

City of New Braunfels Drainage and Erosion Control Design Manual

2016

Manual Updates:

2017-1, 2018-1

Notice of Manual Updates 2017-1

Manual: City of New Braunfels Drainage and Erosion Control Design Manual (2016)

From: Engineering Division | Public Works Department

City Council Approval: August 28, 2017

Effective Date: September 1, 2017

Purpose: To provide clarification and implement best practices.

Content: The following updates were made to the City of New Braunfels Drainage and Erosion Control Design Manual (2016):

Chapter 2 – Drainage Policy and Criteria

- Section 2.1.4 – Specify requirements for Preliminary Drainage Report.
- Section 2.1.5 – Specify requirements for Master Drainage Plan Report.
- Section 2.5 – Specify that the elevation of the lowest floor shall be elevated to 10 inches above finished grade of the surrounding ground (in previous DCM).
- Section 2.5 – Specify that the elevation of the lowest floor shall be elevated to 12 inches above adjacent stormwater conveyance structures (clarification).
- Section 2.5 – Require and specify grading plan required at plat and building permit.
- Section 2.5 – Specify that residential lots shall be graded to avoid water flowing over curb and driveway, and out of right-of-way.
- Section 2.7 – Specify that if development activity changes runoff characteristics that creates point discharge or any increase in discharge rates or velocities, the flow shall outfall into right-of-way or drainage easement that has capacity and an impact analysis is required to verify capacity and no adverse impact.
- Section 2.7 – Specify engineered retaining walls greater than three feet shall be designed to prevent freefall of stormwater.
- Section 2.11 – Specify pumped drainage facilities design, maintenance and operations requirements.
- Section 2.11 – Require feasibility analysis of pumped detention prior to permit application.

Supersedes: The revised manual supersedes prior versions of the City of New Braunfels Drainage and Erosion Control Design Manual (2016)

Notice of Manual Updates 2018-1

Manual: City of New Braunfels Drainage and Erosion Control Design Manual (2016)

From: Engineering Division | Public Works Department

City Council Approval: January 22, 2018

Effective Date: February 5, 2018

Purpose: To provide amend and clarify channel and maintenance access requirements.

Content: The following updates were made to the City of New Braunfels Drainage and Erosion Control Design Manual (2016):

Chapter 2 – Drainage Policy and Criteria

- Section 2.3 – Clarify and revise channel definition, design frequency and freeboard.
- Section 2.10.2 – Clarify easement and maintenance access criteria.

Chapter 8 – Open Channels

- Section 8.1 – Clarify easement and maintenance access criteria and specify pilot channel and channel fencing requirements.

Appendix B – Definition of Terms

- Redefine channel and define ditch and swale.

Supersedes: The revised manual supersedes prior versions of the City of New Braunfels Drainage and Erosion Control Design Manual (2016)

Table of Contents

Notice of Manual Updates 2017-1.....	1-2
Table of Contents	i
List of Figures	iv
List of Tables	v
List of Appendices	vi
1 Introduction	1-1
1.1 Purpose and Scope.....	1-1
1.2 Applicability.....	1-1
1.3 Computer Programs.....	1-1
1.4 References and Definition of Terms	1-1
1.5 Acknowledgements.....	1-2
2 Drainage Policy and Criteria.....	2-1
2.1 Drainage and Water Quality Design Requirements	2-1
2.2 Type 3 Drainage and Water Quality Report Criteria	2-3
2.3 Freeboard.....	2-4
2.4 Drainage Easements and Rights-of-way	2-4
2.5 Finished Floor Elevations	2-5
2.6 Stormwater Mitigation	2-6
2.7 Drainage Facility Design	2-6
2.8 Stream Bank Erosion Hazard Setbacks.....	2-7
2.9 Water Quality Controls	2-8
2.10 Maintenance of Drainage Facilities.....	2-8
2.11 Pumped Drainage Facilities.....	2-8
3 Design Rainfall.....	3-1
3.1 Rainfall Intensity Duration Frequency	3-1
3.2 Rainfall Depth Duration Frequency.....	3-2
4 Determination of Design Discharge	4-1
4.1 General Requirements	4-1
4.2 The Rational Method	4-1
4.3 SCS/NRCS Unit Hydrograph.....	4-6
4.4 Hydrologic Computer Programs.....	4-8
5 Street Flow	5-1
5.1 General Requirements	5-1
5.2 Positive Overflow	5-1
5.3 Street Flow Calculations.....	5-1
5.4 Alley Flow Limitations	5-5

5.5	Alley Flow Calculations.....	5-5
6	Inlet Design	6-1
6.1	General Requirements	6-1
6.2	Inlet Types and Descriptions	6-3
6.3	Inlet Capacity Calculations	6-4
7	Storm Drain Systems.....	7-1
7.1	General Requirements	7-1
7.2	Design Criteria.....	7-2
7.3	Calculation of the Hydraulic Grade Line	7-3
7.4	Hydraulic Grade Line Computation Sheet.....	7-16
8	Open Channels	8-1
8.1	General Requirements	8-1
8.2	Design Criteria.....	8-2
8.3	Channel Capacity.....	8-3
8.4	Roughness Coefficients	8-3
8.5	Subdividing Cross-Sections	8-6
8.6	Slope Conveyance Method	8-6
8.7	Standard Step Backwater Method.....	8-8
8.8	Supercritical Flow.....	8-12
8.9	Flow in Bends	8-13
8.10	Shear Stress.....	8-13
8.11	Drop Structures.....	8-16
8.12	Energy Dissipators.....	8-17
9	Bridges and Culverts	9-1
9.1	General Requirements	9-1
9.2	Bridge Design Criteria	9-1
9.3	Culvert Design Criteria	9-2
9.4	Culvert End Treatments	9-2
9.5	Culvert Hydraulics	9-3
9.6	Debris Fins.....	9-5
9.7	Culvert Outlet Protection.....	9-5
9.8	Energy Dissipation.....	9-5
10	Detention and Retention Facilities	10-1
10.1	General Requirements	10-1
10.2	Design Criteria.....	10-3
10.3	Outlet Structure Design	10-3
11	Lakes, Dams and Levees.....	11-1
11.1	Lakes and Dams.....	11-1
11.2	Levees.....	11-3

12	Site Erosion Control During Construction	12-1
12.1	Applicable Properties or Construction Sites	12-1
12.2	General Guidelines for Erosion Control Plan	12-1
12.3	Stream Bank Erosion	12-2
13	Water Quality Controls	13-1
13.1	Applicability	13-1
13.2	Design Criteria	13-1
13.3	Treatment Methods	13-1
13.4	Maintenance	13-2

List of Figures

Figure 2-1: Typical Federal Housing Administration Lot Grading	2-5
Figure 5-1: Typical Gutter Sections	5-2
Figure 5-2: Chart 1B – Flow in Triangular Gutter Sections.....	5-4
Figure 6-1: Curb Opening Inlet Examples	6-2
Figure 6-2: Depressed Curb Opening Inlet.....	6-2
Figure 6-3: Inlet Types.....	6-3
Figure 6-4: Gutter Cross-Section Diagram	6-5
Figure 6-5: Slotted Drain Inlet Interception Rate.....	6-11
Figure 6-6: Perimeter Length for Grate Inlet in Sag Configuration.....	6-14
Figure 6-7: Relationship between Head and Capacity for Weir and Orifice Flow	6-15
Figure 7-1: Access Hole Energy Level Definitions	7-8
Figure 7-2: Access hole benching methods	7-11
Figure 7-3: Access hole angled inflow definition	7-13
Figure 8-1: EGL for Water Surface Profile	8-9
Figure 9-1: Typical Culvert End Treatments.....	9-3
Figure 10-1: Definition Sketch for Orifice Flow.....	10-4
Figure 10-2: Sharp Crested Weirs	10-5
Figure 10-3: V-Notch Weir	10-8
Figure 10-4: Proportional Weir Dimensions	10-9
Figure 10-5: Emergency Spillway Design Schematic.....	10-10
Figure 10-6: Discharge Coefficients for Emergency Spillways, English Units	10-11

List of Tables

Table 2-1: Development Categories	2-1
Table 2-2: Freeboard Requirements	2-4
Table 2-3: Stream Bank Erosion Hazard Setbacks.....	2-7
Table 3-1: New Braunfels Rainfall Intensity Constants.....	3-1
Table 3-2: New Braunfels Area Depth-Duration Value.....	3-2
Table 4-1: Runoff Coefficients.....	4-2
Table 4-2: Manning's "n" for overland flow.....	4-4
Table 4-3: NRCS Runoff Curve Numbers for Urban Areas and Agricultural Lands	4-7
Table 4-4: Curve Numbers for Fully Developed Conditions.....	4-8
Table 5-1: Water Spread Limits for Roadways.....	5-1
Table 5-2: Manning's n for Street and Pavement Gutters	5-5
Table 6-1: Splash-Over Velocity Calculation Equations	6-13
Table 7-1: Maximum Spacing of Manholes and Junction Boxes.....	7-2
Table 7-2: Maximum Velocity in Storm Drains	7-3
Table 7-3: Frequencies for Coincidental Occurrences	7-5
Table 7-4: Values for the Coefficient, CB	7-11
Table 8-1: Maximum Velocity in Open Channels.....	8-2
Table 8-2: Manning's Roughness Coefficients	8-5
Table 8-3: Retardation Class for Lining Materials	8-15
Table 8-4: Permissible Shear Stresses for Various Linings	8-16
Table 8-5: Minimum Lengths of Downstream Aprons beyond Hydraulic Jumps	8-17
Table 9-1: Entrance Loss Coefficients	9-4
Table 10-1: English Units-Broad-Crested Weir Coefficient C Values as a Function of Weir Crest.....	10-7
Table 10-2: Emergency Spillway Design Parameters (English units)	10-13

List of Appendices

Appendix A: References

Appendix B: Definition of Terms

Appendix C: Stream Bank Erosion Hazard Setbacks Exhibit

1 Introduction

1.1 Purpose and Scope

The purpose of the Drainage and Erosion Control Design Manual is to establish standard principles and practices for the design and construction of storm drainage, flood protection, erosion control, and water quality facilities within the City of New Braunfels, Texas and its extraterritorial jurisdiction (ETJ).

The design factors, formulas, graphs, and procedures described in this manual are intended to serve as guidelines for the design of drainage improvements and projects involving the volume, rate of flow, method of collection, storage, conveyance, treatment, and disposal of stormwater and erosion protection from stormwater flows. Responsibility for actual design remains with the design engineer. Any variations from the methodology or requirements in this manual must have expressed written approval of the City Engineer and Engineering Division, as permitted by Ordinance.

This manual and the City of New Braunfels Code of Ordinances contain requirements for the design of storm drainage, flood protection, water quality, and erosion control facilities. Where there is any conflict between this manual and the current code, the code shall take precedence. The design engineer is responsible for complying with the latest version of this manual and code adopted by the City.

Should conflicts occur between policy and criteria in this manual versus other regulatory authorities with jurisdiction in the same area, such as Texas Commission on Environmental Quality (TCEQ) or Texas Department of Transportation (TxDOT), then the more stringent requirement will apply and the designer will need to show how both requirements have been met.

1.2 Applicability

Criteria in this manual shall apply to all drainage improvements and projects that may have an impact on drainage, both publicly and privately funded, within the City of New Braunfels, Texas and within its ETJ. Criteria in this manual shall apply to any capital improvement or development project, plat, master plan, or building permit except as otherwise noted in the manual.

1.3 Computer Programs

The use of computer programs for calculating and modeling storm data and drainage facilities is accepted as standard practice. There are a variety of computer programs available and the design engineer maintains responsibility of selecting the appropriate approach and/or computer program unless otherwise specified in this manual. Computer programs are not a replacement for sound engineering judgment and the user must understand how the program performs the calculations and what assumptions are made.

1.4 References and Definition of Terms

At certain points in the text, the reader will encounter numbers enclosed in brackets, for example [1]. These numbers correspond to the references listed in **Appendix A**. Figures and tables reproduced from

other sources have the source listed beneath each figure or table. Common terms used in this manual are provided in **Appendix B**.

1.5 Acknowledgements

This manual is the result of the dedication and energy of the Drainage Advisory Committee members for the 2000 edition. For the 2015 update, acknowledgements go to City staff, Watershed Advisory Committee, Design Workshop, Lockwood Andrews & Newnam, Inc., and input from a wide variety of stakeholders.

2 Drainage Policy and Criteria

2.1 Drainage and Water Quality Design Requirements

All drainage improvements and projects shall be designed and constructed in accordance with the current regulations, standards and specifications adopted by the City of New Braunfels. Any capital improvement or development project within the City of New Braunfels jurisdiction is required to comply with the requirements outlined in this manual. When necessary, properly sized easements shall be granted across all contiguous property owned by the property owner.

A drainage report is required to be submitted by the property owner or its agent according to the requirements of this manual. The Engineering Division prior to issuance of a permit must approve the report. The type of development and report shall be based on the location and additional impervious cover of the development as shown in Table 2-1.

Table 2-1: Development Categories

Category	Criteria
Type 1 Development	Less than one acre of land; and < 1,000 SF additional impervious cover
Type 2 Development	Less than one acre of land; and 1,000 – 4,999 SF additional impervious cover; or Agricultural development (not including feedlots)
Type 3 Development	≥ 5,000 SF additional impervious cover; or Development within FEMA designated Special Flood Hazard Area

If any onsite and offsite stormwater structure related to the development is known to be at or above design capacity, the development will be considered a Type 3 Development.

Drainage report requirements are outlined below. An electronic media copy of the report is required in addition to a paper copy at time of city acceptance of infrastructure improvements.

2.1.1 Type 1 Drainage Report

A Type 1 Development is any development or redevelopment that disturbs less than one acre of land and creates less than 1,000 square foot of additional impervious cover. The Type 1 Drainage Report shall be prepared by the property owner or its agent, and consist of the following:

- A. Applicant contact information (e.g. name, address, phone number, and email address)
- B. Site location map
- C. Detailed site drawing or sketch showing any existing features or infrastructure and proposed disturbance
- D. Temporary erosion control plan

2.1.2 Type 2 Drainage Report

A Type 2 Development is any development or redevelopment that disturbs less than one acre of land, and creates more than 1,000 but less than 5,000 square foot of additional impervious cover. Type 2 Developments also include any agricultural development not including feedlots. The Type 2 Drainage Report shall be prepared by the property owner or its agent, and consist of the following:

- A. Applicant contact information (e.g. name, address, phone number, and email address)
- B. Site location map
- C. Detailed site drawing or sketch of the affected area scaled to 1" = 50' (or less) on minimum 11" x 17" paper showing the following:
 1. Existing drainage ways and easements
 2. Runoff flow directions
 3. Floodplain boundaries
 4. Proposed grading and development
 5. Proposed drainage and erosion control facilities
 6. A copy of the survey plat showing the lot layout, streets, and utility and drainage easements
- D. Temporary erosion control plan
- E. If any on-site and off-site stormwater structure related to this development is known to be at or above design capacity, the development will be considered a Type 3 Development

2.1.3 Type 3 Drainage and Water Quality Report

A Type 3 Development is any development or redevelopment greater than or equal to 5,000 square feet of additional impervious cover, not Type 1 or Type 2, or any development within a Federal Emergency Management Agency (FEMA) designated Special Flood Hazard Area. A Type 3 Drainage and Water Quality Report shall be prepared by a professional engineer licensed in the State of Texas, experienced in civil engineering, and having a thorough knowledge of the hydraulic analysis and design. The report shall be signed and sealed, per Texas Board of Professional Engineers, by the person responsible for the report. The Type 3 Drainage and Water Quality Report shall consist of the following:

- A. Applicant contact information (e.g. name, address, phone number, and email address)
- B. Site location map
- C. A copy of the final plat showing the lot layout, streets, and utility and drainage easements
- D. Construction drawings adhering to all applicable codes and regulations including details and specifications
- E. Drainage and Water Quality Report as outlined in **Section 2.2 – Type 3 Drainage and Water Quality Report Criteria**
- F. Temporary and permanent erosion control plan as outlined in **Section 12 – Site Erosion Control**
- G. Approval letters from other agencies with jurisdiction or permit requirements for the site location

2.1.4 Preliminary Drainage Report

A Preliminary Drainage Report of the storm drainage system is required with a preliminary plat. The report shall include the following:

- A. Preliminary Drainage Site Plan including: plat boundary; existing and proposed drainage infrastructure, right-of-way and easements in and adjacent to the plat; proposed stormwater connections and point(s) of development discharge; and proposed changes to floodplain and floodway boundaries. Drainage infrastructure includes inlets, channels, storm sewer, detention, retention and water quality facilities.
- B. Conformance with the Master Drainage Plan Report (if applicable) specified in **Section 2.1.5**. The report may require updating for development plat submittals and changes in the drainage design.

2.1.5 Master Drainage Plan Report

A Master Drainage Plan Report shall be provided with a subdivision master plan and planned development. The report shall include the following:

- A. Existing Drainage Site Plan including: development boundary; existing and proposed drainage infrastructure, right-of-way and easements in and adjacent to the development; and floodplain and floodway boundaries. Drainage infrastructure includes inlets, channels, storm sewer, detention, retention and water quality facilities.
- B. Existing Watershed Map including: development boundary; existing drainage area and all sub areas; 2-foot contours; and existing runoff flow directions.
- C. Preliminary Drainage Site Plan including: development boundary; proposed drainage infrastructure, right-of-way and easements in and adjacent to the development; proposed stormwater connections and point(s) of development discharge; and proposed changes to floodplain and floodway boundaries.
- D. Master Drainage Plan Summary including how drainage and water quality resulting from the proposed development will be managed and how proposed drainage infrastructure will impact adjacent property owners.

2.2 Type 3 Drainage and Water Quality Report Criteria

The planning and design of drainage systems should ensure that problems are not transferred from one location to another. Grading and other construction activities may not change the terrain in such a way to cause damage to public or private property from drainage or flood problems, increased runoff, or increased erosion or sediment movement.

Existing drainage between developed lots will remain the responsibility of the affected property owners. Commercial developments are required to drain surface runoff from an individual lot to a public right-of-way or to a drainage system contained in an easement. Residential lot-to-lot drainage of sheet flows should be avoided, and residential developments are encouraged to direct surface runoff to a public right-of-way or to a drainage system contained in an easement.

The Engineering Division shall not approve any drainage report pertaining to proposed construction, platting or other development where the proposed activity or change in the land would result in post-development discharge from the site exceeding discharge under pre-developed conditions (for new development) or existing conditions (for re-development). Downstream capacity shall not be exceeded as a result of development. Exemptions from this provision are as follows:

- A. Additional drainage improvements are not required if drainage improvements have been provided for the fully developed condition, which includes the proposed development.
- B. Prior written approval of a Stormwater Connection Fee from the City Engineer.

No proposed development shall be constructed which impedes or constricts runoff from an upstream watershed based on fully developed conditions. Therefore drainage computations shall be provided to verify no adverse impact upstream or downstream.

2.3 Freeboard

Freeboard is the vertical distance between the design water surface and the elevation of the drainage facility, such as the top of channel or detention pond. Freeboard is intended to provide a factor of safety and prevent the fluctuation of the water surface from overflowing the drainage facility. Freeboard requirements are shown in Table 2-2. Freeboard is not required where parking areas are designed to serve as detention facilities; however, site design should consider safety and drainage overflow location.

Table 2-2: Freeboard Requirements

Drainage Facility	Design Frequency	Minimum Freeboard
Street right-of-way	100-year	None
Creek improvements	100-year	1.0 ft
Channels with drainage area > 128 acres	100-year	1.0 ft
Channels with drainage area \leq 128 acres		
• 100-year design depth < 5 ft	100-year	25-year + 0.5 ft
• 100-year design depth 5-10 ft	100-year	25-year + 10% design depth
• 100-year design depth > 10 ft	100-year	25-year + 1.0 ft
Detention ponds and reservoirs	100-year	1.0 ft
Bridges and culverts	25-year	See note 2
Floodways and floodplains	100-year	2.0 ft (See note 3)

¹ Channels with drainage area \leq 128 acres shall be designed to contain the 100-year storm event or 25-year storm event plus freeboard, whichever is greater.

² Bridges and culverts shall be designed to withstand the 100-year event, but the water level may reach roadway level at the 25-year design level if no public safety issues are involved.

³ Floodways and floodplains shall have a minimum of 2-feet freeboard or the minimum freeboard established in the most recently adopted Floodplain Ordinance.

2.4 Drainage Easements and Rights-of-way

All private drainage and water quality facilities must have an associated drainage easement, restrictive covenant, or similar recorded instrument that clearly identifies ownership and the party responsible for


maintenance. Drainage easements and rights-of-way shall be dedicated to the City as required in the Code of Ordinances.

2.5 Finished Floor Elevations

The elevation of the lowest floor shall be elevated 10 inches above the finished grade of the surrounding ground as prescribed in the building regulations and Code of Ordinances. Finished grades shall be sloped to direct stormwater away from the structure. Developments adjacent to stormwater conveyance structures must be elevated 12 inches above the 100-year water flow elevation (in the conveyance structure) to the same elevation that a development adjacent to a 100-year floodplain would be required to meet. Driveways serving houses on the downhill side of the street shall have properly sized swales before entering the garage.

A grading plan shall be prepared and submitted to the City at final plat and building permit, which indicates typical lot grading for all lots in the subdivision using typical Federal Housing Administration (FHA) lot grading types (A, B and C). See Figure 2-1. No more than two (2) residential lots may drain onto another lot unless a drainage easement is dedicated and free of obstructions to contain the runoff. An alternate grading plan may be submitted for large lot or commercial subdivisions.

Figure 2-1: Typical Federal Housing Administration Lot Grading

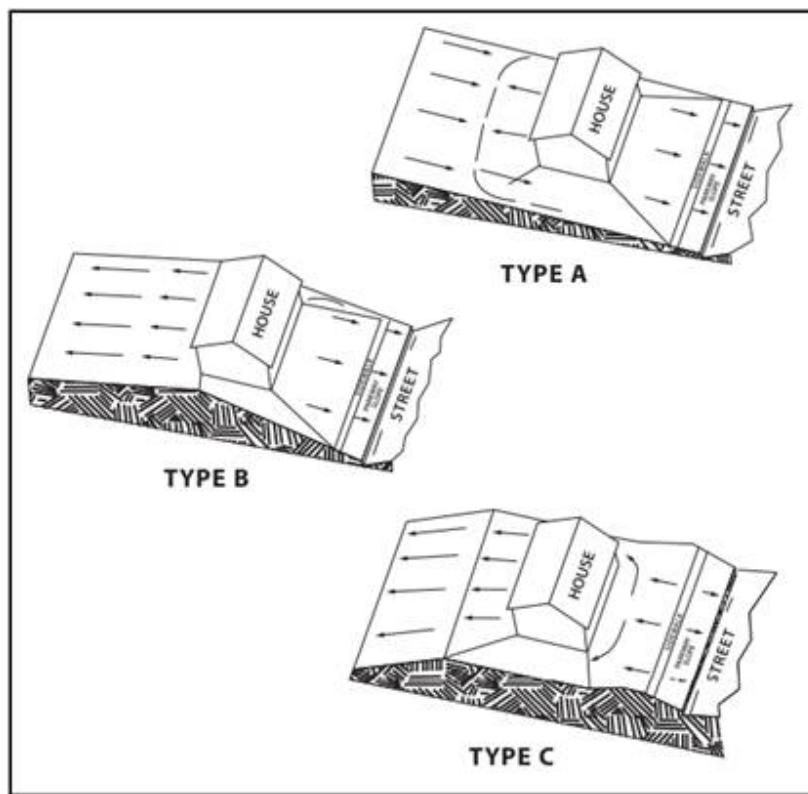

Where residential lots are located on the downhill side of a T-intersection, cul-de-sac, or elbow, the street intersection shall be graded so to avoid water flowing over the curb and driveway, and out of the

right-of-way. Detailed calculations shall be required at permit to show that the discharges are contained within the right-of-way.

2.6 Stormwater Mitigation

It is the intent of this manual, in concert with applicable ordinances, to provide all development under its jurisdiction the option of providing mitigation or demonstrating that no mitigation is in the best interest of the watershed and paying a share of the cost to participate with a stormwater connection fee.

Mitigation through detention, retention, or some other technique must be designed, constructed, and maintained to reduce the post-development discharge rates to below that of pre-development/existing rates for the two (2), ten (10), twenty-five (25), and one-hundred (100) year design storms. Participation in neighborhood or regional mitigation is an acceptable option.

Demonstration that no mitigation is in the best interest of the watershed shall be accomplished by showing no adverse impact due to any increased runoff from the proposed development for the design storms. Approval of a Stormwater Connection Fee is required in compliance with Chapter 143 of the Code of Ordinances. The property owner, or his/her designee, shall meet with the Engineering Division to discuss mitigation and/or Stormwater Connection Fee options prior to commencing the project.

For stormwater mitigation, the following two development conditions shall be analyzed with each adverse impact analysis:

- A. Existing Conditions. This refers to current development conditions in the watershed and on site. This shall be used as the baseline for determining the impact of the development of the site, or the watershed, to other properties or drainage systems.
- B. Proposed Conditions. This refers to existing conditions with the proposed development added. This shall be used to determine if the increased runoff from the proposed development results in an adverse impact to other properties or drainage systems.

2.7 Drainage Facility Design

Drainage design in the urban environment should also consider appearance as an integral part of the design and structures should generally blend with the natural surroundings as much as possible to maintain the aesthetics of the natural area.

The City requires preservation of the natural floodplains. The protection of existing trees and vegetation should be maximized during development of drainage plans. Whenever possible, the replacement of the trees destroyed by drainage and flood protection procedures is encouraged.

Computations to support all drainage designs shall be submitted to the Engineering Division for review in an easy to follow format. On-site pre-development stormwater runoff computations shall be based upon conditions representing the existing land conditions with respect to soil type, percentage cover, and cover type as indicated by current aerial imagery and supporting documentation. Design of structures shall use fully developed sub-basin conditions for the prescribed design storms based on the

sub-basin zoning. If zoning does not exist, then the engineer shall assume the ultimate development based on the most recently adopted Future Land Use Plan.

If a development activity changes stormwater runoff characteristics in a manner that creates a point or points of concentrated flow, where previously there was sheet flow or lesser intensity flow pattern, or any increase in discharge rates or velocities for the 2, 10, 25 and 100-year frequency storms, the flow shall outfall into right-of-way or drainage easement that has the capacity for the discharge. An impact analysis is required to verify the capacity and/or required size of the downstream facility clearly demonstrating no adverse impact.

In development of engineered retaining walls greater than three feet, drainage facilities shall be designed in such a manner as to prevent the freefall of stormwater from natural drainage patterns and sheet flow conditions.

The design requirements and criteria are specified in following chapters. Modeling and calculations shall be included in drainage report submittals to ensure the specified criteria are met for all drainage infrastructure improvements. Infrastructure that is within TxDOT right-of-way and requires dual permitting from both the City and TxDOT shall be designed in compliance with the more conservative requirements.

2.8 Stream Bank Erosion Hazard Setbacks

Erosion hazard setback zone determination is necessary for the banks of streams in which the natural channel is to be preserved. The purpose of the setbacks is to reduce the amount of structural damage and stream degradation caused by the erosion of the bank. With the application of stream bank erosion hazard setbacks, an easement is dedicated to the City such that no structure can be located, constructed, or maintained in the area encompassing the erosion hazard setback.

The City allows for stream bank stabilization as an alternative to dedicating the erosion hazard setback zone. Stream bank erosion hazard setbacks may extend beyond the limits of the regulatory floodplain and are shown in Table 2-3.

Table 2-3: Stream Bank Erosion Hazard Setbacks

Contributing Drainage Area (square miles)	Setback Distance from Stream Centerline (feet)
0-1	0
1-5	50
5 or more	100

A map delineating the contributing drainage area sizes along each stream in the City's jurisdiction is included for reference in **Appendix C**. For the purpose of this manual, any watercourse that was included in the rivers and stream data set published in the United States Geological Survey (USGS) National Hydrography Dataset (NHD) in 2013 was considered a stream.

2.9 Water Quality Controls

Temporary water quality best management practices (BMPs) shall be required when any disturbance could result in appreciable erosion that could result in measurable accumulation of sedimentation in dedicated streets, alleys, any waterway or other private properties during construction activities. Site erosion control requirements are provided in **Section 12**.

Development and redevelopment located over the Edwards Aquifer regulatory zones shall comply with the latest TCEQ published rules and technical design guidance for the Edwards Aquifer. Permanent water quality BMPs for development outside of the Edwards Aquifer regulated zones shall be designed to provide adequate treatment of the water quality volume in the City's jurisdiction as defined in **Section 13**.

2.10 Maintenance of Drainage Facilities

The property owner or designee will maintain the hydraulic integrity of drainage systems not dedicated to the City. The City will maintain the hydraulic integrity of drainage systems dedicated to and accepted by the City. Maintenance of the floodplain, drainage easements, and water quality features shall be explicitly stated in a recorded instrument.

2.10.1 Maintenance Schedule

A maintenance schedule supported by engineering or scientific published documents shall be submitted to the Engineering Division prior to approval of construction plans for public and private facilities. The City has the right to conduct periodic inspections of privately owned and maintained drainage and water quality improvements to ensure that the maintenance schedule is being implemented.

2.10.2 Maintenance Access

Access shall be provided for all channels to allow equipment access for maintenance. Access shall have a width of at least 12 feet and a cross slope no greater than two percent. Maintenance ramps used for access shall have a vertical grade no steeper than 6:1. An unobstructed access easement connecting the channel drainage easement with a roadway parallel to or near the easement shall be provided at a minimum spacing of one access easement at a minimum of 1,000 feet intervals. Access shall be provided within dedicated right-of-way or within the drainage easement dedicated for the channel. The bottom of the channel cannot be considered as maintenance access.

2.11 Pumped Drainage Facilities

The City of New Braunfels discourages the use of Pumped Drainage Facilities. A Pumped Drainage Facility is defined as any drainage system not wholly utilizing gravity outflow. Facility designs considered under this section's guidelines must first demonstrate that a gravity system is not feasible from both an engineering and economic standpoint. A feasibility analysis is required to be submitted prior to permit application. The applicant must have expressed written approval from the City Engineer and Engineering Division with permit application.

Pumped Drainage Facilities will only be acceptable in commercial applications and must meet all other drainage requirements outlined in this manual. All approved Pumped Drainage Facilities must be

privately owned and maintained. The owner assumes responsibility for any damage to property as a result of a system's normal operation or failure.

2.11.1 Design Requirements

If approved by the Engineering Division, Pumped Drainage Facilities design submittals should include the following items:

- A. Pump discharge shall be used for a maximum of 50% of the total required basin capacity, not including freeboard. The remaining volume must discharge by gravity.
- B. A minimum of two (2) pumps will be provided, each of which is sized to pump the designed flow rate.
- C. Provide an emergency power source for the drainage facility pumps.
- D. Design should include but not be limited to controls, pumps, cycling and anti-vandalism measures.
- E. Facility discharge must be into an existing right-of-way or drainage easement that has the capacity for the increase discharge.
- F. Provide an armored gravity emergency outflow structure designed to allow the outflow of the 100-year design storm, assuming the pond is full and the discharge is 100% clogged. At minimum, the emergency overflow shall engage when ponding exceeds the 100-year water surface elevation plus freeboard.

2.11.2 Maintenance and Operations

A maintenance and operations plan shall be submitted to the Engineering Division prior to approval of construction plans for all facilities. The City has the right to conduct periodic inspections of privately owned and maintained drainage improvements to ensure that the maintenance schedule is being implemented.

This page intentionally left blank.

3 Design Rainfall

3.1 Rainfall Intensity Duration Frequency

The City evaluated area rainfall data in 2011 following the procedures outlined in United States Geological Survey (USGS) *Water Resources Investigation Report 98-4044* [1]. The data set used in 2011 included several significant rain events that occurred after the USGS analysis. The City determined that the following rainfall data was more appropriate for use in this area than the USGS analysis. Rainfall intensities will be computed using the Intensity Duration Frequency (IDF) equation (Equation 3-1) below and appropriate design frequency coefficients provided in Table 3-1. This equation is to be used only with time of concentrations between 10 minutes and 3 hours.

Equation 3-1

$$I = \frac{b}{(T_C + d)^e}$$

Where:

I = Rainfall intensity (in/hr)

T_C = Time of concentration (min)

b, d, e = Rainfall intensity constants.

Table 3-1: New Braunfels Rainfall Intensity Constants

Year	Intensity Constants		
	b	d	e
2	69.7	12.03	0.857
5	61.2	9.61	0.762
10	59.8	7.69	0.720
25	64.6	7.14	0.691
50	68.4	6.40	0.673
100	74.9	5.95	0.663

3.2 Rainfall Depth Duration Frequency

The appropriate rainfall depths for calculations in the New Braunfels area are provided in Table 3-2.

Table 3-2: New Braunfels Area Depth-Duration Value

Year	Area Depth-Duration (inches)									
	5-Min	15-Min	1-Hr	2-Hr	3-Hr	6-Hr	12-Hr	24-Hr	2-Day	3-Day
2	0.51	1.05	1.65	2.19	2.44	2.87	3.10	3.34	3.98	4.31
5	0.66	1.34	2.33	3.08	3.48	4.17	4.45	4.83	5.66	6.20
10	0.80	1.58	2.84	3.72	4.23	5.11	5.49	6.06	7.00	7.72
25	0.96	1.89	3.56	4.61	5.26	6.41	7.07	8.06	9.08	10.11
50	1.11	2.16	4.17	5.32	6.10	7.47	8.50	9.96	10.99	12.34
100	1.28	2.47	4.84	6.08	6.99	8.61	10.18	12.30	13.30	15.04

4 Determination of Design Discharge

4.1 General Requirements

The selection of the appropriate method for calculating runoff depends upon the size of the drainage area, time of concentration, and detention mitigation. Flows are to be analyzed for both existing and proposed conditions at all locations where runoff leaves a proposed project for the 2, 10, 25, and 100-year frequencies. Design discharges are to be calculated by either Rational Method or Unit Hydrograph.

4.2 The Rational Method

Rational Method equation is based on the following assumptions:

- Rainfall intensity is constant over the time it takes to drain the watershed (time of concentration)
- The runoff coefficient remains constant during the time of concentration
- The watershed area does not change
- The minimum time of concentration is not less than 10 minutes and does not exceed 3-hours

The Rational Method may be used to generate peak flows for drainage basins less than 150 acres that do not require detention or timing considerations. For drainage areas in excess of 150 acres, reclaiming floodplains, creating lakes or building other types of drainage-related facilities on major drainage courses where the use of the Rational Method does not provide reliable results, a unit hydrograph method shall be used. The discharge computed by the Rational Method is the peak discharge for a given frequency on the watershed in question, and is given by the following relationship (Equation 4-2):

Equation 4-1

$$Q = CIA$$

Where:

Q = peak design for a given frequency on the watershed at the desired design point (cfs)

C = dimensionless weighted runoff coefficient, representing ground cover conditions and/or land use within the watershed area. (See Table 4-1)

I = average rainfall intensity in inches per hour at a rainfall duration equal to the time of concentration, associated with the desired design frequency. (See Table 3-1) (in/hr)

A = the drainage area in acres contributing runoff to the desired design point (acres).

4.2.1 Runoff Coefficient

Suggested coefficients with respect to specific surface types are given in Table 4-1. "C" values for developed conditions should be based on composite values. The Engineering Division must approve assumptions for fully developed conditions where maximum allowable impervious cover is not defined by city ordinance. The runoff coefficients include an antecedent precipitation factor to reflect the additional runoff that results from saturated ground conditions with less frequent recurrence intervals.

Table 4-1: Runoff Coefficients

RATIONAL METHOD RUNOFF COEFFICIENTS FOR COMPOSITE ANALYSIS							
Runoff Coefficient (C)							
Character of Surface	Return Period						
	2 Years	5 Years	10 Years	25 Years	50 Years	100 Years	500 Years
DEVELOPED							
Asphaltic	0.73	0.77	0.81	0.86	0.90	0.95	1.00
Concrete	0.75	0.80	0.83	0.88	0.92	0.97	1.00
<i>Grass Areas (Lawns, Parks, etc.)</i>							
<u>Poor Condition*</u>							
Flat, 0-2%	0.32	0.34	0.37	0.40	0.44	0.47	0.58
Average, 2-7%	0.37	0.40	0.43	0.46	0.49	0.53	0.61
Steep, over 7%	0.40	0.43	0.45	0.49	0.52	0.55	0.62
<u>Fair Condition**</u>							
Flat, 0-2%	0.25	0.28	0.30	0.34	0.37	0.41	0.53
Average, 2-7%	0.33	0.36	0.38	0.42	0.45	0.49	0.58
Steep, over 7%	0.37	0.40	0.42	0.46	0.49	0.53	0.60
<u>Good Condition***</u>							
Flat, 0-2%	0.21	0.23	0.25	0.29	0.32	0.36	0.49
Average, 2-7%	0.29	0.32	0.35	0.39	0.42	0.46	0.56
Steep, over 7%	0.34	0.37	0.40	0.44	0.47	0.51	0.58
UNDEVELOPED							
<u>Cultivated</u>							
Flat, 0-2%	0.31	0.34	0.36	0.40	0.43	0.47	0.57
Average, 2-7%	0.35	0.38	0.41	0.44	0.48	0.51	0.60
Steep, over 7%	0.39	0.42	0.44	0.48	0.51	0.54	0.61
<u>Pasture/Range</u>							
Flat, 0-2%	0.25	0.28	0.30	0.34	0.37	0.41	0.53
Average, 2-7%	0.33	0.36	0.38	0.42	0.45	0.49	0.58
Steep, over 7%	0.37	0.40	0.42	0.46	0.49	0.53	0.60
<u>Forest/Woodlands</u>							
Flat, 0-7%	0.22	0.25	0.28	0.31	0.35	0.39	0.48
Average, 2-7%	0.31	0.34	0.36	0.40	0.43	0.47	0.56
Steep, over 7%	0.35	0.39	0.41	0.45	0.48	0.52	0.58
Composite "C" value for developed conditions (C_{DEV}) is : $C_{DEV} = IC_1 + (1-I)C_2$							
Where:							
I = Impervious cover, percent							
C_1 = "C" value for impervious cover							
C_2 = "C" value for pervious area (grass, lawns, parks, etc.)							
* Grass cover less than 50 percent of the area.							
** Grass cover on 50 to 75 percent of the area.							
*** Grass cover larger than 75 percent of the area.							
Source: <i>City of Austin Drainage Criteria Manual</i> [2]							

The drainage area under investigation may consist of several different drainage surfaces or zoning classifications. In such cases, an average coefficient weighted in accordance with the respective areas shall be used, as outlined in Equation 4-2.

Equation 4-2

$$C_w = \left(\frac{A_1 C_1 + A_2 C_2 + \cdots + A_n C_n}{A_1 + A_2 + A_3 + \cdots + A_n} \right)$$

4.2.2 Time of Concentration

The time of concentration (T_c) is the amount of time required for surface runoff to travel from the most hydraulically remote point within the drainage basin to the drainage point under consideration. The most hydraulically remote drainage point refers to the route requiring the longest drainage travel time and not necessarily the greatest linear distance. Furthermore, the most hydraulically remote point must be taken from a location that best represents the majority of the contributing area.

The Natural Resources Conservation Service (NRCS) method in *Technical Release 55: Urban Hydrology for Small Watersheds (TR-55)* [3] is the preferred method for estimating time of concentration, unless the design engineer can justify why an alternative method is more suitable for the watershed under analysis. Other methodologies can be used but must be approved by the Engineering Division.

The procedure for estimating time of concentration, as described in TR-55, is outlined below. The overall time of concentration is calculated as the sum of the sheet, shallow concentrated and channel flow travel times as shown in Equation 4-3. Note that there may be multiple shallow concentrated and channel segments depending on the nature of the flow path.

Equation 4-3

$$T_c = T_{t(sheet)} + T_{t(shallow concentration)} + T_{t(channel)}$$

Sheet Flow

Sheet flow is shallow flow over land surfaces, which usually occurs in the headwaters of streams. The engineer should realize that sheet flow occurs for only very short distances, especially in urbanized conditions. Sheet flow for both natural (undeveloped) and developed conditions should be limited to a maximum of 100 feet. Sheet flow for developed conditions should be based on the actual pavement or grass conditions for areas that are already developed and should be representative of the anticipated land use within the headwater area in the case of currently undeveloped areas. In a typical residential subdivision, sheet flow may be the distance from one end of the lot to the other or from the house to the edge of the lot. In some heavily urbanized drainage areas, sheet flow may not exist in the headwater area. The NRCS method employs Equation 4-4, which is a modified form kinematic wave equation, for the calculation of the sheet flow travel time.

Equation 4-4

$$T_t = \frac{0.007(nL)^{0.8}}{(P_2^{0.5})(s^{0.4})} \times 60$$

Where:

T_t = Sheet flow travel time (min)

L = Length of the reach (ft)

n = Manning's n (see Table 4-2)

P_2 = 2-year, 24-hour rainfall (in) (see Table 3-2)

s = Slope of the ground (ft/ft).

Table 4-2: Manning's "n" for overland flow

Manning's "n" ¹	Surface Description
0.015	Concrete (rough or smoothed finish)
0.016	Asphalt
0.05	Fallow (no residue)
	Cultivated Soils:
0.06	Residue Cover \leq 20%
0.17	Residue cover $>$ 20%
	Grass:
0.15	Short-grass prairie
0.24	Dense grasses ²
0.41	Bermuda Grass
0.13	Range (natural)
	Woods ³ :
0.04	Light underbrush
0.8	Dense underbrush
¹ The Manning's n values are a composite of information compiled by Engman (1986).	
² Includes species such as weeping lovegrass, bluegrass, buffalo grass, blue grama grass, and native grass mixtures.	
³ When selecting n , consider cover to a height of about 0.1 ft. This is the only part of the plant cover that will obstruct sheet flow.	
Source: <i>City of Austin Drainage Criteria Manual</i> [2] and <i>TR-55</i> [3]	

Shallow Concentrated Flow

After a maximum of approximately 100 feet, sheet flow usually becomes shallow concentrated flow collecting in swales, small rills, and gullies. Shallow concentrated flow is assumed not to have a well-defined channel and has flow depths of 0.1 to 0.5 feet. The travel time for shallow concentrated flows can be computed by Equation 4-5 and Equation 4-6. These two equations are based on the solution of Manning's Equation with different assumptions for n (Manning's Roughness Coefficient) and r (hydraulic radius, ft). For unpaved areas, n is 0.05 and r is 0.4; for paved areas, n is 0.025 and r is 0.2.

Equation 4-5 : Unpaved

$$T_t = \frac{L}{(60)(16.1345)(s^{0.5})}$$

Equation 4-6: Paved

$$T_t = \frac{L}{(60)(20.3282)(s^{0.5})}$$

Where:

T_t = Travel time for shallow concentrated flows (min)

L = Length of the reach (ft)

s = Slope of the ground (ft/ft).

4.2.3 Channel or Storm Drain Flow

The velocity in an open channel or a storm drain not flowing full can be determined by using Manning's Equation. Channel velocities can also be determined by using backwater profiles. For open channel flow, average flow velocity is usually determined by assuming a bank-full condition. Note that the channel flow component of the time of concentration may need to be divided into multiple segments in order to represent significant changes in channel characteristics. The details of using Manning's Equation and selecting Manning's "n" values for channels can be obtained from **Section 8**.

For the storm drain flow under pressure conditions (hydraulic grade line is higher than the lowest crown of a storm drain) the following equation should be applied:

Equation 4-7

$$V = \frac{Q}{A}$$

Where:

V = Average velocity (ft/s)

Q = Design discharge (cfs)

A = Cross-sectional area (ft²).

Total travel time through a channel and/or storm drain can be calculated by Equation 4-8.

Equation 4-8

$$T_t = \sum \left(\frac{L_i}{60V_i} \right)$$

Where:

L_i = The i-th channel segment length (ft)

V_i = The average flow velocity within the ith channel segment (ft/s)

T_t = Total flow travel time through the channel (min).

4.3 SCS/NRCS Unit Hydrograph

The preferred unit hydrograph in general is the Soil Conservation Service (SCS)/Natural Resource Conservation Service (NRCS) Dimensionless Unit Hydrograph. The runoff curve number(s) used in calculating the pre-development/existing condition and the post-development condition shall be documented. A fully developed drainage area shall be assumed for the post-development condition.

NRCS curve numbers are to be selected from Table 4-3. Curve numbers in Table 4-4 shall be used when performing an analysis of fully developed conditions. Average antecedent moisture conditions II (AMC II) shall be assumed.

Table 4-3: NRCS Runoff Curve Numbers for Urban Areas and Agricultural Lands

Cover Description	Average % Impervious Area ¹	Curve Numbers for Hydrologic Soil Group				
		A	B	C	D	
Cover Type and Hydrologic Condition						
<i>Fully developed urban areas (vegetation established)</i>						
Open space (lawns, parks, golf courses, cemeteries, etc.):						
Poor condition (grass cover 50%)		68	79	86	89	
Fair condition (grass cover 50% to 75%)		49	69	79	84	
Good condition (grass cover 75%)		39	61	74	80	
Impervious areas:						
Paved parking lots, roofs, driveways, etc. (excluding right of way)		98	98	98	98	
Streets and roads:						
Paved; curbs and storm drains (excluding right of way)		98	98	98	98	
Paved; open ditches (including right of way)		83	89	92	93	
Gravel (including right of way)		76	85	89	91	
Dirt (including right of way)		72	82	87	89	
<i>Developing urban areas</i>						
Newly graded areas (pervious areas only, no vegetation)		77	86	91	94	
<i>Agricultural lands</i>						
Grassland, or range-continuous forage for grazing ²	Poor	68	79	86	89	
	Fair	49	69	79	84	
	Good	39	61	74	80	
Meadow-continuous grass, protected from grazing and generally mowed for hay		30	58	71	78	
Brush—brush-weed-grass mixture with brush the major element ³	Poor	48	67	77	83	
	Fair	35	56	70	77	
	Good	30	48	65	73	
Woods—grass combination (orchard or tree farm). ⁴	Poor	57	73	82	86	
	Fair	43	65	76	82	
	Good	32	58	72	79	
Woods ⁵	Poor	45	66	77	83	
	Fair	36	60	73	79	
	Good	30	55	70	77	
Farmsteads—buildings, lanes, driveways and surrounding lots		59	74	82	86	

¹Poor: less than 50 percent ground cover or heavily grazed with no mulch.

Fair: 50 to 75 percent ground cover and not heavily grazed.

Good: greater than 75 percent ground cover and lightly or only occasionally grazed.

²Poor: less than 50 percent ground cover.

Fair: 50 to 75 percent ground cover.

Good: greater than 75 percent ground cover.

³Curve numbers shown were computed for areas with 50 percent woods and 50 percent grass (pasture) cover.

Other combinations of conditions may be computed from the curve numbers for woods and pasture.

⁴Poor: Forest litter, small trees and brush are destroyed by heavy grazing or regular burning.

Fair: Woods are grazed but not burned, and some forest litter covers the soil.

Good: Woods are protected from grazing, and litter and brush adequately cover the soil.

Source: TR-55 [3]

Table 4-4: Curve Numbers for Fully Developed Conditions

Zone	Curve Numbers for Hydrologic Soil Group			
	A	B	C	D
R-1/R-1A Single family	61	75	83	87
R-2/R-2A Single and two family	77	85	90	92
R-3/R-3L Multi family high density	77	89	92	94
R-3/R-3H Multi family low density	77	85	90	92
B-1/B-1A Convent & mobile homes	61	75	83	87
TH/TH-A Townhouse	77	89	92	92
ZH/ZH-A Zero lot line homes	68	79	87	90
C-1/C1A Neighborhood business	83	89	92	93
C-2/C-1B General Business	77	86	93	94
C-3 Commercial	89	92	94	95
C-4/C-4A Resort Commercial/PUD (must use composite values)	-	-	-	-
M-1/M1A Light industry	68	79	87	90
M-2/M-2A Heavy industry	89	92	94	95

Source: *TR-55* [3]

Curve numbers can be reduced by either using a climatic adjustment as described in the *Texas Department of Transportation (TxDOT) Hydraulic Design Manual (HDM)* [4] or calibrating to historical storms. If curve numbers are calibrated from historical storms, the Engineer must provide documented data for rainfall, stream flow data, or detention pond stage storage data used to determine the historical curve numbers.

Time of concentration shall be computed using the same techniques as for the Rational Method. The lag time, defined as the time between the center of mass of excess rainfall to the runoff peak, is typically used in the Hydrologic Modeling System (HEC-HMS) implementation of the SCS methodology. The lag time can be estimated with Equation 4-9.

Equation 4-9

$$T_{lag} = 0.6T_c$$

The SCS/NRCS Unit Hydrograph shall be analyzed using 24-hour rainfall depths provided in Table 3-2. The 24-hour rainfall depths are to be distributed temporally with the NRCS Type III rainfall distribution.

4.4 Hydrologic Computer Programs

The preferred hydrologic model for the City is HEC-HMS. The use of other computer modeling software is discussed in **Section 1.3**. When using any model, use the procedures outlined in the respective user's manual. Data generated with the model and the results of the program shall be summarized on the drainage plans.

5 Street Flow

5.1 General Requirements

- A. All roadways and/or paved alleys must contain the 100-year flow within the right-of-way. Runoff shall not enter private property from a street except in recorded drainage easements or rights-of-way, or in historic watercourses where easements or rights-of-way have not yet been obtained.
- B. 100-year design storm depth of water shall not exceed 10 inches at any point within the street right-of-way and the product of maximum depth (feet) times average cross-section velocity (feet per second) at any point shall not exceed 6.0.
- C. Rundowns, roadway slope, shall be designed to convey and contain drainage carried by the roadway to ensure the 100-year event is contained within the right-of-way. If a storm drain system is present, rundowns shall be designed for the difference between the storm drain capacity and the 100-year runoff, with a 25-year minimum design assuming all of the flow bypasses the storm drain system.
- D. Driveways should be constructed to allow the 25-year design storm runoff to pass under the driveway in a culvert (18 inches minimum or equivalent) or over the driveway on a concrete apron. Concrete aprons or box culverts are preferred in areas of heavy sediment transport.
- E. The side slope of a ditch or swale on the side adjacent to City roads shall be no steeper than 4:1. Roadways under TxDOT jurisdiction shall be designed in accordance with TxDOT requirements (6:1).
- F. Water Spread Limits for Roadways is as indicated in Table 5-1. No lowering of the standard height of street crown shall be allowed for the purposes of obtaining additional hydraulic capacity. Where additional hydraulic capacity is required, the proposed street gradient must be increased or curb inlets and storm sewers installed to remove a portion of the flow.

Table 5-1: Water Spread Limits for Roadways

Street Classification	10-Yr Permissible Water Spread
Arterial Streets and Parkways	One 11-foot traffic lane must remain open in each direction.
Collector Streets	Clear width of 11 feet must remain open.
< Collector Streets	Water flow must not exceed the top of either curb.

5.2 Positive Overflow

The approved drainage system shall provide for positive overflow at all low points. The term “positive overflow” means that, when the inlets do not function properly or when the design capacity of the conduit or roadway ditch is exceeded, the excess flow can be conveyed overland along an open course. Normally, this would mean along a street or alley, but it can be constructed on private property within the dedication of a drainage easement.


5.3 Street Flow Calculations

Evaluation of street flow is based upon open channel hydraulics theory, with the Manning’s Equation modified to allow direct solution, based on the street cross section. Refer to *Hydraulic Engineering*

Circular 22: Urban Drainage Design Manual (HEC 22) [5]. All proposed projects must meet the ponding criteria defined in this manual.

The following information was summarized from *HEC 22* for street flow calculations. The distance of the spread, T , is measured perpendicular to the curb face to the extent of the water on the roadway and is shown in Figure 5-1.

Figure 5-1: Typical Gutter Sections

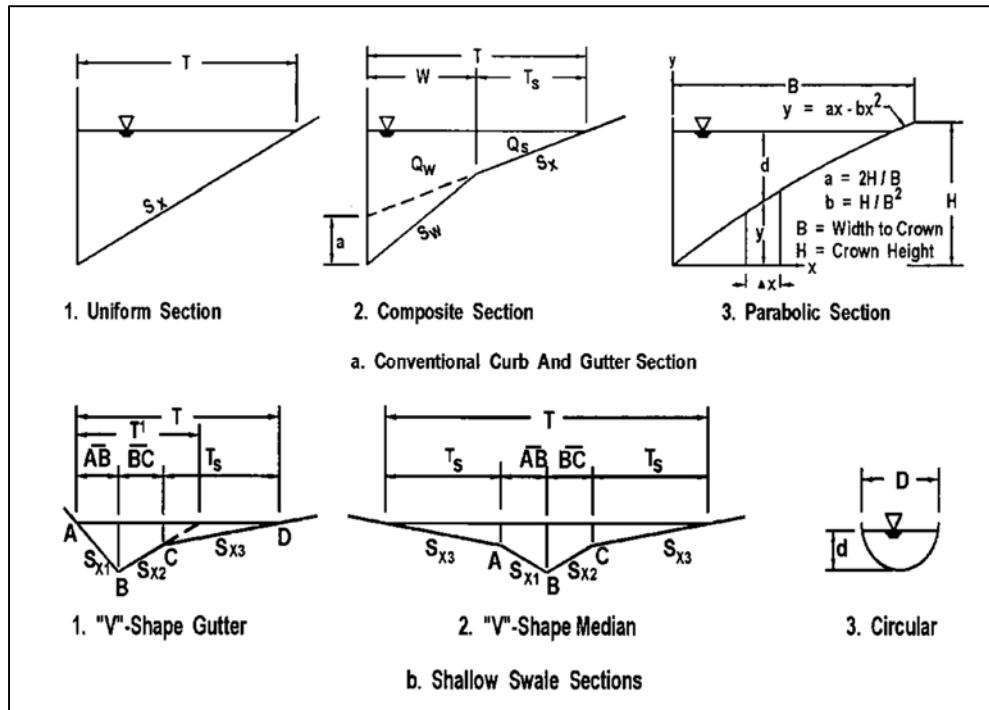

Source: *HEC 22* [5]

Capacity Relationship

Gutter flow calculations are necessary to establish the spread of water on the shoulder, parking lane, or pavement section. A modification of the Manning's Equation can be used for computing flow in triangular channels. The modification is necessary because the hydraulic radius in the equation does not adequately describe the gutter cross section, particularly where the top width of the water surface may be more than 40 times the depth at the curb. To compute gutter flow, the Manning's Equation is integrated for an increment of width across the section [6]. The resulting equation is:

Equation 5-1

$$Q = \left(\frac{K_u}{n} \right) S_x^{1.67} S_L^{0.5} T^{2.67}$$

Or in terms of T :

Equation 5-2

$$T = \left[\frac{Qn}{K_u S_x^{1.67} S_L^{0.5}} \right] T^{0.375}$$

Where:

$K_u = 0.56$ in English units

n = Manning's coefficient (Table 5-2)

Q = Flow rate (cfs)

T = Width of flow (spread) (ft)

S_x = Cross slope (ft/ft)

S_L = Longitudinal slope (ft/ft).

Equation 5-1 neglects the resistance of the curb face since this resistance is negligible.

Spread on the pavement and flow depth at the curb are often used as criteria for spacing pavement drainage inlets. Figure 5-2 is a nomograph for solving Equation 5-1 and should be used as reference only, Figure 5-2 is not intended to replace equation 5-1. The chart can be used for either criterion with the relationship:

Equation 5-3

$$d = TS_x$$


Where:

d = Depth of flow (ft)

T = Width of flow (ft)

S_x = Cross slope (ft/ft).

Figure 5-2: Chart 1B – Flow in Triangular Gutter Sections

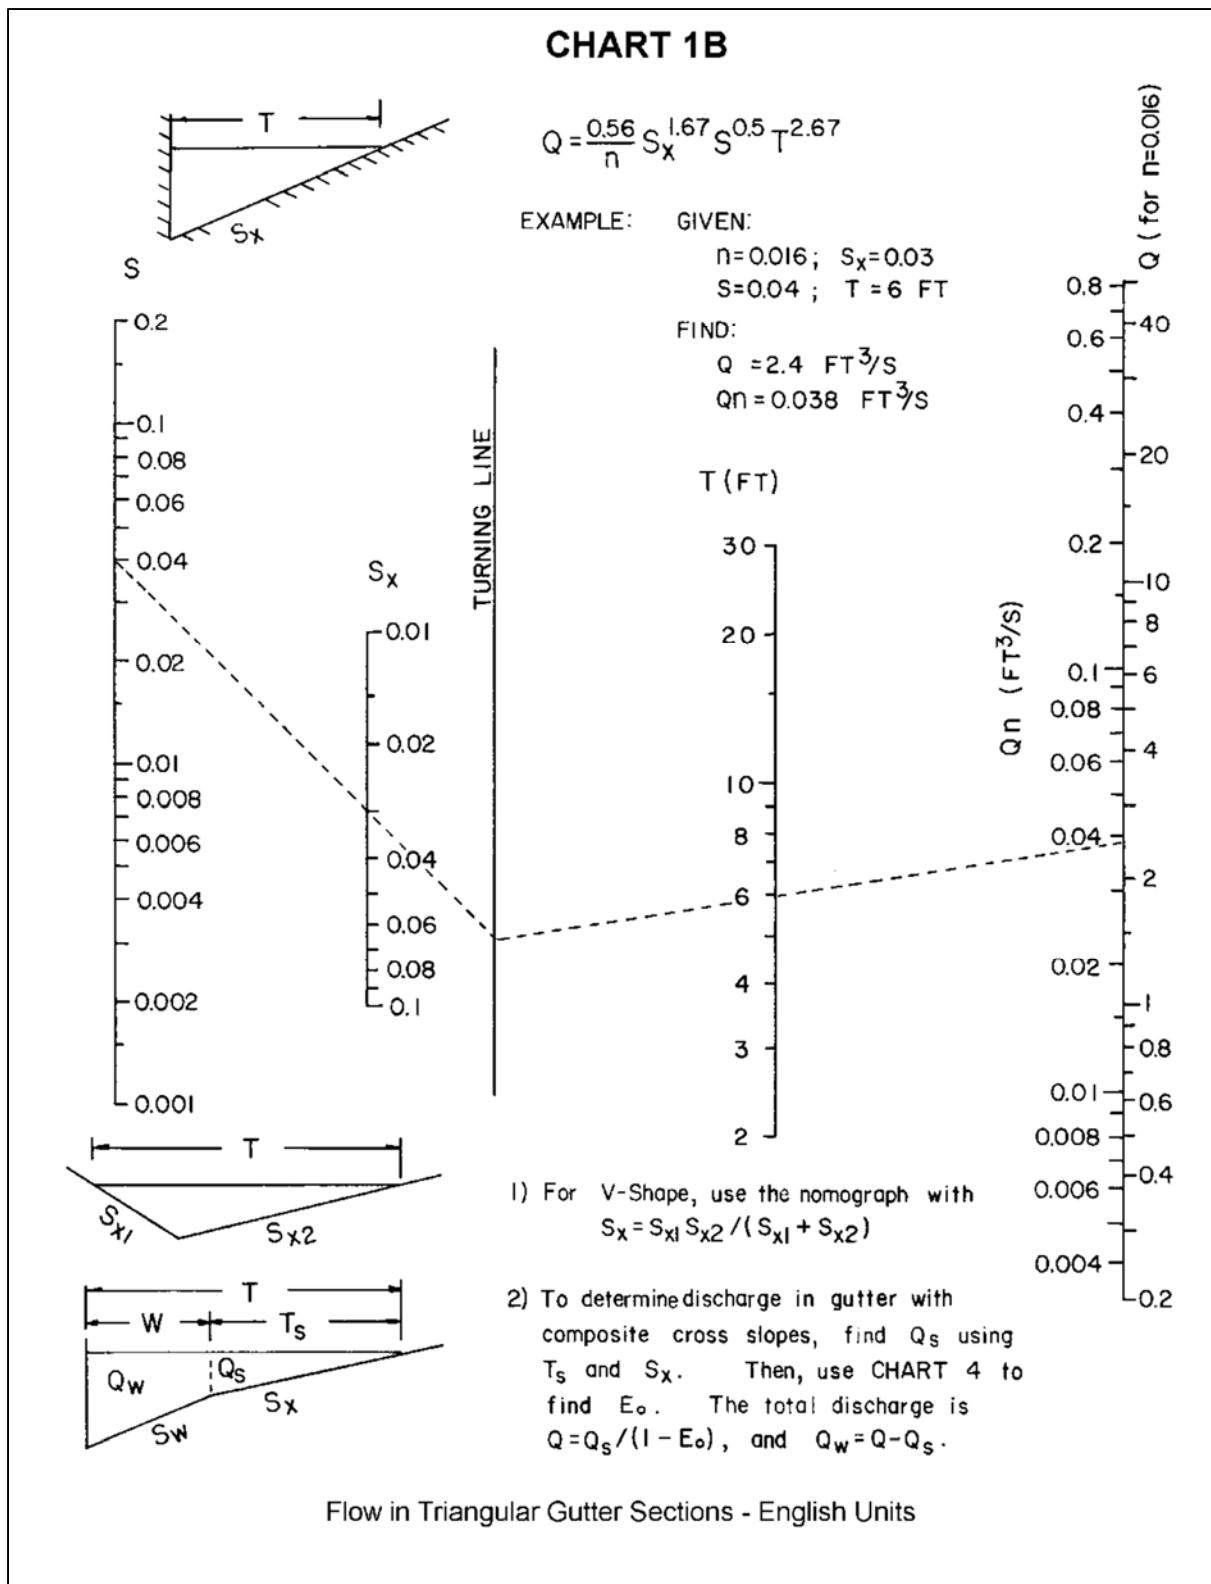

Source: HEC 22 [5]

Table 5-2: Manning's n for Street and Pavement Gutters

Type of Gutter or Pavement	Manning's n
Concrete gutter, troweled finish	0.012
Asphalt Pavement:	
Smooth texture	0.013
Rough texture	0.016
Concrete gutter-asphalt pavement:	
Smooth	0.013
Rough	0.015
Concrete pavement:	
Float finish	0.014
Broom finish	0.016
For gutters with small slope, where sediment may accumulate, increase above values of "n" by.....	0.002
Source: <i>Design Charts for Open-Channel Flow (HDS 3)</i> [7]	

5.3.1 Shallow Swale Sections

Where curbs are not needed for traffic control, a small swale section of circular or V-shape may be used to convey runoff from the pavement. As an example, the control of pavement runoff on fills may be needed to protect the embankment from erosion. Small swale sections may have sufficient capacity to convey the flow to a location suitable for interception.

In lieu of using an irregular open channel cross-section to compute flow in small swale, Figure 5-2 can be used to compute the flow in a shallow V-shaped section. When using Chart 1B for V-shaped channels, the cross slope, S_x is determined by the following equation:

Equation 5-4

$$S_x = \frac{(S_{x1}S_{x2})}{(S_{x1} + S_{x2})}$$

5.4 Alley Flow Limitations

Alley capacities shall be checked at all alley turns and "T" intersections to determine if curbing is needed or grades should be flattened. Curbing shall be required for at least 10 feet on either side of an inlet in an alley and on the other side of the alley so that the top of the inlet is even with the high edge of the alley pavement. Alleys adjacent to drainage channel shall be required to have curbs for the full length of the channel.

5.5 Alley Flow Calculations

Flow in alleys is also based upon open channel hydraulic theory, with the Manning equation modified to allow direct solution, with regard to the alley cross section.

This page intentionally left blank.


6 Inlet Design

6.1 General Requirements

Inlets shall be located as necessary to remove the flow based on the 25-year storm and accommodate ponding widths in streets as defined in Table 5-1. The hydraulic efficiency of storm drain inlets varies with the amount of gutter flow, street grade, street crown and the geometry of the inlet opening. The following are design considerations, which must be given attention during inlet design:


1. Inlets must be located where the allowable street flow capacities are exceeded, at low points (sumps or sags) and upstream of transition between normal and super-elevated street sections. Inlets should be located to intercept stormwater prior to traversing intersections.
2. In super-elevated sections of divided arterial streets, inlets placed against the center medians shall have no gutter depression. Interior gutter flow (flow along the median) shall be intercepted at the point of super-elevation transition, to prevent pavement cross flow.
3. At bridges with curbed approaches, gutter flow shall be intercepted prior to flowing onto the bridge, to prevent ice from developing during cold weather.
4. The maximum approved inlet throat opening is seven inches. Openings larger than seven inches require approval by the Engineering Division and, if approved, must contain a bar or other form of restraint. For curb opening inlets the throat opening is shown as "h" in Figure 6-1.
5. The design and location of all inlets must take into consideration pedestrian and bicycle traffic. Combination curb inlets (with opening in curb and grate opening in gutter) may be used only where space behind the curb prohibits the use of other inlet types.
6. Where recessed inlets are required, they shall not decrease the width of the sidewalk or interfere with utilities. Recessed inlets must also be depressed. The depression is measured from the theoretical gutter flow line, shown as "a" in Figure 6-2, and shall be one inch minimum.
7. Non-recessed, depressed inlets shall have a maximum allowable inlet depression of five inches.
8. The use of slotted drains is not allowed except in instances where there is no alternative, in which case approval must be obtained from the City Engineer. If slotted drains are used, the inlet capacity shall be the lesser of the calculated capacity from this manual or the manufacturer's design guidelines and cleanouts shall be provided.

Figure 6-1: Curb Opening Inlet Examples

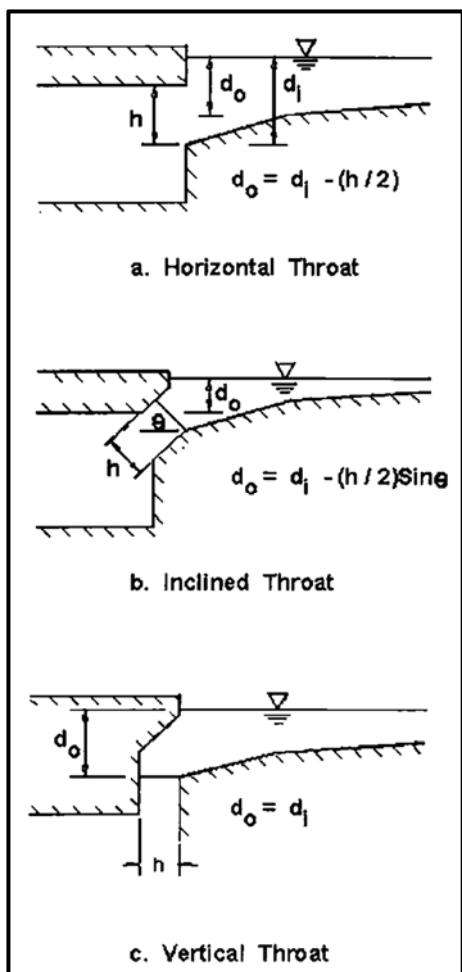

Source: HEC 22 [5]

Figure 6-2: Depressed Curb Opening Inlet

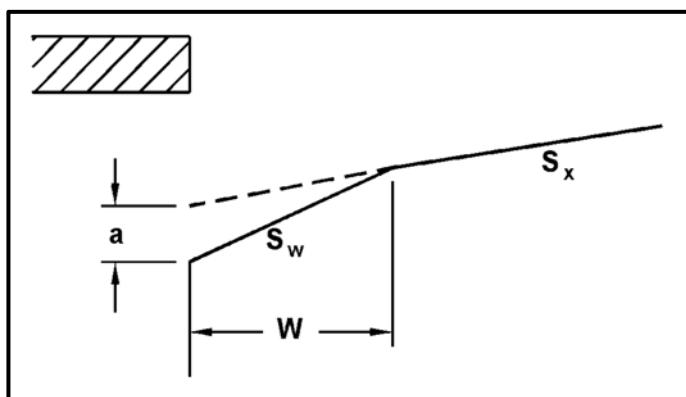


Source: HEC 22 [5]

6.2 Inlet Types and Descriptions

Stormwater inlets are used to remove surface runoff and convey it to a storm drainage system. For the purposes of this manual, inlets are divided into four classes listed below and shown in Figure 6-3.

1. Grate Inlets
2. Curb Opening Inlets
3. Combination Inlet
4. Slotted Drain Inlets

Figure 6-3: Inlet Types

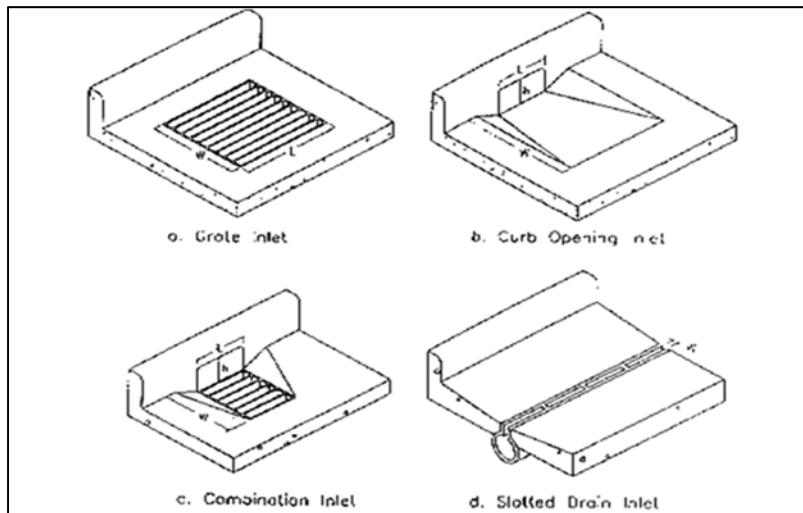

Source: *TxDOT HDM* [4]

6.2.1 Grate Inlets

Although grate inlets may be designed to operate satisfactorily in a range of conditions, they may become clogged by floating debris during storm events. In addition, they can produce a hazard to wheelchair and bicycle traffic and must be designed to be safe for both. For these reasons, they may be used only at locations where space restriction prohibit the use of other types of inlets and shall be designed to be twice as large as the theoretical required area to compensate for clogging.

6.2.2 Curb Opening Inlets

Curb opening inlets are the most effective type of inlet on slopes flatter than 3%, in sag locations, and with flows which typically carry large amounts of debris. Similar to grate inlets, curb opening inlets also tend to lose capacity as street grades increase, but to a lesser degree than grate inlets.

6.2.3 Combination Inlets

A combination inlet consists of both the grate inlet and the curb opening inlet. This configuration provides many of the advantages of both inlet types. The combination inlet also reduces the chance of clogging by debris with flow into the curb portion of the inlet. If a curb opening is extended on the upstream side of the combination inlet it will act as a "Sweeper", and remove debris before it reaches the grate portion of the inlet.

6.2.4 Slotted Drain Inlets

Although slotted drain inlets can be used to intercept sheet flow, or flow in wide sections, they are not recommended for use in the City of New Braunfels since they are very susceptible to clogging from debris. Slot inlets may only be used with the permission of the City Engineer.

6.3 Inlet Capacity Calculations

The inlet capacity calculations provided below are summarized from *TxDOT HDM*. For additional information refer to the source document.

6.3.1 Combination Inlets

For a combination curb opening and grate inlet, assume that the capacity of the combination inlet comprises the sum of the capacity of the grate and the upstream curb opening length. Ignore the capacity of the curb opening that is combined with the grate opening. Refer to *HEC 22* for additional procedures and examples for computing the interception capacity of combination inlets.

6.3.2 Curb Opening Inlets On-Grade

The design of on-grade curb opening inlets involves determination of length required for total flow interception, subjective decision about actual length to be provided, and determination of any resulting carryover rate. For each on-grade inlet, determine early whether or not carryover is to be a valid design consideration. In some cases due to a logical location of the inlet, no carryover may be allowed. In other cases, while carryover is acceptable, there may not be a convenient location to accommodate the bypass flow. Use the following procedure to design curb inlets on-grade:

1. Compute depth of flow and ponded width (T) in the gutter section at the inlet.
2. Determine the ratio of the width of flow in the depressed section (W) to the width of total gutter flow (T) using Equation 6-1. Figure 6-4 shows the gutter cross section at an inlet.

Equation 6-1

$$E_0 = \frac{K_w}{K_w + K_0}$$


Where:

E_0 = ratio of depression flow to total flow

K_w = conveyance of the depressed gutter section (cfs)

K_0 = conveyance of the gutter section beyond the depression (cfs).

Figure 6-4: Gutter Cross-Section Diagram

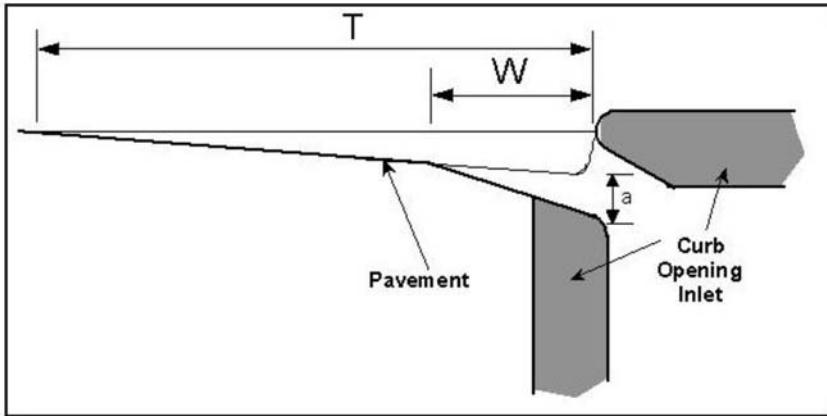

Source: *TxDOT HDM* [4]

3. Use Equation 6-2 to calculate conveyance, K_w and K_0 .

Equation 6-2

$$K = \frac{zA^{5/3}}{nP^{2/3}}$$

Where:

K = conveyance of cross section (cfs)

z = 1.486 for English measurements

A = area of cross section (ft^2)

n = Manning's roughness coefficient

P = wetted perimeter (ft).

4. Use Equation 6-3 to calculate the area of cross section in the depressed gutter section.

Equation 6-3

$$A_w = WS_x \left(T - \frac{W}{2} \right) + \frac{1}{2} aW$$

Where:

A_w = area of depressed gutter section (ft^2)

W = depression width for an on-grade curb inlet (ft)

S_x = cross slope (ft/ft)

T = calculated ponded width (ft)

a = curb opening depression depth (ft).

5. Use Equation 6-4 to calculate the wetted perimeter in the depressed gutter section.

Equation 6-4

$$P_W = \sqrt{[(WS_x + a)^2 + W^2]}$$

Where:

P_W = wetted perimeter of depressed gutter section (ft)

W = depression width for an on-grade curb inlet (ft)

S_x = cross slope (ft/ft)

a = curb opening depression depth (ft).

6. Use

7. Equation 6-5 to calculate the area of cross section of the gutter section beyond the depression.

Equation 6-5

$$A_0 = \frac{S_x}{2} (T - W)^2$$

Where:

A_0 = area of gutter/road section beyond the depression width (ft^2)

S_x = cross slope (ft/ft)

W = depression width for an on-grade curb inlet (ft)

T = calculated ponded width (ft).

8. Use Equation 6-6 to calculate the wetted perimeter of the gutter section beyond depression.

Equation 6-6

$$P_0 = T - W$$

Where:

P_0 = wetted perimeter of the depressed gutter section (ft)

T = calculated ponded width (ft)

W = depression width for an on-grade curb inlet (ft).

9. Use Equation 6-7 to determine the equivalent cross slope (S_e) for a depressed curb opening inlet.

Equation 6-7

$$S_e = S_x + \frac{a}{W} E_0$$

Where:

S_e = equivalent cross slope (ft/ft)

S_x = cross slope of the road (ft/ft)

a = gutter depression depth (ft)

W = gutter depression width (ft)

E_0 = ratio of depression flow to total flow.

10. Use Equation 6-8 to calculate the length of curb inlet required for total interception.

Equation 6-8

$$L_r = zQ^{0.42}S^{0.3} \left(\frac{1}{nS_e} \right)^{0.6}$$

Where:

L_r = length of curb inlet required (ft)

z = 0.6 for English measurement

Q = flow rate in gutter (cfs)

S = longitudinal slope (ft/ft)

n = Manning's roughness coefficient

S_e = equivalent cross slope (ft/ft).

If no carryover is allowed, the inlet length is assigned a nominal dimension of at least L_r . Use a nominal length available in standards for curb opening inlets. Do not use the exact value of L_r if doing so requires special details, special drawings and structural design, and costly and unfamiliar construction. If carryover is considered, round the curb opening inlet length down to the next available (nominal) standard curb opening length and compute the carryover flow.

6.3.2.1 Determine Carryover Flow

In carryover computations, efficiency of flow interception varies with the ratio of actual length of curb opening inlet supplied (L_a) to length L_r and with the depression to depth of flow ratio. Use Equation 6-9 for determining carryover flow.

Equation 6-9

$$Q_{co} = Q \left(1 - \frac{L_a}{L_r} \right)^{1.8}$$

Where:

Q_{co} = carryover discharge (cfs)

Q = total discharge (cfs)

L_a = design length of the curb opening inlet (ft)

L_r = length of curb opening inlet required to intercept the total flow (ft).

Carryover rates usually should not exceed about 0.5 cfs or about 30% of the original discharge. Greater rates can be troublesome and cause a significant departure from the principles of the Rational Method application. In all cases, you must accommodate any carryover rate at some other specified point in the storm drain system.

6.3.2.2 Calculate Intercepted Flow

Calculate the intercepted flow as the original discharge in the approach curb and gutter minus the amount of carryover flow.

6.3.3 Curb Inlets in Sag Configuration

The capacity of a curb inlet in a sag depends on the water depth at the curb opening and the height of the curb opening. The inlet operates as a weir to depths equal to the curb opening height and as an orifice at depths greater than 1.4 times the opening height. At depths between 1.0 and 1.4 times the opening height, flow is in a transition stage and the capacity should be based on the lesser of the computed weir and orifice capacity. Generally, this ratio should be less than 1.4 such that the inlet operates as a weir.

If the depth of flow in the gutter (d) is less than or equal to 1.4 times the inlet opening height (h), ($d \leq 1.4H$), determine the length of inlet required considering weir control. Otherwise, skip this step. Calculate the capacity of the inlet when operating under weir conditions with Equation 6-10.

Equation 6-10

$$L = \frac{Q}{C_w d^{1.5}} - 1.8W$$

Where:

Q = total flow reaching inlet (cfs)

C_w = weir coefficient ($\text{ft}^{\frac{0.5}{s}}$)

Suggested value = $2.3 \text{ ft.}^{\frac{0.5}{s}}$ for depressed inlets.

Suggested value = $3.0 \text{ ft.}^{\frac{0.5}{s}}$ without depression.

d = head at inlet opening (ft), computed with Equation 10-1.

L = length of curb inlet opening (ft)

W = gutter depression width (perpendicular to curb)

If $L > 12$ ft, then $W = 0$ and $C_w = 3.0 \text{ ft.}^{\frac{0.5}{s}}$

If the depth of flow in the gutter is greater than the inlet opening height ($d > h$), determine the length of inlet required considering orifice control. The equation for interception capacity of a curb opening operating as an orifice follows:

Equation 6-11

$$Q = C_o h L \sqrt{2 g d_o}$$

Where:

Q = total flow reaching inlet (cfs)

C_o = orifice coefficient = 0.67 h = depth of opening (ft) (this depth will vary slightly with the inlet detail used)

L = length of curb opening inlet (ft)

g = acceleration due to gravity = 32.2 ft/s²

d_o = effective head at the centroid of the orifice (ft).

For curb inlets with an inclined throat such as Type C inlet, the effective head, d_o , is at the centroid of the orifice.

This changes Equation 6-11 to:

Equation 6-12

$$Q = C_o h L \sqrt{2g(y + a - \frac{h}{2} \sin \theta)}$$

Where:

Q = total flow reaching inlet (cfs)

C_o = orifice coefficient = 0.67

h = depth of opening (ft) (this depth will vary slightly with the inlet detail used)

L = Length of curb opening inlet (ft)

g = acceleration due to gravity = 32.2 ft/s²

y = depth of water in the curb and gutter cross section (ft)

a = gutter depression depth (ft).

Rearranging Equation 6-12 allows a direct solution for required length.

Equation 6-13

$$L = \frac{Q}{C_o h \sqrt{2g(y + a - \frac{h}{2} \sin \theta)}}$$

If both steps 1 and 2 were performed (i.e., $h < d < 1.4h$), choose the larger of the two computed lengths as being the required length. Select a standard inlet length that is greater than the required length.

6.3.4 Slotted Drain Inlet Design

Use the following procedure for on-grade slotted drain inlets:

1. Determine the length of slotted drain inlet required for interception of all of the water in the curb and gutter calculated by Equation 6-14.

Equation 6-14

$$L_r = \frac{zQ_a^{0.442} S^E S_x^{-0.849}}{n^{0.384}}$$

Where:

L_r = length of slotted drain inlet required for total interception of flow (ft)

z = 0.706 for English measurement

Q_a = total discharge (cfs)

S = gutter longitudinal slope (ft/ft)

E = function of S and S_x as determined by Equation

S_x = transverse slope (ft/ft)

n = Manning's roughness coefficient.

Equation 6-14 is limited to the following ranges of variables: total discharge ≤ 5.5 cfs longitudinal gutter slope ≤ 0.09 ft/ft roughness coefficient (n) in the curb and gutter: $0.011 \leq n \leq 0.017$.

Equation 6-15

$$E = 0.207 - 19.084S^2 + 2.613S - 0.0001S_x^{-2} + 0.007S_x^{-1} - 0.049SS_x^{-1}$$

The longitudinal slope exponent (E) is determined with Equation 6-14: Because the equations are empirical, extrapolation is not recommended.

2. Select the desired design slotted drain length (L_a) based on standard inlet sizes. If $L_a < L_r$ the interception capacity may be estimated using Figure 6-5, multiplying the resulting discharge ratios by the total discharge. Alternatively, the carryover for a slotted drain inlet length may be directly computed using Equation 6-16.

Equation 6-16

$$Q_{co} = 0.918 Q \left(1 - \frac{L_a}{L_r}\right)^{1.769}$$

Where:


Q_{co} = carryover discharge (cfs)

Q = total discharge (cfs)

L_a = design length of slotted drain inlet (ft)

L_r = length of slotted drain inlet required to intercept the total flow (ft).

Figure 6-5: Slotted Drain Inlet Interception Rate

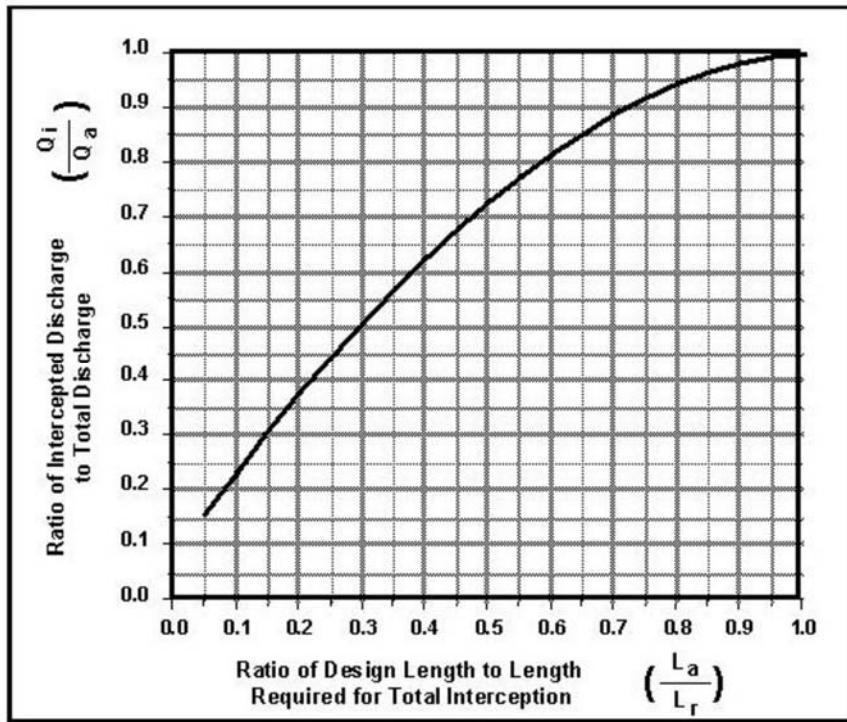

Source: *TxDOT HDM* [4]

As a rule of thumb, you can optimize slotted drain inlets' economy by providing actual lengths (L_a) to required lengths (L_r) in an approximate ratio of about 0.65. This implies a usual design with carryover for on-grade slotted drain inlets.

6.3.5 Grate Inlets On-Grade

The capacity of a grate inlet on-grade depends on its geometry and cross slope, longitudinal slope, total gutter flow, depth of flow, and pavement roughness. The depth of water next to the curb is the major factor affecting the interception capacity of grate inlets. At low velocities, all of the water flowing in the section of gutter occupied by the grate, called frontal flow, is intercepted by grate inlets, and a small portion of the flow along the length of the grate, termed side flow, is intercepted. On steep slopes, only a portion of the frontal flow will be intercepted if the velocity is high or the grate is short and splash-over occurs. For grates less than 2 feet long, intercepted flow is small. Agencies and manufacturers of grates have investigated inlet interception capacity. For inlet efficiency data for various sizes and shapes of grates, refer to *Hydraulic Engineering Circular 12: Drainage of Highway Pavements (HEC 12)* [8].

Grate inlets shall be designed to be twice as large as the theoretical required area.

6.3.5.1 Bicycle Safety

A parallel bar grate is the most efficient type of gutter inlet; however, when crossbars are added for bicycle safety, the efficiency is reduced. Where bicycle traffic is a design consideration, the curved vane grate and the tilt bar grate are recommended for both their hydraulic capacity and bicycle safety.

features. In certain locations where leaves may create constant maintenance problems, the parallel bar grate may be used more efficiently if bicycle traffic is prohibited.

6.3.5.2 Design Procedure

Use the following procedure for grate inlets on-grade:

1. Compute the ponded width of flow (T).
2. Choose a grate type and size.
3. Find the ratio of frontal flow to total gutter flow (E_o) for a straight cross-slope using Equation 6-1. No depression is applied to a grate on-grade inlet.
4. Find the ratio of frontal flow intercepted to total frontal flow, R_f , using Equation 6-17, Equation 6-18, and Equation 6-19.

Equation 6-17

$$R_f = 1 - 0.3(v - v_o) \text{ , if } v > v_o$$

Equation 6-18

$$R_f = 1.0 \text{ , if } v > v_o$$

Where:

R_f = ratio of frontal flow intercepted to total frontal

v = approach velocity of flow in gutter (ft/s)

v_o = minimum velocity that will cause splash over grate (ft/s).

For triangular sections, calculate the approach velocity of flow in gutter (v) using Equation 6-19.

Equation 6-19

$$v = \frac{2Q}{Ty} = \frac{2Q}{T^2 S_x}$$

Otherwise, compute the section area of flow (A) and calculate the velocity using Equation 6-20.

Equation 6-20

$$v = \frac{Q}{A}$$

Calculate the minimum velocity (v_o) that will cause splash over the grate using the appropriate equation in Table 6-1.

Where:

v_o = splash-over velocity (ft/s)

L = length of grate (ft).

Table 6-1: Splash-Over Velocity Calculation Equations

Grate Configuration	Typical Bar Spacing (in.)	Splash-over Velocity Equation
Parallel Bars	2	$v_o = 2.218 + 4.031L - 0.649L^2 + 0.056L^3$
Parallel Bars	1.2	$v_o = 1.762 + 3.117L - 0.451L^2 + 0.033L^3$
Transverse Curved Vane	4.5	$v_o = 1.381 + 2.78L - 0.300L^2 + 0.020L^3$
Transverse 45° Tilted Vane	4	$v_o = 0.988 + 2.625L - 0.359L^2 + 0.029L^3$
Parallel bars w/ transverse rods	2 parallel / 4 trans	$v_o = 0.735 + 2.437L - 0.265L^2 + 0.018L^3$
Transverse 30° Tilted Vane	4	$v_o = 0.505 + 2.344L - 0.200L^2 + 0.014L^3$
Reticuline	n/a	$v_o = 0.030 + 2.278L - 0.179L^2 + 0.010L^3$

Source: *TxDOT HDM* [4]

5. Find the ratio of side flow intercepted to total side flow, R_s .

Equation 6-21

$$R_s = \left[1 + \frac{zv^{1.8}}{S_x L^{2.3}} \right]^{-1}$$

Where:

R_s = ratio of side flow intercepted to total flow

$z = 0.15$ for English measurement

S_x = transverse slope

v = approach velocity of flow in gutter (ft/s)

L = length of grate (ft).

6. Determine the efficiency of grate, E_f . Use Equation 6-22.

Equation 6-22

$$E_f = [R_f E_o + R_s(1 - E_o)]$$

7. Calculate the interception capacity of the grate, Q_i . Use Equation 6-23. If the interception capacity is greater than the design discharge, skip step 8.

Equation 6-23

$$Q_i = E_f Q = Q[R_f E_o + R_s(1 - E_o)]$$

8. Determine the carryover, CO. Use Equation 6-24.

Equation 6-24

$$CO = Q - Q_i$$

9. Depending on the carryover, select a larger or smaller inlet as needed. If the carryover is excessive, select a larger configuration of inlet and return to step 3. If the interception capacity far exceeds the design discharge, consider using a smaller inlet and return to step 3.

6.3.6 Design Procedure for Grate Inlets in Sag Configurations

A grate inlet in sag configuration operates in weir flow at low ponding depths. A transition to orifice flow begins as the ponded depth increases. Use the following procedure for calculating the inlet capacity:

1. Choose a grate of standard dimensions to use as a basis for calculations.
2. Determine an allowable head (h) for the inlet location. This should be the lower of the curb height and the depth associated with the allowable ponded width. No gutter depression is applied at grate inlets.
3. Determine the capacity of a grate inlet operating as a weir. Under weir conditions, the grate perimeter controls the capacity. Figure 6-6 shows the perimeter length for a grate inlet located next to and away from a curb. The capacity of a grate inlet operating as a weir is determined using Equation 6-25.

Equation 6-25

$$Q_w = C_w P^{1.5}$$

Where:


Q_w = weir capacity of grate (cfs)

C_w = weir coefficient = 3 for English measurement

P = perimeter of the grate (ft) as shown in Figure 6-6: A multiplier of 0.5 is required to be applied to the measured perimeter as a safety factor.

h = allowable head on grate (ft).

Figure 6-6: Perimeter Length for Grate Inlet in Sag Configuration

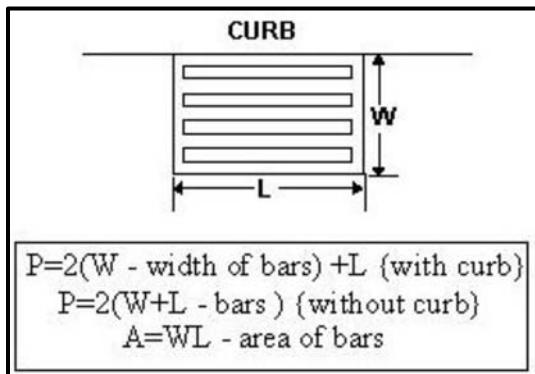

Source: *TxDOT HDM* [4]

4. Determine the capacity of a grate inlet operating under orifice flow. Under orifice conditions, the grate area controls the capacity. The capacity of a grate inlet operating under orifice flow is computed with Equation 6-26.

Equation 6-26

$$Q_o = C_o A \sqrt{2 g h}$$

Where:

Q_o = orifice capacity of grate (cfs)

C_o = orifice flow coefficient = 0.67


A = clear opening area (ft^2) of the grate (the total area available for flow). A multiplier of 0.5 is required to be applied to the measured area as a safety factor

g = acceleration due to gravity = 32.2 ft/s^2

h = allowable head on grate (ft).

5. Compare the calculated capacities from steps 3 and 4 and choose the lower value as the design capacity. The design capacity of a grated inlet in a sag is based on the minimum flow calculated from weir and orifice conditions. Figure 6-7 demonstrates the relationship between weir and orifice flow. If Q_o is greater than Q_w (to the left of the intersection in Figure 6-7), then the designer would use the capacity calculated with the weir equation. If, however, Q_o is less than Q_w (to the right of the intersection), then the capacity as determined with the orifice equation would be used.

Figure 6-7: Relationship between Head and Capacity for Weir and Orifice Flow

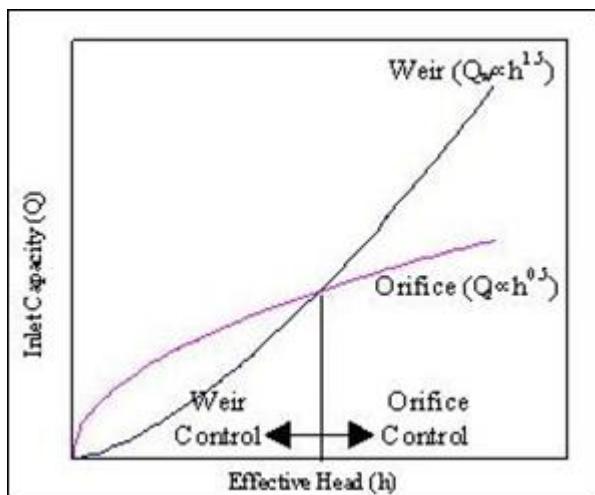

Source: *TxDOT HDM* [4]

This page intentionally left blank.

7 Storm Drain Systems

7.1 General Requirements

- A. Storm drain systems shall be designed for the 25-year design storm with the design hydraulic grade line (HGL) of the system located a minimum of 2 feet below the theoretical gutter flow line of inlets.
- B. Storm drain pipe shall be reinforced concrete pipe (AASHTO M170 Class III). Corrugated metal pipe or plastic pipe shall not be permitted for storm drain systems in the public right-of-way.
- C. Concrete pipe collars or manufactured transition pieces must be used at all pipe size changes on trunk lines. For all pipe junctions other than manholes and junction boxes, manufactured wye connections should be used, and the angle of intersection shall not be greater than 45 degrees. This includes discharges into box culverts and channels. Laterals shall be connected to trunk lines using manholes or manufactured wye connections. Inlet laterals will connect only one inlet to the trunk line. Vertical curves in the conduit will not be permitted, and horizontal curves must meet manufacturer's requirements for offsetting of the joints.
- D. The maximum manhole and junction box spacing for storm drain systems are shown in Table 7-1. Manholes or junction boxes shall also be placed at: pick up points having three or more laterals; trunk line size changes for pipes with diameter differences greater than 24 inches; vertical alignment changes; and, future collection points. The requirement for manholes may be waived if the pipe size allows direct access into the pipe by maintenance personnel and equipment.
- E. The cover over the crown of circular pipe should be at least three feet and should be based on the type of pipe used, the expected loads and the supporting strength of the pipe. Box sections should normally have a minimum of one foot of cover; however, box sections may be designed for direct traffic in special situations with approval.
- F. Grates for drop inlets should be designed to facilitate removal for maintenance, but minimize vandalism. Design shall consider traffic loading, bicycle and pedestrian safety, and a means to secure grate.
- G. The minimum lateral and trunk line pipe shall be 24 inches.
- H. At no time shall bypass flow exceed the water spread limits for roadways as defined by Table 5-1. Inlets shall be located to prevent water convergence and/or excessive flows through intersections.
- I. For arterial or collector streets with super-elevated sections, no more than 3 cubic feet per second of the 25-year flow will be allowed to cross flow from the higher elevation to the lower elevation.
- J. All storm sewer conduits to be dedicated to the City of New Braunfels, and outside of the right-of-way, shall be located in drainage easements dedicated to the City of New Braunfels at the time of final platting of the property. Storm sewer easements shall be at least 15 feet wide. Wider easements may be required to accommodate larger storm drain systems.

Table 7-1: Maximum Spacing of Manholes and Junction Boxes

Pipe Diameter (in)	Max. Spacing (ft)
24	400
27-39	800
42-60	1,000
Larger than 60	1,200

7.2 Design Criteria

- A. Storm drain systems shall be designed for the 25-year design storm and evaluated for the 100-year design storm. Systems shall be designed with Manning's Equation and step backwater methodology outlined in the *TxDOT HDM* and summarized in this section. The minimum coefficient of roughness for concrete storm drain pipe is 0.013.
- B. The minimum velocity in a conduit shall be 2.5 feet per second for the 25-year design storm. This minimum velocity is required to minimize or prevent the accumulation of sediment in the system. Such sediment accumulation can severely reduce the ability of the system to convey the design flow.
- C. Maximum velocities in conduits are important because of the possibility of excessive erosion of the storm drainpipe material. Table 7-2 lists the maximum velocities allowed. Maximum flow velocities at the downstream end of pipe systems shall be consistent with the maximum allowable velocities for the receiving channel (refer to **Section 8**). Erosion protection is required for outfalls into natural channels.
- D. The maximum discharge velocities in the pipe shall not exceed the design velocity of the receiving channel or conduit at the outfall. The maximum outfall velocity of a conduit in partial flow shall be computed for partial depth and shall not exceed the maximum permissible velocity of the receiving channel unless controlled by an appropriate energy dissipater.
- E. When establishing the hydraulic gradient of a storm sewer, entrance and exit losses, expansion losses, manhole and bend losses, junction losses, and minor head losses at points of turbulence shall be calculated and included in the computation of the hydraulic gradient.
- F. The flow lines of storm sewer conduits that discharge into open channels shall be higher than or equal to the flow line of the channel. Storm sewer outfall pipes shall not be at sump with the receiving channel.
- G. Pipe diameters shall increase downstream. Pipe size and slope shall be designed so that the velocity of flow will increase progressively down the system or at least will not appreciably decrease at inlets, bends or other changes in geometry or configuration to prevent sedimentation.
- H. At points of change in storm drain size, pipe crowns (soffits) shall be set at the same elevation.

Table 7-2: Maximum Velocity in Storm Drains

Storm Drain Type	Maximum Velocity
Inlet Laterals (shorter than 30 feet)	No Limit
Inlet Laterals (longer than 30 feet)	15 feet per second
Trunk Lines	15 feet per second

7.3 Calculation of the Hydraulic Grade Line

The 25-year and 100-year frequency hydraulic grade line (HGL) shall be computed and plotted for all storm drain systems. The 25-year frequency hydraulic grade line shall be calculated throughout the system and shall be at least two feet below the theoretical gutter line at the entrance to the inlet. The determination of friction losses and minor losses are required for these calculations.

7.3.1 Tailwater Conditions

- A. The designer must determine the tailwater conditions at the downstream end of the proposed storm drain system when calculating the hydraulic performance of the system. When proposed storm drains are to discharge into existing watercourses, the tailwater elevation used in hydraulic calculations of the proposed storm drain system will be determined by the design engineer. The tailwater elevation shall be the greater of the water surface of the receiving stream and the minimum outlet water surface, y_m , both in feet above mean sea level (ft msl). The minimum water surface, y_m , is derived from the following equations:

Equation 7-1

$$y_m = \frac{(D_0 + y_c)}{2} + FL$$

Where:

y_m = minimum water surface elevation of the pipe (ft msl)

D_0 = pipe outlet diameter (ft)

y_c = critical depth of the channel for a given flow and geometric conditions (ft)

FL = flow line of the pipe, lateral, trunk, or channel (ft msl).

The critical depth, y_c , is determined by the following equation for Froude Number, which is set equal to 1.0 and solved for depth:

Equation 7-2

$$1.0 = \frac{(Q/A)}{(gD)^{0.5}}$$

Where:

Q = flow in the inlet pipe (cfs)

A = cross-sectional area of the flow (ft²)

D = diameter of the inlet pipe (ft)

g = acceleration due to gravity = 32.2 ft/sec²

- B. Storm drain outfalls to a river or stream creates the need to consider the joint or coincidental probability of two hydrologic events occurring at the same time to adequately determine the elevation of the tailwater in the receiving stream. The relative independence of the discharge from the storm drainage system can be qualitatively evaluated by a comparison of the drainage area of the receiving stream to the area of the storm drainage system. For example, if the storm drainage system has a drainage area much smaller than that of the receiving stream, the peak discharge from the storm drainage system may be out of phase with the peak discharge from the receiving watershed. In this case, it would be necessary to establish an appropriate design tailwater elevation for a storm drainage system based on the expected coincident storm frequency on the outfall channel. The area ratio shown in Figure 7-3 is the ratio of the main stream (receiving area) to the tributary (storm system drainage area).
- C. The designer must also perform a "Normal Depth" outfall analysis to determine the maximum outlet velocities of the facility. This analysis includes solving the downstream boundary condition using Manning's Equation for Normal Depth.

Table 7-3: Frequencies for Coincidental Occurrences

Area Ratio	2-Year design		5-Year Design	
	Main Stream	Tributary	Main Stream	Tributary
10,000:1	1	2	1	5
	2	1	5	1
1,000:1	1	2	2	5
	2	1	5	2
100:1	2	2	2	5
	2	2	5	5
10:1	2	2	5	5
	2	2	5	5
1:1	2	2	5	5
	2	2	5	5
Area Ratio	10-year design		25-year design	
	Main Stream	Tributary	Main Stream	Tributary
10,000:1	1	10	2	25
	10	1	25	2
1,000:1	2	10	5	25
	10	2	25	5
100:1	5	10	10	25
	10	5	25	10
10:1	10	10	10	25
	10	10	25	10
1:1	10	10	25	25
	10	10	25	25
Area Ratio	50-year design		100-year design	
	Main Stream	Tributary	Main Stream	Tributary
10,000:1	2	50	2	100
	50	2	100	2
1,000:1	5	50	10	100
	50	5	100	10
100:1	10	50	25	100
	50	10	100	25
10:1	25	50	50	100
	50	25	100	50
1:1	50	50	100	100
	50	50	100	100

Source: *TxDOT HDM* [4]

7.3.2 Friction Losses

Friction losses or major losses shall be computed using Manning's Equation. The friction loss (h_f) for a segment of conduit is defined by the product of the friction slope at full flow and the length of the conduit. Per the *TxDOT HDM*, the simplified form of the equation is shown in Equation 7-3.

Equation 7-3

$$h_f = \frac{Q^2 n^2}{z^2 A^2 R^{4/3}} L$$

Where:

Q = discharge (cfs)

n = Manning's roughness coefficient

$z = 1.486$ for use with English measurements only

A = cross-sectional area of flow (ft^2)

R = hydraulic radius (ft)

L = length of pipe (ft).

7.3.3 Minor Energy Losses

Minor energy losses in storm drains are attributed from junctions, bends, manholes or inlets, and expansions and contractions. Minor energy losses are required to be evaluated when designing a storm drain system. The following equations and methods shall be used when designing a storm drain system and are base on design information in the *TxDOT HDM*.

7.3.3.1 Junction Loss Equation

A pipe junction is the connection of a lateral pipe to a larger trunk pipe without the use of an access hole. The minor loss equation for a pipe junction is in the form of the momentum equation. In Equation 7-4, the subscripts "i", "o", and "1" indicate the inlet, outlet and lateral, respectively.

Equation 7-4

$$h_j = \frac{Q_o v_o - Q_i v_i - Q_1 v_1 \cos\theta}{0.5g(A_o + A_i)}$$

Where:

h_j = junction head loss (ft)

Q = flow (cfs)

v = velocity (fps)

A = cross-sectional area (ft^2)

θ = angle in degrees of lateral with respect to centerline of outlet pipe

g = gravitational acceleration = 32.2 ft/s^2 .

The above equation applies only if $v_o > v_i$ and assumes that $Q_o = Q_i + Q_1$.

7.3.3.2 Exit Loss Equation

The exit loss, h_o , is a function of the change in velocity at the outlet of the pipe as shown in Equation 7-5.

Equation 7-5

$$h_o = C_o \frac{v^2 - v_d^2}{2g}$$

Where:

h_o = exit loss (ft)

v = average outlet velocity (fps)

v_d = channel velocity downstream of the outlet (fps)

C_o = exit loss coefficient (0.5 typical).

The above assumes that the channel velocity is lower than the outlet velocity. Note that, for partial flow where the pipe outfalls into a channel with water moving in the same direction, the exit loss may be reduced to virtually zero.

7.3.3.3 Inlet and Access Hole Energy Loss Equations

HEC 22 presents the method to compute energy losses for inlets and access holes.

As a starting point, the outflow pipe energy head (E_i) is the difference between the energy gradeline in the outflow pipe (EGL_i) and the outflow pipe flowline (Z_i), as determined in Equation 7-6 and shown on Figure 7-1.

Equation 7-6

$$E_i = EGL_i - Z_i$$


Where:

E_i = Outflow pipe energy head (ft)

EGL_i = Outflow pipe energy gradeline (ft)

Z_i = Outflow pipe flowline elevation (ft).

Figure 7-1: Access Hole Energy Level Definitions

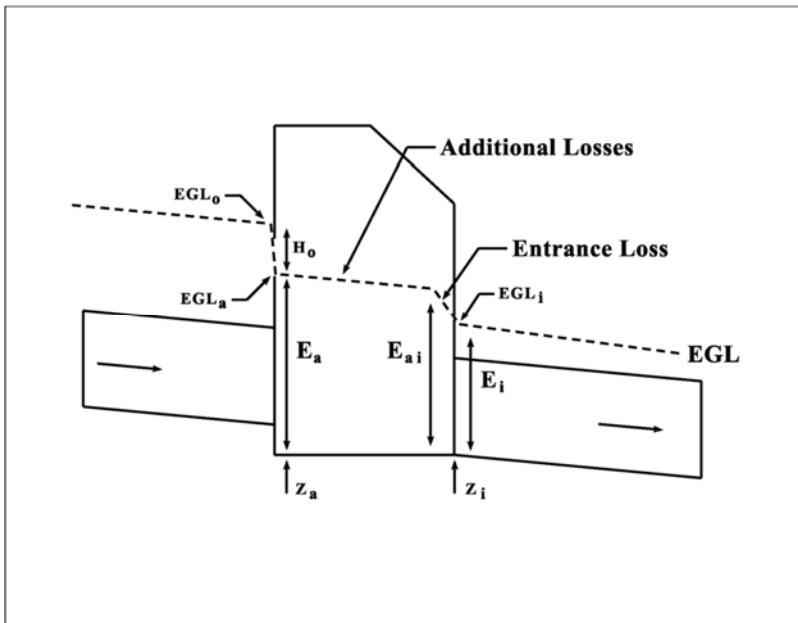

Source: *TxDOT HDM* [4]

Initial Access Hole Energy Level

The initial estimate of energy level (E_{ai}) is taken as the maximum of the three values, E_{aio} , E_{ais} , and E_{aiu} , as determined in Equation 7-7.

Equation 7-7

$$E_{ai} = \max(E_{aio}, E_{ais}, E_{aiu})$$

Where:

E_{aio} = estimated access hole energy level for outlet control (full and partial flow)

E_{ais} = estimated access hole energy level for inlet control (submerged)

E_{aiu} = estimated access hole energy level for inlet control (unsubmerged).

E_{aio} – Estimated Energy Level for Outlet Control

In the outlet control condition, flow out of the access hole is limited by the downstream storm drain system. The outflow pipe would be in subcritical flow and could be either flowing full or partially full. Whether the outflow pipe is flowing full or partially full affects the value of E_{aio} . This can be determined by describing and rearranging the outflow pipe energy head E_i . E_i can be described as the sum of the potential head, pressure head, and velocity head, as shown in Equation 7-8.

Equation 7-8

$$E_i = y + (P/\gamma) + \frac{V^2}{2g}$$

Where:

y = Outflow pipe depth (potential head) (ft)

(P/γ) = Outflow pipe pressure head (ft)

$V^2/2g$ = Outflow pipe velocity head (ft).

Rearranging Equation 7-8 to isolate the potential head and pressure head gives Equation 7-9.

Equation 7-9

$$y + (P/\gamma) = E_i - \frac{V^2}{2g}$$

If $y + (P/\gamma)$ is less than the diameter of the outflow pipe, then the pipe is in partial flow and the estimated initial structure energy level (E_{aio}) is equal to zero ($E_{aio} = 0$).

If $y + (P/\gamma)$ is greater than the diameter of the outflow pipe, then the pipe is in full flow, and the estimated initial structure energy level (E_{aio}) is calculated using Equation 7-10:

Equation 7-10

$$E_{aio} = E_i + H_i$$

Where:

E_i = Outflow pipe energy head (ft)

H_i = entrance loss assuming outlet control, using Equation 7-11.

Equation 7-11

$$H_i = 0.2 \frac{V^2}{2g}$$

Where:

$V^2/2g$ = Outflow pipe velocity head (ft).

E_{ais} – Estimated Energy Level for Inlet Control: Submerged

The submerged inlet control energy level (E_{ais}) checks the orifice condition and is estimated using Equation 7-12:

Equation 7-12

$$E_{ais} = D_o (DI)^2$$

Where:

D_o = Diameter of outflow pipe (ft)

DI = Discharge Intensity parameter, calculated by Equation 7-13:

Equation 7-13

$$DI = \frac{Q}{[A(gD_o)^{0.5}]}$$

Where:

DI = discharge Intensity parameter

Q = flow in outfall pipe (cfs)

A = area of outflow pipe (ft^2)

D_o = diameter of outflow pipe (ft).

E_{aiu} – Estimated Energy Level for Inlet Control: Unsubmerged

The unsubmerged inlet control energy level (E_{aiu}) checks the weir condition and is estimated using Equation 7-14:

Equation 7-14

$$E_{aiu} = 1.6D_o (DI)^{0.67}$$

Adjustments for Benching, Angled Flow, and Plunging Flow

The revised access hole energy level (E_a) is determined by adding three loss factors for: (1) benching configurations; (2) flows entering the structure at an angle; and (3) plunging flows. Flows entering a structure from an inlet can be treated as plunging flows and determined by Equation 7-15.

Equation 7-15

$$E_a = E_{ai} + H_a$$

Where:

E_a = the revised access hole energy level

E_{ai} = the initial estimate of access hole energy level, calculated using Equation 7-7

H_a = additional energy loss due to benching, angled inflow and plunging inflow, calculated using Equation 7-16.

If E_a is calculated to be less than the outflow pipe energy head (E_i), then E_a should be set equal to E_i .

Equation 7-16

$$H_a = (C_B + C_\theta + C_p)(E_{ai} - E_i)$$

Where:

C_B = Coefficient for benching (floor configuration)

C_θ = Coefficient for angled flows


C_p = Coefficient for plunging flows.

Note that the value of H_a should always be positive. If not, H_a should be set to zero.

Additional Energy Loss: Benching

Benching serves to direct flow through the access hole, which reduces energy losses. Figure 7-2 illustrates some typical bench configurations.

Figure 7-2: Access hole benching methods

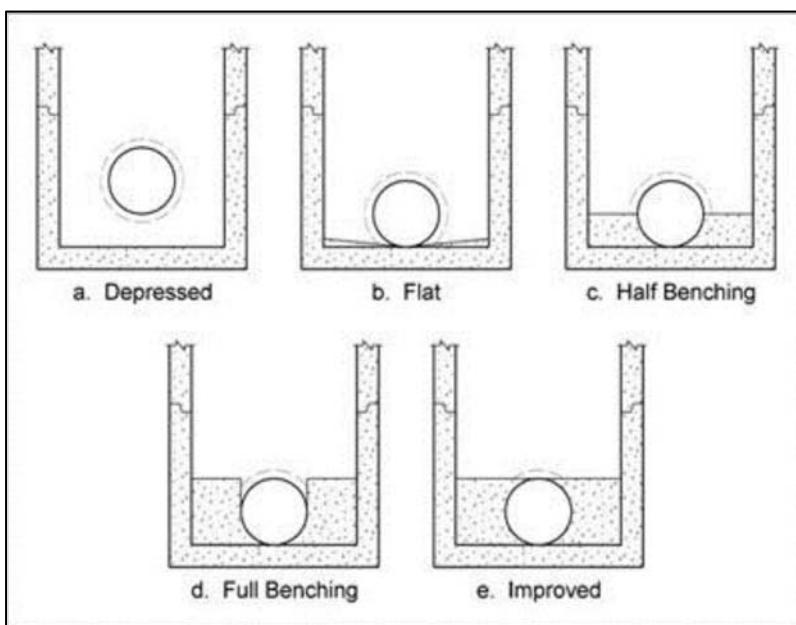

Source: *TxDOT HDM* [4]

The energy loss coefficient for benching, (C_B), is obtained from Table 7-4. A negative value indicates water depth will be decreased rather than increased.

Table 7-4: Values for the Coefficient, C_B

Floor Configuration	C_B
Flat (level)	-0.05
Depressed	0.0
Unknown	-0.05

Source: *TxDOT HDM* [4]

Additional Energy Loss: Angled Inflow

The angles of all inflow pipes into the access hole are combined into a single weighted angle (θ_w) using Equation 7-17:

Equation 7-17

$$\theta_w = \Sigma \left((Q_J \theta_J) / (\Sigma Q_J) \right)$$

Where:

Q_J = Contributing flow from inflow pipe (cfs)

θ_J = Angle measured from the outlet pipe (degrees)(plunging flow is 180 degrees).

Figure 7-3 illustrates the orientation of the pipe inflow angle measurement. The angle for each inflow pipe is referenced to the outlet pipe, so that the angle is not greater than 180 degrees. A straight pipe angle is 180 degrees. If all flows are plunging, θ_w is set to 180 degrees; the angled inflow coefficient approaches zero as θ_w approaches 180 degrees and the relative inflow approaches zero. The angled inflow coefficient (C_θ) is calculated by Equation 7-18:


Equation 7-18

$$C_\theta = 4.5 \frac{(\Sigma Q_J)}{Q_o} \cos\left(\frac{\theta_w}{2}\right)$$

Where:

Q_o = Flow in outflow pipe (cfs).

Figure 7-3: Access hole angled inflow definition

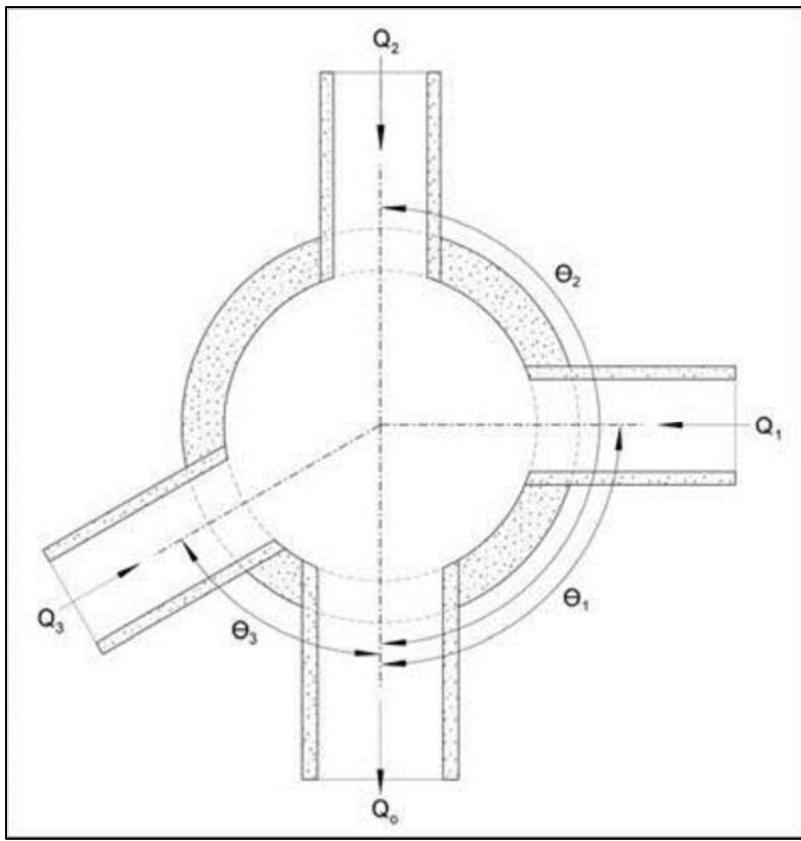

Source: TxDOT HDM [4]

Additional Energy Loss: Plunging Inflow

Plunging inflow is defined as inflow from an inlet or a pipe where the pipe flowline is above the estimated access hole water depth (approximated by E_{ai}).

The relative plunge height (h_k) for each inflow pipe is calculated using Equation 7-19

Equation 7-19

$$h_k = \frac{(Z_k - E_{ai})}{D_o}$$

Where:

Z_k = the difference between the inflow pipe flowline elevation and the access hole flowline elevation. If $Z_k > 10D_o$ it should be set to $10D_o$.

The relative plunge height for each inflow pipe is calculated separately and then combined into a single plunging flow coefficient (C_p):

Equation 7-20

$$C_p = \frac{\sum(Q_k H_k)}{Q_o}$$

As the proportion of plunging flows approaches zero, C_p also approaches zero.

Access Hole Energy Gradeline

Knowing the access hole energy level (E_a) and assuming that the access hole flowline (Z_a) is the same elevation as the outflow pipe flowline (Z_o) allows determination of the access hole energy gradeline (EGL_a):

Equation 7-21

$$EGL_a = E_a + Z_a$$

As described earlier, the potentially highly turbulent nature of flow within the access hole makes determination of water depth problematic. Research has shown that determining velocity head within the access hole is very difficult, even in controlled laboratory conditions. However, a reasonable assumption is to use the EGL_a as a comparison elevation to check for potential surcharging of the system.

Inflow Pipe Exit Losses

The final step is to calculate the energy gradeline into each inflow pipe, whether plunging or non-plunging.

Non-Plunging Inflow Pipe

Non-plunging inflow pipes are those pipes with a hydraulic connection to the water in the access hole. Inflow pipes operating under this condition are identified when the revised access hole energy gradeline (E_a) is greater than the inflow pipe flowline elevation (Z_o). In this case, the inflow pipe energy head (EGL_o) is equal to:

Equation 7-22

$$EGL_o = EGL_a + H_o$$

Where:

$$H_o = 0.4(V^2/2g) = \text{Inflow pipe exit loss.}$$

Exit loss is calculated in the traditional manner using the inflow pipe velocity head since a condition of supercritical flow is not a concern on the inflow pipe.

Plunging Inflow Pipe

For plunging inflow pipes, the inflow pipe energy gradeline (EGL_o) is logically independent of access hole water depth and losses.

Continuing Computations Upstream

For either the nonplunging or plunging flows, the resulting energy gradeline is used to continue computations upstream to the next access hole. The procedure of estimating entrance losses, additional losses, and exit losses is repeated at each access hole.

7.3.4 Energy Gradeline Procedure

1. Determine the EGL_i and HGL_i downstream of the access hole. The EGL and HGL will most likely need to be followed all the way from the outfall. If the system is being connected to an existing storm drain, the EGL and HGL will be that of the existing storm drain.
2. Verify flow conditions at the outflow pipe.
 - a. If HGL_i is greater or equal to the soffit of the outflow pipe, the pipe is in full flow.
 - b. If HGL_i is less than the soffit of the outflow pipe but greater than critical depth, the pipe is not in full flow but downstream conditions still control.
 - c. If HGL_i is less than the soffit of the outflow pipe but greater than critical depth and less than or equal to normal depth, the pipe is in subcritical partial flow. EGL_i becomes the flowline elevation plus normal depth plus the velocity head.
 - d. If HGL_i is less than critical depth, the pipe is in super-critical partial flow conditions. Pipe losses in a supercritical pipe section are not carried upstream.
3. Estimate E_i (outflow pipe energy head) by subtracting Z_i (pipe flowline elevation) from the EGL_i using Equation 7-6. Calculate $y + P/\gamma$ using Equation 7-9. Compute DI using Equation 7-13.
4. Calculate E_{ai} as maximum of E_{aio} , E_{ais} , and E_{aiu} as below:
 - a. If $(y + P/\gamma) > D$, then the pipe is in full flow and $E_{aio} = E_i + H_i$ (Equation 7-10). If $(y + P/\gamma) < D$, then the pipe is in partial flow and $E_{aio} = 0$.
 - b. $E_{ais} = D_o(DI)^2$ (Equation 7-12)
 - c. $E_{aiu} = 1.6 D_o(DI)^{0.67}$ (Equation 7-14)

If $E_{ai} < E_i$, the head loss through the access hole will be zero, and $E_{ai} = E_i$. Go to Step 10.

5. Determine the benching coefficient (C_B) using Table 7-4. The values are the same whether the bench is submerged or unsubmerged.
6. Determine the energy loss coefficient for angle flow (C_θ) by determining θ_w for every pipe into the access hole.
 - a. Is $E_i <$ inflow pipe flowline? If so, then the flow is plunging and θ_w for that pipe is 180 degrees.
 - b. If the pipe angle is straight, then θ_w for that pipe is 180 degrees.
 - c. Otherwise, θ_w is the angle of the inflow pipe relevant to the outflow pipe. Maximum angle is 180 degrees (straight).

Use Equation 7-17 and Equation 7-18 to calculate θ_w and C_θ .

7. Determine the plunging flow coefficient (C_p) for every pipe into the access hole using Equation 7-20. The relative plunge height (h_k) is calculated using Equation 7-19. Z_k is the difference between the access hole flowline elevation and the inflow pipe flowline elevation. If $Z_k > 10D_o$, Z_k should be set to $10D_o$.
8. If the initial estimate of the access hole energy level is greater than the outflow pipe energy head ($E_{ai} > E_i$), then $E_a = E_i$. If $E_{ai} < E_i$, then $H_a = (E_{ai} - E_i)(C_B + C_\theta + C_p)$. If $H_a < 0$, set $H_a = 0$.
9. Calculate the revised access hole energy level (E_a) Equation 7-15. If $E_a < E_i$, set $E_a = E_i$.
10. Compute EGL_a by adding E_a to the outflow pipe flowline elevation. Assume HGL_a at the access hole structure is equal to EGL_a .
11. Compare EGL_a with the critical elevation (ground surface, top of grate, gutter elevation, or other limits). If EGL_a exceeds the critical elevation, modifications must be made to the design.

7.4 Hydraulic Grade Line Computation Sheet

The design engineer shall provide a HGL computation sheet that depicts all forms or energy loss for each junction and pipe connection and identifies the upstream and downstream HGL and EGL elevations. These computations shall be provided for the design storm and 100-year assessment.

8 Open Channels

8.1 General Requirements

The general classifications for open channels are: (1) Natural channels, which include all watercourses that have been carved by nature through erosion; and (2) Engineered channels, which are constructed or existing channels that have been significantly altered by human effort.

- A. The City of New Braunfels encourages the preservation of natural channels and drainage patterns. Developed drainage flows must enter and depart from a developed area in the same manner and location as under pre-development conditions. Any concentration of previous over-land flow is required to leave the developed site into a receivable body such as a drainage easement or city right-of-way in a manner so as to not impact downstream properties and/or facilities.
- B. Easements or drainage rights-of-way shall be provided for all open channels such that the 100-year runoff and maintenance access are contained within drainage easements and/or right-of-way. Drainage easements shall be designated on plats for recording. For properties with existing structural development on previously platted lots, additional drainage easements shall be dedicated by separate recorded instrument or an amended plat. Easements and FEMA floodways shall not be encroached upon with fill materials or structures, which would reduce the channel's ability to carry the 100-year flood.
 - a. Easement width shall be at least the width of the water surface from the 100-year design storm runoff under post-development conditions plus maintenance access. Maintenance access shall extend 2 feet from one side of the channel and 12 feet on the other side of the channel. If a channel is located parallel and adjoining a roadway, maintenance access shall extend 2 feet from both sides of the channel.
 - b. Additional easement width should be provided to allow for channel meandering near bends of channels
- C. Engineered channels shall be designed to meet the applicable design, freeboard and easement requirements. Freeboard along the outside of channel bends shall include the increased water surface due to superelevation.
- D. Fencing and/or warning signs should be required to prevent public access where flowing water would pose a safety hazard. Fencing shall be designed in such a way as to not pose a drainage obstruction.
- E. Shear stress shall be computed for all open channels and adequate protection provided in accordance with *Hydraulic Engineering Circular 15: Design of Roadway Channels with Flexible Linings (HEC 15)* [9]. Channels shall be designed to be stable and to not create safety hazards. Side slopes of vegetative lined channels should be 3:1 or flatter (4:1 or flatter along roadways) in channels with depths greater than 2 feet. Recommended maximum water velocities for earthen channels are given in Table 8-1. Erosion control or energy dissipation devices should be used to control velocities such that channel degradation does not occur. Bank stabilization measures shall not reduce channel capacity and shall follow sound engineering practices

Table 8-1: Maximum Velocity in Open Channels

Channel Lining Material ¹	Channel Slope (%)	Maximum Velocity (fps)
Earthen Channels	0 – 5	6
	5 – 10	5
	> 10	4
Rock (native subgrades)		10
Gabion Lined		12
Reinforced concrete lining		20
Rock Riprap (placed rock)		12
Prefabricated lining products		Use 90% of manufacturer's recommended velocity limits

¹ Uniform, in well-maintained condition.

- F. Should diversion of a natural drainage way be required, sufficient work shall be done upstream and/or downstream to provide all affected properties at least the same level of flood protection and erosion control that existed prior to the diversion. The time length of a diversion channel must be at least as long as the segment of natural channel being replaced so that velocity is not increased.
- G. Fencing shall be required adjacent to the channel where channel vertical wall heights exceed 30 inches and where channel side slopes exceed 2:1 and the depth is greater than 30 inches. Fencing shall be a minimum of 42 inches high, provide for maintenance access and not hinder sight distance for traffic. Fence type and location shall be determined by the design engineer.
- H. Concrete pilot channels shall be provided for channels with longitudinal slopes less than 0.5 percent or bottom widths greater than 30 feet. The minimum bottom width of the pilot channel shall be 4 feet and the minimum earthen slope draining toward the pilot channel shall be 1 percent.

8.2 Design Criteria

- A. The depth and velocity of flow are necessary for the design and analysis of channel linings and structures. The depth and velocity at which a given discharge flows in a channel of known geometry, roughness, and slope can be determined through hydraulic analysis. The following two methods are commonly used in the hydraulic analysis of open channels:

1. Slope Conveyance Method
2. Standard Step Backwater Method

The Slope Conveyance and Standard Step Backwater Methods have been summarized from the *TxDOT HDM*.

- B. Channels should have sufficient gradient, depending upon the type of soil or channel lining material, to provide velocities that will be self-cleaning (greater than 2 feet per second for the 2-year storm event) but not cause erosion due to excessive shear stress.
- C. Appropriate energy dissipating structures may be used to control erosion due to high velocities at pipe system outfalls and steep grades and shall be designed in accordance with accepted design

practices such as outlined by the Soil Conservation Service, the Corps of Engineers, the Bureau of Land Reclamation, or TxDOT.

8.3 Channel Capacity

Per HEC 22, the most commonly used equation for solving steady, uniform flow problems is the Manning's Equation (Equation 8-1). The depth of flow in steady, uniform flow is called the normal depth.

Equation 8-1

$$v = \frac{z}{n} R^{2/3} S^{1/2}$$

Where:

v = velocity (cfs)

z = 1.486 for English measurement units

n = Manning's roughness coefficient (a coefficient for quantifying the roughness characteristics of the channel)

R = hydraulic radius (ft) = A/WP

WP = wetted perimeter of flow (the length of the channel boundary in direct contact with the water) (ft) and A = area of conveyance (ft^2)

S = slope of the energy gradeline (ft/ft) (For uniform, steady flow, S = channel slope, ft/ft).

Combine Manning's Equation with the continuity equation to determine the channel uniform flow capacity as shown in Equation 8-2.

Equation 8-2

$$Q = \frac{z}{n} A R^{2/3} S^{1/2}$$

Where:

Q = discharge (cfs)

z = 1.486 for English measurement units

A = cross-sectional area of flow (ft^2).

For convenience, Manning's Equation in this manual assumes the form of Equation 8-2. Since Manning's Equation does not allow a direct solution to water depth (given discharge, longitudinal slope, roughness characteristics, and channel dimensions), an indirect solution to channel flow is necessary.

8.4 Roughness Coefficients

All hydraulic conveyance formulas quantify roughness subjectively with a coefficient. In Manning's Equation, the roughness coefficients, or n -values, for Texas streams and channels range from 0.200 to 0.012; values outside of this range are probably not realistic. Determination of a proper n -value is the

most difficult and critical of the engineering judgments required when using the Manning's Equation. The recommended Manning's roughness coefficients ("N" values) for use in open channel hydraulic calculations are listed in Table 8-2.

Table 8-2: Manning's Roughness Coefficients

Natural Channels	Min	Normal	Max
<i>Minor Streams (top width at flood stage <30 meters)</i>			
Streams on plain:			
◆ Clean, straight, full stage, no rifts or deep pools	0.025	0.030	0.033
◆ Same as above, but more stones and weeds	0.030	0.035	0.040
◆ Clean, winding, some pools and shoals	0.033	0.040	0.045
◆ Same as above, but some stones and weeds	0.035	0.045	0.050
◆ Same as above, but lower stages, more ineffective slopes and sections	0.040	0.048	0.055
◆ Clean, winding, some pools and shoals, some weeds and many stones	0.045	0.050	0.060
◆ Sluggish reaches, weedy, deep pools	0.050	0.070	0.080
◆ Very weedy reaches, deep pools, or floodways with heavy stand of timber and underbrush	0.075	0.100	0.150
Mountain streams, no vegetation in channel, banks usually steep, trees and brush along banks submerged at high stages:			
◆ Bottom: gravel, cobbles, and few boulders	0.030	0.040	0.050
◆ Bottom: cobbles with large boulders	0.040	0.050	0.070
<i>Flood Plains</i>			
Pasture, no brush:			
◆ Short grass	0.025	0.030	0.035
◆ High grass	0.030	0.035	0.050
Cultivated areas:			
◆ No crop	0.020	0.030	0.040
◆ Mature row crops	0.025	0.035	0.045
◆ Mature field crops	0.030	0.040	0.050
Brush:			
◆ Scattered brush, heavy weeds	0.035	0.050	0.070
◆ Light brush and trees, in winter	0.035	0.050	0.060
◆ Light brush and trees, in summer	0.040	0.060	0.080
◆ Medium to dense brush, in winter	0.045	0.070	0.110
◆ Medium to dense brush, in summer	0.070	0.100	0.160
Trees:			
◆ Dense willows, summer, straight	0.110	0.150	0.200
◆ Cleared land with tree stumps, no sprouts	0.030	0.040	0.050
◆ Same as above, but with heavy growth of sprouts	0.050	0.060	0.080
◆ Heavy stand of timber, a few down trees, little undergrowth, flood stage below branches	0.080	0.100	0.120
◆ Same as above, but flood stage reaching branches	0.100	0.120	0.160
<i>Major Streams (top width at flood stage >30 meters)</i>			
◆ Regular section with no boulders or brush	0.025	--	0.060
◆ Irregular and rough section	0.035	--	0.100
<i>Lined Channels</i>			
◆ Concrete-lined	0.012	--	0.018
◆ Concrete rubble	0.017	--	0.030
<i>Unlined Channels</i>			
◆ Earth, straight and uniform	0.017	--	0.025
◆ Winding and sluggish	0.022	--	0.030
◆ Rocky beds, weeds on bank	0.025	--	0.040
◆ Earth bottom, rubble sides	0.028	--	0.035
◆ Rock cuts	0.025	--	0.045

Source: *TxDOT HDM [4]*

In some instances, such as a trapezoidal section under a bridge, the n-value may vary drastically within a section, but the section should not be sub-divided. If the n-value varies as such, use a weighted n-value (n_w). This procedure is defined by Equation 8-3 as follows:

Equation 8-3

$$n_w = \frac{\sum(n \text{ } WP)}{\sum WP}$$

Where:

WP = subsection wetted perimeter

n = subsection n-value.

8.5 Subdividing Cross-Sections

Because any estimating method involves the calculation of a series of hydraulic characteristics of the cross section, arbitrary water-surface elevations are applied to the cross section. The computation of flow or conveyance for each water-surface application requires a hydraulic radius. The hydraulic radius is intended as an average depth of a conveyance. A hydraulic radius and subsequent conveyance is calculated under each arbitrary water surface elevation. If there is significant irregularity in the depth across the section, the hydraulic radius may not accurately represent the flow conditions. Divide the cross section into sufficient subsections so that realistic hydraulic radii are derived.

Subdivide cross sections primarily at major breaks in geometry. Additionally, major changes in roughness may call for additional subdivisions. Subdivisions for major breaks in geometry or for major changes in roughness should maintain these approximate basic shapes so that the distribution of flow or conveyance is nearly uniform in a subsection.

Documentation must be submitted by the design engineer describing the methodology used to subdivide cross sections for review and approval by the City Engineer.

8.6 Slope Conveyance Method

The Slope Conveyance Method requires more judgment and assumptions than the Standard Step Method. In many situations, however, use of the Slope Conveyance Method is justified, as in the following conditions:

- Standard roadway ditches
- Culverts
- Storm drain outfalls

The procedure involves an iterative development of calculated discharges associated with assumed water surface elevations in a typical section. The series of assumed water surface elevations and associated discharges comprise the stage-discharge relationship. When stream gauge information exists, a measured relationship (usually termed a “rating curve”) may be available.

A channel cross section and associated roughness and slope data considered typical of the stream reach are required for this analysis. A typical section is one that represents the average characteristics of the stream near the point of interest. This cross section should be located downstream of and as close as reasonably possible to the proposed drainage facility discharge site. The closer to the proposed site a typical cross section is taken, the less error in the final water surface elevation

A typical cross section should be used for the analysis. If a cross section does not exist, then a "control" cross section (also downstream) should be used. The depth of flow in a control cross section is controlled by a constriction of the channel, a damming effect across the channel, or possibly an area with extreme roughness coefficients. The cross section should be normal to the direction of stream flow under flood conditions.

After identifying the cross section, apply Manning's roughness coefficients (n-values). Divide the cross section with vertical boundaries at significant changes in cross-section shape or at changes in vegetation cover and roughness components. Determine the average bed slope near the site.

8.6.1 Slope Conveyance Procedure

The calculation of the stage-discharge relationship should proceed as described in this section.

1. Select a trial starting depth and apply it to a plot of the cross section.
2. Compute the area and wetted perimeter weighted n-value for each submerged subsection.
3. Compute the subsection discharges with Manning's Equation. Use the subsection values for roughness, area, wetted perimeter, and slope. The sum of all of the incremental discharges represents the total discharge for each assumed water surface elevation. NOTE: Compute the average velocity for the section by substituting the total section area and total discharge into the continuity equation (Equation 8-4).
4. Tabulate or plot the water surface elevation and resulting discharge (stage versus discharge).
5. Repeat the above steps with a new channel depth, or add a depth increment to the trial depth. The choice of elevation increment is somewhat subjective. However, if the increments are less than about 0.25 feet, considerable calculation is required. On the other hand, if the increments are greater than 1.5 feet, the resulting stage-discharge relationship may not be detailed enough for use in design.
6. Determine the depth for a given discharge by interpolation of the stage versus discharge table or plot.

Equation 8-4

$$V = \frac{Q}{A}$$

8.7 Standard Step Backwater Method

Calculations of water surface profiles can be accomplished by using the Standard Step Method. Water surface profiles for the design frequency floods shall be computed for all channels and shown on all final drawings.

The Corps of Engineers HEC-RAS Water Surface Profile Programs may also be used to perform standard step backwater calculations, and if used, a summary table shall be submitted to the City. In addition, the design engineer shall provide documentation that justifies the flow regime (subcritical, supercritical, or mixed) used in the analysis. Losses due to changes in velocity, drops, bridge openings, and other obstructions shall be considered in the backwater computations, as described in the HEC-RAS User's Manuals.

Use the Standard Step Method for analysis in the following instances:

- Results from the Slope-Conveyance Method may not be accurate enough
- The drainage facility's level of importance deserves a more sophisticated channel analysis
- The channel is highly irregular with numerous or significant variations of geometry, roughness characteristics, or stream confluences
- A controlling structure affects backwater.

This procedure applies to most open channel flow, including streams having an irregular channel with the cross section consisting of a main channel and separate overbank areas with individual n-values. Use this method either for supercritical flow or for subcritical flow.

8.7.1 Standard Step Data Requirements

At least four cross sections are required to complete this procedure. The number and frequency of cross sections required is a direct function of the irregularity of the stream reach. The cross sections should represent the reach between them. A system of measurement or stationing between cross sections is also required. Evaluate roughness characteristics (n-values) and associated sub-section boundaries for all of the cross sections.

The selection of cross sections used in this method is critical. As the irregularities of a stream vary along a natural stream reach, accommodate the influence of the varying cross-sectional geometry.

Incorporate transitional cross sections into the series of cross sections making up the stream reach.

8.7.2 Standard Step Procedure

The Standard Step Method uses the Energy Balance Equation, Equation 8-5, which allows the water surface elevation at the upstream section (noted as subscript 2) to be found from a known water surface elevation at the downstream section (noted as subscript 1). The following procedure assumes that cross sections, stationing, discharges, and n-values have already been established. Generally, for Texas, the assumption of subcritical flow will be appropriate to start the process. Subsequent calculations will check this assumption.

Equation 8-5

$$z_2 + d_2 + \alpha_2 \left(\frac{v_2^2}{2g} \right) = z_1 + d_1 + \alpha_1 \left(\frac{v_1^2}{2g} \right) + h_f + \text{other losses}$$

Where:

z = elevation of the streambed (ft)

d = depth of flow (ft)

α = kinetic energy coefficient

v = average velocity of flow (fps)

h_f = friction head loss from upstream to downstream (ft)

g = acceleration due to gravity = 32.2 ft/ s².


1. Select the discharge to be used. Determine a starting water surface elevation. For subcritical flow, begin at the most downstream cross section. Use one of the following methods to establish a starting water surface elevation for the selected discharge: a measured elevation, the Slope-Conveyance Method to determine the stage for an appropriate discharge, or an existing (verified) rating curve.
2. Referring to Figure 8-1 and Equation 8-5, consider the downstream water surface to be section 1 and calculate the following variables:

z_1 = flowline elevation at section 1

y_1 = tailwater minus flowline elevation

α = kinetic energy coefficient (For simple cases or where conveyance does not vary significantly, it may be possible to ignore this coefficient).

Figure 8-1: EGL for Water Surface Profile

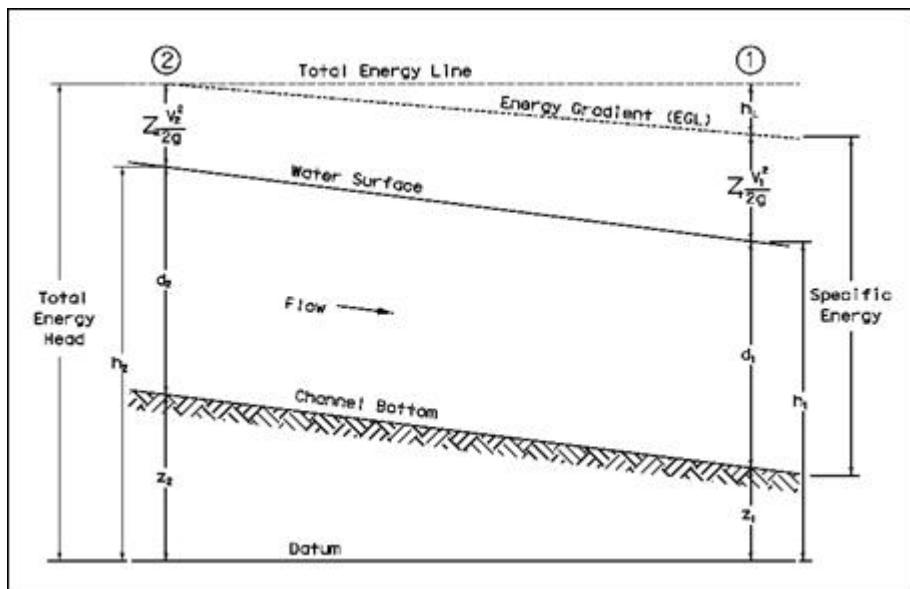

Source: TxDOT HDM [4]

3. From cross section 1, calculate the area, A_1 . Then use Equation 8-6 to calculate the velocity, v_1 , for the velocity head at A_1 . The next station upstream is usually section 2. Assume a depth y_2 at section 2, and use y_2 to calculate z_2 and A_2 . Calculate, also, the velocity head at A_2 .

Equation 8-6

$$Q = A_1 v_1 = A_2 v_2$$

Q = discharge (cfs)

A = flow cross-sectional area (ft^2)

v = mean cross-sectional velocity (fps, perpendicular to the flow area).

The superscripts 1 and 2 refer to successive cross sections along the flow path.

4. Calculate the friction slope between the two sections using Equation 8-7 and Equation 8-8:

Equation 8-7

$$s_f = \left(\frac{Q}{K_{ave}} \right)^2$$

Where:

$$K_{ave} = \frac{K_1 + K_2}{2} = 0.5 \left(\frac{ZA_1 R_1^{\frac{2}{3}}}{n_1} + \frac{ZA_2 R_2^{\frac{2}{3}}}{n_2} \right)$$

5. Calculate the friction head losses (h_f) between the two sections using:

Equation 8-8

$$h_f = S_{ave} L$$

Where:

L = Distance between the two sections (ft).

6. Calculate the kinetic energy correction coefficients (α_1 and α_2) using Equation 8-9.

Equation 8-9

$$\alpha = \frac{\sum(Q_i v_i^2)}{Q v^2} = \frac{\sum[K_i(K_i/A_i)^2]}{K_t(K_t/A_t)^2}$$

Where:

v_i = average velocity in subsection (fps) (see Continuity Equation section)

Q_i = discharge in same subsection (cfs) (see Continuity Equation section)

Q = total discharge in channel (cfs)

v = average velocity in river at section or Q/A (ft/s)

K_i = conveyance in subsection (cfs) (see Conveyance section)

A_i = flow area of same subsection (ft^2)

K_t = total conveyance for cross-section (cfs)

A_t = total flow area of cross-section (ft^2).

7. Where appropriate, calculate expansion losses (h_e) using Equation 8-10 and contraction losses

(h_c) using Equation 8-11 (Other losses, such as bend losses, are often disregarded as an unnecessary refinement.)

Equation 8-10

$$h_e = K_e \frac{\Delta V^2}{2g}$$

Where:

$K_e = 0.1$ for a gentle contraction

$K_e = 0.5$ for a sudden contraction

Equation 8-11

$$h_c = K_c \frac{\Delta V^2}{2g}$$

Where:

$K_c = 0.1$ for a gentle contraction

$K_c = 0.5$ for a sudden contraction

8. Check the energy equation for balance using Equation 8-12 and Equation 8-13.

Equation 8-12

$$L = z_2 + y_2 + \alpha_1 \frac{v_2^2}{2g}$$

Equation 8-13

$$R = z_1 + y_1 + \alpha_1 \frac{v_1^2}{2g} + h_f + h_e + h_c$$

The following considerations apply:

- if $L=R$ within a reasonable tolerance, then the assumed depth at Section 1 is okay. This will be the calculated water surface depth at Section 1; proceed to step (9)
- if $L \neq R$, go back to step (3) using a different assumed depth.

9. Determine the critical depth (d_c) at the cross section and find the uniform depth (d_u) by iteration. If, when running a supercritical profile, the results indicate that critical depth is greater than uniform depth, then it is possible the profile at that cross section is supercritical. For subcritical flow, the process is similar but the calculations must begin at the upstream section and proceed downstream.

10. Assign the calculated depth from step (8) as the downstream elevation (Section 1) and the next section upstream as Section 2, and repeat steps (2) through (10).

11. Repeat these steps until all of the sections along the reach have been addressed.

8.8 Supercritical Flow

The Froude Number provides a relationship between flow velocity and the hydraulic depth of flow, and gravitational action, and shall be calculated for all channel improvements designs. Subcritical flow conditions occur when the Froude Number is less than 1.0 and supercritical flow conditions exist in lined channels when the Froude Number exceeds 1.0.

If a channel's normal depth is supercritical, its alternate depth is a deeper subcritical depth. Obstructions that may enter a stream during a storm event may cause supercritical flows to experience a hydraulic jump and become subcritical flows. When it is calculated that supercritical conditions could occur for the design storm, the depth of the channel must be at least the alternate depth plus the required freeboard. Adequate protection of the channel must be provided to protect against supercritical flow.

Subcritical flow conditions are recommended for all channel designs, as supercritical flow tends to have high velocities and high potential for channel erosion. Supercritical flow conditions will not be allowed in channels with a vegetative lining. Subcritical flow conditions may be achieved by using energy dissipators in areas where the existing topography will not allow subcritical flow conditions to occur

naturally. In all cases, the channel improvements shall be designed to avoid the unstable transitional flow conditions that occur when the Froude Number is between 0.9 and 1.1.

8.9 Flow in Bends

Adequate freeboard must be provided for a channel, ditch and swales as shown in Table 2-2. Flow around a bend in an open channel induces centrifugal forces because of the change in flow direction. This results in a superelevation of the water surface at the outside of bends and can cause the flow to splash over the side of the channel if adequate freeboard is not provided. This superelevation can be estimated by equation using Equation 8-14 from HEC-15.

Equation 8-14

$$\Delta H = \frac{V^2 T}{g R_c}$$

Where:

ΔH = Difference in water surface elevation between the inner and outer banks of the channel in the bend, (ft)

V = Average velocity (fps)

T = Surface width of the channel (ft)

R_c = Radius to the centerline of the channel (ft)

g = Gravitational acceleration = 32.2 ft/s².

Equation 8-14 is valid for subcritical flow conditions. The elevation of the water surface at the outer channel bank will be $\Delta d/2$ higher than the centerline water surface elevation (the average water surface elevation immediately before the bend) and the elevation of the water surface at the inner channel bank will be $\Delta d/2$ lower than the centerline water surface elevation.

Flow around a channel bend also imposes higher shear stress on the channel bottom and banks and may impact channel stability. Refer to *HEC 15* for further guidance if shear stress around a channel bend is anticipated to cause channel erosion.

8.10 Shear Stress

Shear stress shall be computed for all open channels and adequate protection shall be provided based on the tractive force method described in *HEC 15* and the permissible shear stresses reported in the *TxDOT HDM*.

- A. The hydrodynamic force of water flowing in a channel is known as the tractive force. The basis for stable channel design with flexible lining materials is that flow-induced tractive force should not exceed the permissible or critical shear stress of the lining materials. In a uniform flow, the tractive force is equal to the effective component of the drag force acting on the body of water, parallel to the channel bottom [10]. The mean boundary shear stress applied to the wetted perimeter is computed with Equation 8-15.

Equation 8-15

$$\tau = \gamma R S$$

Where:

τ_o = mean boundary shear stress (lb/ft^2)

γ = unit weight of water ($62.4 \text{ lb}/\text{ft}^3$)

R = hydraulic radius (ft)

S_o = average bottom slope (equal to energy slope for uniform flow) (ft/ft).

B. The maximum shear stress on a channel bottom, τ_d , and on the channel side, τ_s , in a straight channel depends on the channel shape. To simplify the design process, the maximum channel bottom shear stress is computed with Equation 8-16.

Equation 8-16

$$\tau = \gamma d S$$

Where:

τ_d = shear stress in channel at maximum depth (lb/ft^2)

d = maximum depth of flow in the channel for the design discharge (ft).

C. Determine channel lining or protection needed. Calculate uniform flow depth (y_m in ft or m) at design discharge using the Slope Conveyance Method. Compute maximum shear stress at normal depth using Equation 8-16. Select a lining and determine the permissible shear stress (in lbs/ft^2 or N/m^2) using Table 8-3 and Table 8-4. If $\tau_d < \tau_p$, then the lining is acceptable.

Table 8-3: Retardation Class for Lining Materials

Retardance Class	Cover	Condition
A	Weeping Lovegrass	Excellent stand, tall (average 30 in. or 760 mm)
	Yellow Bluestem <i>Ischaemum</i>	Excellent stand, tall (average 36 in. or 915 mm)
B	Kudzu	Very dense growth, uncut
	Bermuda grass	Good stand, tall (average 12 in. or 305 mm)
	Native grass mixture little bluestem, bluestem, blue gamma, other short and long stem medwest grasses	Good stand, unmowed
	Weeping Lovegrass	Good Stand, tall (average 24 in. or 610 mm)
	Lespedeza <i>sericea</i>	Good stand, not woody, tall (average 19 in. or 480 mm)
	Alfalfa	Good stand, uncut (average 11 in or 280 mm)
	Weeping lovegrass	Good stand, unmowed (average 13 in. or 330 mm)
	Kudzu	Dense growth, uncut
	Blue gamma	Good stand, uncut (average 13 in. or 330 mm)
	Crabgrass	Fair stand, uncut (10-to-48 in. or 55-to-1220 mm)
	Bermuda grass	Good stand, mowed (average 6 in. or 150 mm)
	Common lespedeza	Good stand, uncut (average 11 in. or 280 mm)
	Grass-legume mixture: summer (orchard grass redtop, Italian ryegrass, and common lespedeza)	Good stand, uncut (6-8 in. or 150-200 mm)
	Centipedegrass	Very dense cover (average 6 in. or 150 mm)
D	Kentucky bluegrass	Good stand, headed (6-12 in. or 150-305 mm)
	Bermuda grass	Good stand, cut to 2.5 in. or 65 mm
	Common lespedeza	Excellent stand, uncut (average 4.5 in. or 115 mm)
	Buffalo grass	Good stand, uncut (3-6 in. or 75-150 mm)
	Grass-legume mixture: fall, spring (orchard grass Italian ryegrass, and common lespedeza)	Good Stand, uncut (4-5 in. or 100-125 mm)
	Lespedeza <i>sericea</i>	After cutting to 2 in. or 50 mm (very good before cutting)
E	Bermuda grass	Good stand, cut to 1.5 in. or 40 mm
	Bermuda grass	Burned stubble

Source: *TxDOT HDM* [4]

Table 8-4: Permissible Shear Stresses for Various Linings

Protective Cover	(lb./sq.ft.)	tp (N/m ²)
Retardance Class A Vegetation (See the "Retardance Class for Lining Materials" table above)	3.7	177
Retardance Class B Vegetation (See the "Retardance Class for Lining Materials" table above)	2.1	101
Retardance Class C Vegetation (See the "Retardance Class for Lining Materials" table above)	1	48
Retardance Class D Vegetation (See the "Retardance Class for Lining Materials" table above)	0.6	29
Retardance Class E Vegetation (See the "Retardance Class for Lining Materials" table above)	0.35	17
Woven Paper	0.15	7
Jute Net	0.45	22
Single Fiberglass	0.6	29
Double Fiberglass	0.85	41
Straw W/Net	1.45	69
Curled Wood Mat	1.55	74
Synthetic Mat	2	96
Gravel, D50 = 1 in. or 25 mm	0.4	19
Gravel, D50 = 2 in. or 50 mm	0.8	38
Rock, D50 = 6 in. or 150 mm	2.5	120
Rock, D50 = 12 in. or 300 mm	5	239
6-in. or 50-mm Gabions	35	1675
4-in. or 100-mm Geoweb	10	479
Soil Cement (8% cement)	>45	>2154
Dycel w/out Grass	>7	>335
Petraflex w/out Grass	>32	>1532
Armorflex w/out Grass	20-Dec	574-957
Erikamat w/3-in or 75-mm Asphalt	13-16	622-766
Erikamat w/1-in. or 25 mm Asphalt	<5	<239
Armorflex Class 30 with longitudinal and lateral cables, no grass	>34	>1628
Dycel 100, longitudinal cables, cells filled with mortar	<12	<574
Concrete construction blocks, granular filter underlayer	>20	>957
Wedge-shaped blocks with drainage slot	>25	>1197

8.11 Drop Structures

The function of a drop structure is to reduce flow velocities by dissipating some of the kinetic energy of the flow at the drop structure, and also providing flatter channel slopes upstream and downstream of the drop structure. Sloping channel drops and vertical channel drops are two commonly used drop structure types.

An apron shall be designed and constructed immediately upstream and downstream of a drop structure to protect against turbulence and prevent scour. Unless an alternative is approved by the City Engineer, the upstream apron shall extend at least ten feet upstream from the point where flow becomes supercritical, and the downstream apron shall be extended downstream from the anticipated location of

the hydraulic jump by the minimum distance listed in Table 8-5. Each end shall include a concrete toe that extends a minimum of twenty-four inches into the ground.

Table 8-5: Minimum Lengths of Downstream Aprons beyond Hydraulic Jumps

Discharge Rate per Unit Width of Apron (cfs/ft)	Minimum Distance to extend Downstream Apron beyond the Hydraulic Jump (ft)
0-14	10
15	15
20	20
25	23
30	25

All drop structures shall be constructed of reinforced concrete, and the bottom and walls (if any) shall have a minimum thickness of six inches. To facilitate maintenance, drop structures should be located near bridges or culverts if possible.

8.11.1 Vertical Drop Structures

The drop length and the hydraulic jump length of the drop structure should be calculated to determine the length of the downstream apron required to prevent erosion [8] [11]. In order to utilize a vertical drop structure vehicular access must be provided to both the upstream and downstream ends of the structures.

8.11.2 Sloping Drop Structures

The location of the hydraulic jump should be determined based on the upstream and downstream flow depths and channel slopes [8] [11]. When utilizing a sloping drop structure, a minimum slope of 6:1 shall be used to allow vehicular access from one end across the structure. If the slope of the drop structure is less than 6:1, vehicular access must be provided to both the upstream and downstream ends of the structures.

8.12 Energy Dissipators

Although hydraulic jumps can be used as energy dissipators, impact dissipators are recommended for their predictability, efficiency, and economy. The Baffled Apron is used to dissipate the energy in the flow at a drop. It requires no initial tailwater to be effective, although scour is reduced with tailwater. The chute of the Baffle Apron is constructed on a 2:1 or flatter slope extending below the channel bottom. Refer to *Hydraulic Engineering Circular 14: Energy Dissipators (HEC 14)* [12] for methods to design energy dissipators.

This page intentionally left blank.

9 Bridges and Culverts

9.1 General Requirements

A bridge is defined as a structure, including supports, erected over a depression or an obstruction (e.g., water, highway or railway) having a roadway for carrying traffic or other moving loads, and having an opening measured along the center of the roadway of more than 20 feet between faces of abutments, spring lines of arches, or extreme ends of openings for multiple box culverts. Culverts convey surface water through a roadway embankment or away from the roadway right-of-way or into a channel along the right-of-way.

- A. Bridges and culverts shall be designed to withstand the 100-year design storm.
- B. Bridges and culverts on arterial streets and parkways shall meet the following requirements:
 - 1. 50-year design storm runoff with headwater one foot below the top of the culvert structure.
 - 2. 100-year water surface shall not encroach through half of roadway lanes.
 - 3. Minimum culvert size of a 24-inch circular pipe or equivalent for alternate shapes.
- C. Bridges and culverts on all other streets shall meet the following requirements:
 - 1. 25-year design storm runoff with headwater one foot below the top embankment.
 - 2. 25-year water surface shall leave at least one lane open.
 - 3. 50-year design storm runoff no more than 6 inches over top of roadway.
 - 4. Allowance shall be made for conveyance of the 100-year runoff across the road and into the downstream channel without damage to the road or adjacent property.
 - 5. Minimum culvert size of an 18-inch circular pipe or equivalent for alternate shapes.
- D. Temporary crossings shall be designed to safely pass the 2-year design storm runoff.
- E. The backwater created by a culvert or bridge during the 100-year design storm runoff shall not cause damage to public or private property.
- F. Culvert outlets shall be designed to minimize damage caused by erosion.
- G. Culverts and bridges shall be aligned with natural drainage ways in grade and direction whenever practical. Culverts shall have a minimum design storm velocity of 2.5 feet per second for the 2-year storm to reduce sediment accumulation.
- H. Larger culvert sizes, bridges, box culverts, and/or smooth-walled pipes are recommended for crossings where heavy debris or sediment accumulations are anticipated. Trash racks may be required.
- I. All headwalls shall be constructed of reinforced concrete.
- J. Plastic pipe is prohibited for use as a culvert pipe material in the public right-of-way.
- K. Corrugated metal pipe will not be allowed in the public right-of-way except beneath driveways.

9.2 Bridge Design Criteria

Design criteria for all bridges shall be on a case-by-case basis as determined by the City Engineer.


9.3 Culvert Design Criteria

- A. Headwalls and necessary erosion protection shall be provided at all culverts and shall comply with TxDOT standard details. All culverts and bridges are to be analyzed at both the design flow and 100-year check flow.
- B. Alignment, location and grade of proposed culverts must be consistent with planned development of the drainage system for that watershed. In the event the particular watershed or waterway is not covered by a planned storm drainage system, the designer should proceed with the design from the nearest downstream control (i.e. bridge, culvert dam, etc.) and design the proposed drainage system improvements anticipating future system expansion due to fully developed watershed conditions.
- C. Wingwalls, if used, may be either straight parallel, flared, or tapered. Approach and discharge aprons shall be provided for all culvert headwall designs. Precast headwalls and end walls may be used if all other criteria are satisfied.

9.4 Culvert End Treatments

Figure 9-1 shows sketches of various end treatment types. The TxDOT Bridge Division maintains standard details of culvert end treatments. Safety End Treatment (SET) of a culvert provides a method of mitigating a less safe condition with-out interfering with the hydraulic function of the culvert. SETs such as those used with driveway and other small diameter culverts may be more hydraulically efficient by providing both tapered wingwalls and a beveled edge instead of using a mitered section. SETs for larger culverts that are not protected by a railing or guard fence use pipe runners arranged either horizontally or vertically.

Figure 9-1: Typical Culvert End Treatments

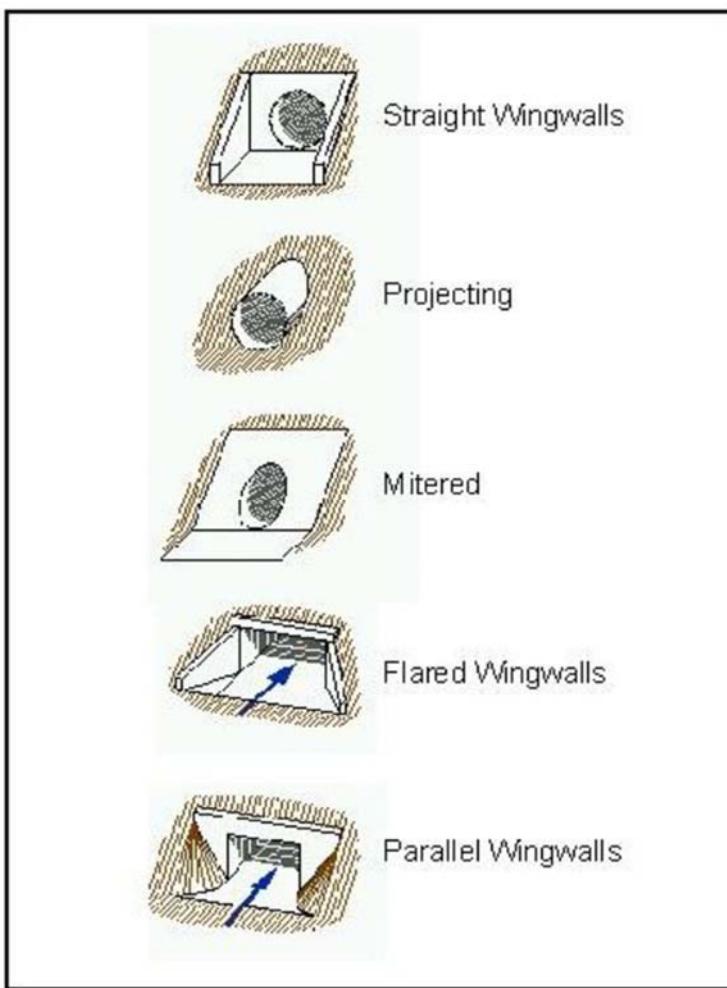

Source: *TxDOT HDM* [4]

The pipes of pipe runner SETs have been proven to be within the tolerance of the entrance loss equations. Therefore, the entrance should be evaluated solely for its shape and the effect of the pipes should be ignored.

9.5 Culvert Hydraulics

The hydraulic design of culverts shall be based upon design guidelines set forth by TxDOT, the U.S. Department of Transportation, or other suitable material as approved by the City Engineer. Computer programs such as FHWA's "HY-8" may be used, provided that the design engineer provides output tables showing models results and input data.

Values of entrance loss coefficients (C_e) are shown in Table 9-1 based on culvert shape and entrance condition.

Table 9-1: Entrance Loss Coefficients

Concrete Pipe	C _e
Projecting from fill, socket end (groove end)	0.2
Projecting from fill, square cut end	0.5
<i>Headwall or headwall and wingwalls:</i>	-
• Socket end of pipe (groove end)	0.2
• Square-edge	0.5
• Rounded (radius 1/12 D)	0.2
Mitered to conform to fill slope	0.7
End section conforming to fill slope	0.5
Beveled edges, 33.7° or 45° bevels	0.2
Side- or slope-tapered inlet	0.2
Corrugated Metal Pipe or Pipe Arch	-
Projecting from fill (no headwall)	0.9
Headwall or headwall and wingwalls square-edge	0.5
Mitered to conform to fill slope, paved or unpaved slope	0.7
End section conforming to fill slope	0.5
Beveled edges, 33.7° or 45° bevels	0.2
Side- or slope-tapered inlet	0.2
Reinforced Concrete Box	-
<i>Headwall parallel to embankment (no wingwalls):</i>	-
• Square-edged on 3 edges	0.5
• Rounded on 3 edges to radius of 1/12 barrel dimension, or beveled edges on 3 sides	0.2
<i>Wingwalls at 30° to 75° to barrel:</i>	-
• Square-edged at crown	0.4
• Crown edge rounded to radius of 1/12 barrel dimension, or beveled top edge	0.2
Wingwall at 10° to 25° to barrel: square-edged at crown	0.5
Wingwalls parallel (extension of sides): square-edged at crown	0.7
Side- or slope-tapered inlet	0.2

Source: *TxDOT HDM* [4]

There are two categories of flow through culverts: inlet control and outlet control.

1. **Inlet Control.** The flow is controlled by the cross-sectional area of the culvert, inlet configuration, and headwater depth. Slope, roughness and length of culvert are of no importance. Nomographs are available for inlet control estimations as proved in Hydraulic Design of Highway Culverts [13].
2. **Outlet control.** The flow is controlled by the cross-section area of the culvert, inlet configuration, and headwater depth and, slope, roughness and length of culvert. Culverts will be outlet controlled if the culvert slope is relatively flat, the tailwater sufficiently deep or the culvert is quite long. It is also possible, where the water enters the culvert under inlet control, but the culvert slope or tailwater conditions cause a hydraulic jump near the outlet. This situation should be avoided because damage can occur to the culvert pipe. Unstable conditions are most likely when the culvert is placed at a near-critical slope.

The design engineer shall calculate both outlet and inlet control conditions and use the more conservative of the two as the design condition.

9.6 Debris Fins

For conditions where more than one box culvert is required, the upstream face of the structure may incorporate debris deflector fins to prevent debris buildup. For multiple-pipe, or single box in critical situations, installations of debris fins may be used but are not required unless the Engineering Division requires upon review of the design situation. The engineer of record should analyze the situation for the applicability of debris fins.

The debris fin is an extension of the interior walls of a multiple-box culvert. The wall thickness shall be designed to satisfy structural requirements and reduce impact and turbulence to the flow.

A debris fin is constructed to the height of the culvert with a fin length of one and one-half times the height of the box culvert. Since the debris fins are subject to the same erosive forces as bridge piers, care must be taken in the design of the footing. A reinforced toewall at the upstream end of the debris fin and the apron is required. The reinforced toewall shall include a toe that extends a minimum of twenty-four inches into the ground.

9.7 Culvert Outlet Protection

High discharge velocities from culverts can cause eddies or other turbulence which could damage unprotected downstream channel banks and roadway embankments. To prevent damage from scour and erosion in these conditions, culvert outlet protection is needed. The outlet protection should extend downstream to a point where non-erosive channel velocities or shear stress are established in accordance with **Section 8.10** of this manual. The outlet protection should be placed sufficiently high on the adjacent banks to extend 1' above the design WSEL. All outlet protection shall be designed with an appropriate toe depth. All toes shall be no less than twenty-four inches.

9.8 Energy Dissipation

Design of riprap stone protection shall be done in accordance to *HEC 22*. Design of concrete baffles and stilling basins shall be done in accordance with *HEC 14*.

This page intentionally left blank.

10 Detention and Retention Facilities

10.1 General Requirements

Detention is the storage of runoff for a controlled release during or immediately following a design storm. Retention is an artificial pond with used for flood protection, water quality or aesthetic improvement.

- A. The method(s) of retention or detention shall be appropriate to the type of development, topography, and amount of control needed. Examples of methods include, but are not limited to, the following:
 - 1. Basins or swales – single or multiple
 - 2. Check dams in gullies to slow runoff and trap sediment
 - 3. Leach fields, infiltration chambers, dry wells, rain barrels, French drains
 - 4. Granular fill under permeable paving blocks
 - 5. Contour terracing, improved vegetation cover
- B. Parking areas may be used as detention facilities provided that maximum depths of ponding do not exceed eight inches, and ponding is in the areas most remotely situated from structures.
- C. Stormwater infiltration systems are not permitted for mitigation in any development where there is a potential for pollutants to adversely affect ground water quality (e.g. Edwards Aquifer Recharge Zone).
- D. No detention or retention basin shall retain standing water longer than 36 hours unless it is designed and constructed to be a permanent pond with appropriate health, safety and water quality measures. Permanent ponds must comply with all applicable water rights requirements for such a body of water.
- E. Detention basins to be excavated shall provide positive drainage through the pond. A concrete pilot channel shall be provided to convey runoff from entry points of concentrated flow into the pond to the outlet structure of the pond during low flow conditions. The minimum longitudinal slope of the concrete pilot channel shall be 0.25% and the minimum slope to the pilot channel shall be 0.5%. Erosion protection must be provided adjacent to the pilot channel to prevent undermining of the pilot channel due to scour.
- F. Facilities shall be located such that the edge of the 100-year water surface is at least 10 feet from the pavement edge of any public road. Finished floors of adjacent structures should be a minimum of 1 foot above the 100-year water surface in the facility. Facilities should preferably be located such that the invert of the outlet structure is above the 100-year flood level in the receiving body; but in all cases facilities shall be designed to function properly during conditions where the outlet is submerged by the tailwater of the receiving stream.
- G. Drainage easements are required for retention/detention facilities. Easement boundaries shall contain the berms, inlet and outlet structures, access ramps, permanent erosion control facilities, the 100-year water surface and any additional area needed for access and maintenance.
- H. Ponding below natural grade (depressed storage) is allowed.

- I. Detention facilities shall be designed with one or more outlet structures to allow safe passage of the 100-year post-development design storm runoff. If an overflow weir is not incorporated into the design of the outlet structure, then an emergency overflow weir or spillway shall be provided with sufficient capacity to pass at least the 25-year design storm runoff, assuming the pond is full and the discharge pipe in the outfall structure is 100% clogged. At minimum, the emergency overflow weir should engage when ponding exceeds the 100-year water surface elevation.
- J. Weirs, spillways and outlets shall be protected from erosion with riprap, grouted riprap, or other method of erosion control to adequately protect the structure and downstream channel. Outflows shall be conveyed within proposed property limits to an appropriate receiving drainage facility in a manner such that roadways, private property, buildings, etc. are not damaged.
- K. Best management practices shall be used in the event a detention facility empties into another storage facility downstream. The timing of the hydrograph from the detention facility shall be checked against the timing of the receiving storage facility to prevent any increase in the flow rate from the downstream facility.
- L. Side slopes of earthen embankments shall be designed for stability and safety, with the following minimum requirements for facilities with unrestricted access: side slopes of earthen banks shall be 3:1 or flatter; a benched configuration is required for facilities with ponding depths over 6 feet. Bench widths shall be at least 4 feet, spaced at least every 3 feet vertically. The above slope criteria may be waived if security barriers are provided. Barriers may consist of chain-link, masonry, wood, vegetation or other materials, but must not restrict the hydraulic capacity of drainage facilities. Minimum barrier height is 48". Vegetative barriers must be of a width equal to or greater than the greatest interior embankment height/depth, with density sufficient to restrict access. All constructed stormwater structures of earthen material shall be re-vegetated to mature growth.
- M. Maximum water depths over 6 feet shall not be allowed without prior approval from the City Engineer. Any detention facility that is classified as a dam by the State of Texas shall conform to the more stringent of rules listed in this manual or the dam safety rules adopted by the State of Texas.
- N. Earthen embankments of a height greater than 3 feet used to impound a required detention volume must have a minimum top-width of 4 feet, shall contain a non-permeable core, and shall be based on a geotechnical investigation for the site. Compaction of all earthen drainage structures shall be to 90% standard proctor.
- O. A maintenance ramp shall be provided for vehicular access in detention basin design for periodic de-silting and debris removal. The slope of the ramp shall not exceed 6:1 and the minimum width shall be 12 feet.
- P. Basins with permanent storage must include dewatering facilities to provide for maintenance.
- Q. The design of detention facilities shall include provisions for collecting and removing sediment deposited after collecting and releasing stormwater.
- R. Detention ponds and reservoirs shall provide at least 1-foot of freeboard for the 100-year storm event measured from top of berm to the 100-year water surface elevation of the pond.

10.2 Design Criteria

- A. Stormwater detention basins are used to temporarily impound (detain) excess stormwater, thereby reducing peak discharge rates.
- B. All detention ponds are to be designed to prevent an increase in flow to the existing 2, 10, 25, and 100-year peak runoff leaving a proposed site.
- C. Detention ponds will be sized using the NRCS synthetic hydrograph as outlined in **Section 4** of this manual.

10.3 Outlet Structure Design

- A. Multi-level outlet structures may be necessary to reduce the 2, 10, 25 and 100-year developed design storm runoff to pre-development levels. See publication *Stormwater Detention Outlet Control Structures* [14] for further outlet design and construction guidance not presented below.
- B. Documentation on retention or detention structures should include design hydrographs, calculation of stage-storage-discharge tables, drawings of the basin, spillway, weir and outlet size and location, and erosion control measures.
- C. Development of a composite stage-discharge curve requires consideration of the discharge rating relationships for each component of the outlet structure. The following sections are design relationships for typical outlet controls summarized from *HEC 22*.

10.3.1 Orifices

For a single orifice as illustrated in Figure 10-1 (a), orifice flow can be determined using Equation 10-1.

Equation 10-1

$$Q = C_o A_o (2gH_o)^{0.5}$$

Where:

Q = Orifice flow rate (cfs)


C_o = Discharge coefficient 0.40 – 0.60

A_o = Area of orifice (ft^2)

H_o = Effective head on the orifice measured from the centroid of the opening (ft)

g = Gravitational acceleration = 32.2 ft/s^2 .

Figure 10-1: Definition Sketch for Orifice Flow

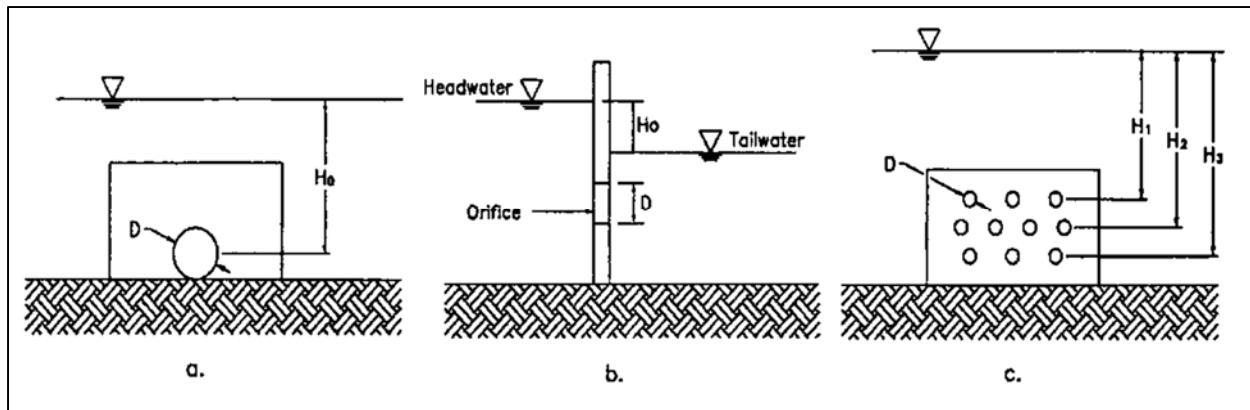

Source: HEC 22 [5]

If the orifice discharges as a free outfall, then the effective head is measured from the centerline of the orifice to the upstream water surface elevation. If the orifice discharge is submerged, then the effective head is the difference in elevation of the upstream and downstream water surfaces. This latter condition of a submerged discharge is shown in Figure 10-1(b).

For square-edged, uniform orifice entrance conditions, a discharge coefficient of 0.6 should be used. For ragged edged orifices, such as those resulting from the use of an acetylene torch to cut orifice openings in corrugated pipe, a value of 0.4 should be used.

For circular orifices with C_o set equal to 0.6, the following equation results:

Equation 10-2

$$Q = K_{or} D^2 H_o^{0.50}$$

Where:

$K_{or} = 3.78$ (English units)

D = Orifice diameter (ft).

Pipes smaller than 1 foot in diameter may be analyzed as a submerged orifice as long as H_o/D is greater than 1.5. Pipes greater than 1 foot in diameter should be analyzed as a discharge pipe with headwater and tailwater effects taken into account, not just as an orifice.

Flow through multiple orifices (see Figure 10-1 (c)) can be computed by summing the flow through individual orifices. For multiple orifices of the same size and under the influence of the same effective head, the total flow can be determined by multiplying the discharge for a single orifice by the number of openings.

10.3.2 Weirs

Relationships for sharp-crested, broad-crested, V-notch, and proportional weirs are provided in the following sections.

10.3.2.1 Sharp Crested Weirs

Typical sharp crested weirs are illustrated in Figure 10-2. Equation 10-3 provides the discharge relationship for sharp crested weirs with no end contractions (illustrated in Figure 10-2 (a)).

Equation 10-3

$$Q = C_{scw} L H^{1.5}$$

Where:

Q = Discharge (cfs)

L = Horizontal weir length (ft)


H = Head above weir crest excluding velocity head (ft)

$$C_{scw} = 3.27 + 0.4 (H/H_c)$$

As indicated above, the value of the coefficient C_{scw} is known to vary with the ratio H/H_c (see Figure 10-2 (c) for definition of terms). For values of the ratio H/H_c less than 0.3, a constant C_{scw} of 3.33 (in English units) is often used.

Equation 10-4 provides the discharge equation for sharp-crested weirs with end contractions (illustrated in Figure 10-2 (b)). As indicated above, the value of the coefficient C_{scw} is known to vary with the ratio H/H_c (see Figure 10-2 (c) for definition of terms). For values of the ratio H/H_c less than 0.3, a constant C_{scw} of 3.33 (in English units) is often used.

Figure 10-2: Sharp Crested Weirs

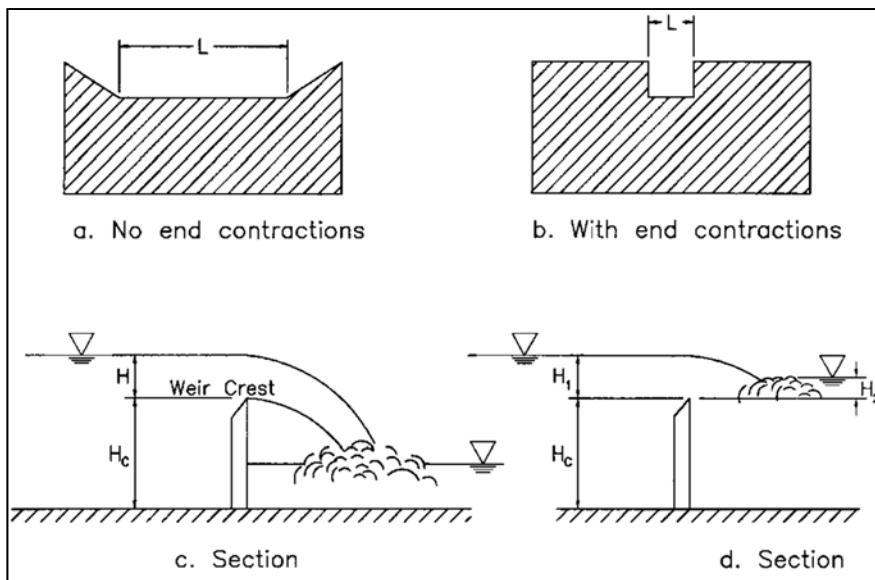

Source: HEC 22 [5]

Equation 10-4

$$Q = C_{scw}(L - 0.2H)H^{1.5}$$

Sharp crested weirs will be effected by submergence when the tailwater rises above the weir crest elevation, as shown in Figure 10-2 (d). The result will be that the discharge over the weir will be reduced. The discharge equation for a submerged sharp-crested weir is:

Equation 10-5

$$Q_s = Q_r \left(1 - \left(\frac{H_2}{H_1} \right)^{1.5} \right)^{0.385}$$

Where:

Q_s = Submerged flow (cfs)

Q_r = Unsubmerged weir flow from Equation 10-3 or Equation 10-4 (cfs)

H_1 = Upstream head above crest (ft)

H_2 = Downstream head above crest (ft).

Flow over the top edge of a riser pipe is typically treated as flow over a sharp crested weir with no end constrictions. Equation 10-3 should be used for this case.

10.3.2.2 Broad-Crested Weir

The equation typically used for a broad-crested weir is:

Equation 10-6

$$Q = C_{BCW} L H^{1.5}$$

Where:

Q = Discharge, (ft^3/s)

C_{BCW} = Broad-crested weir coefficient, 2.34 to 3.32 (English units)

L = Broad-Crested weir length, (ft)

H = Head above weir crest (ft).

If the upstream edge of a broad-crested weir is so rounded as to prevent contraction and if the slope of the crest is as great as the loss of head due to friction, flow will pass through critical depth at the weir crest; this gives the maximum C value of 3.09 (in English units). For sharp corners on the broad crested weir, a minimum value of 2.62 (in English units) should be used. Additional information on C values as a function of weir crest breadth and head is given in Table 10-1.

Table 10-1: English Units-Broad-Crested Weir Coefficient C Values as a Function of Weir Crest

Broad-Crested Weir Coefficient C Values as a Function of Weir Crest Breadth and Head (coefficient has units of ft 0.5/sec) ⁽¹⁾											
Head ⁽²⁾ (ft)	Breadth of Crest of Weir (ft)										
	0.5	0.75	1	1.5	2	2.5	3	4	5	10	15
0.2	2.8	2.75	2.69	2.62	2.54	2.48	2.44	2.38	2.34	2.49	2.68
0.4	2.92	2.8	2.72	2.64	2.61	2.6	2.58	2.54	2.5	2.56	2.7
0.6	3.08	2.89	2.75	2.64	2.61	2.6	2.68	2.69	2.7	2.7	2.7
0.8	3.3	3.04	2.85	2.68	2.6	2.6	2.67	2.68	2.68	2.69	2.64
1	3.32	3.14	2.98	2.75	2.66	2.64	2.65	2.67	2.68	2.68	2.63
1.2	3.32	3.2	3.08	2.86	2.7	2.65	2.64	2.67	2.66	2.69	2.64
1.4	3.32	3.26	3.2	2.92	2.77	2.68	2.64	2.65	2.65	2.67	2.64
1.6	3.32	3.29	3.28	3.07	2.89	2.75	2.68	2.66	2.65	2.64	2.63
1.8	3.32	3.32	3.31	3.07	2.88	2.74	2.68	2.66	2.65	2.64	2.63
2	3.32	3.31	3.3	3.03	2.85	2.76	2.72	2.68	2.65	2.64	2.63
2.5	3.32	3.32	3.31	3.28	3.07	2.89	2.81	2.72	2.67	2.64	2.63
3	3.32	3.32	3.32	3.32	3.2	3.05	2.92	2.73	2.66	2.64	2.63
3.5	3.32	3.32	3.32	3.32	3.32	3.19	2.97	2.76	2.68	2.64	2.63
4	3.32	3.32	3.32	3.32	3.32	3.32	3.07	2.79	2.7	2.64	2.63
4.5	3.32	3.32	3.32	3.32	3.32	3.32	3.32	2.88	2.74	2.64	2.63
5	3.32	3.32	3.32	3.32	3.32	3.32	3.32	3.07	2.79	2.64	2.63
5.5	3.32	3.32	3.32	3.32	3.32	3.32	3.32	3.32	2.88	2.64	2.63
Source: Brater, E.F. and King, H.W., <u>Handbook of Hydraulics</u> , 6th ed., 1976 [15]											
Measured at least 2.5 Hc upstream of the weir											

10.3.2.3 V-Notch Weir

The discharge through a v-notch weir is shown in Figure 10-3 and can be calculated from the following equation:

Equation 10-7

$$Q = K_u [\tan(\theta/2)] H^{2.5}$$

Where:


Q = Discharge (cfs)

θ = Angle of v-notch (degrees)

H = Head on apex of v-notch (ft)

$K_u = 2.5$ (English units).

Figure 10-3: V-Notch Weir

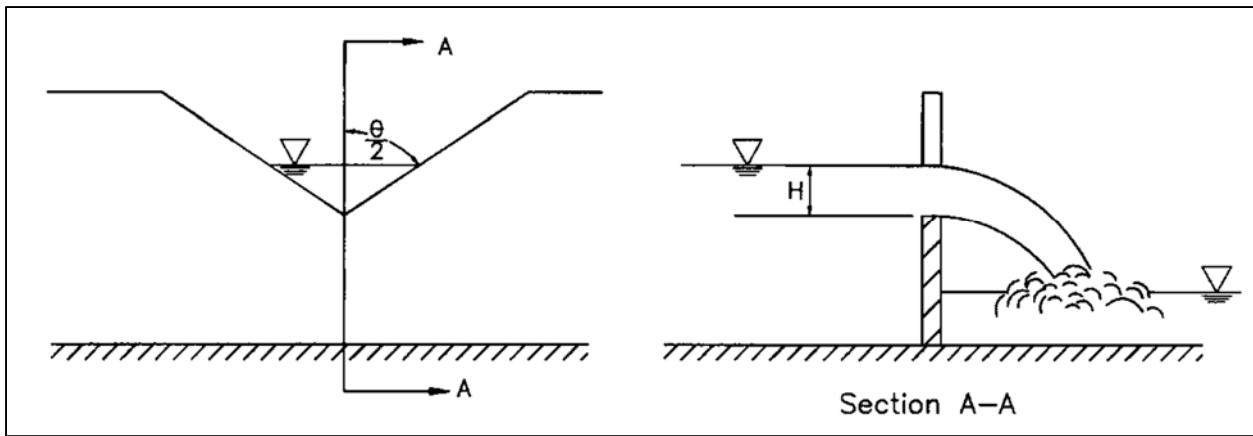

Source: HEC 22 [5]

10.3.2.4 Proportional Weir

Although more complex to design and construct, a proportional weir may significantly reduce the required storage volume for a given site. The proportional weir is distinguished from other control devices by having a linear head-discharge relationship. This relationship is achieved by allowing the discharge area to vary nonlinearly with head. Design equations for proportional weirs are as follows: [16]

Equation 10-8

$$Q = K_u a^{0.5} b (H - a/3)$$

Where:


$K_u = 4.96$ (English units)

Q = Discharge (cfs)

H = Head above horizontal sill (ft).

Dimensions a , b , x , and y are shown in Figure 10-4.

Figure 10-4: Proportional Weir Dimensions

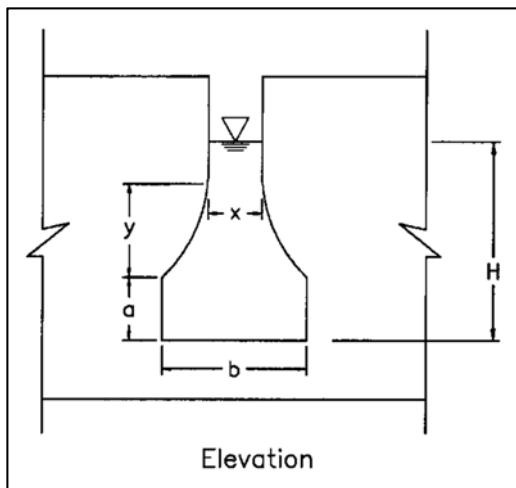

Source: HEC 22 [5]

10.3.3 Discharge Pipes

Discharge pipes are often used as outlet structures for detention facilities. The design of these pipes can be for either single or multistage discharges. A single step discharge system would consist of a single culvert entrance system and would not be designed to carry emergency flows. A multistage inlet would involve the placement of a control structure at the inlet end of the pipe.

For single stage systems, the facility would be designed as if it were a simple culvert. Downstream boundary conditions are to be applied in the same manner as discussed in **Section 9** of this manual. A stage-discharge curve would be developed for the full range of flows that the structure would experience.

For multistage control structures, the inlet control structure would be designed considering the full range of flows. A stage-discharge curve would be developed for the full range of flows that the structure would experience. The design flows will typically be orifice flow through whatever shape the designer has chosen while the higher flows will typically be weir flow over the top of the control structure.


Orifices can be designed using the equations in **Section 10.3.1** and weirs can be designed using the equations in **Section 10.3.2**. The pipe must be designed to carry all flows considered in the design of the control structure.

In designing a multistage structure, the designer would first develop peak discharges that must be passed through the facility. The second step would be to select a pipe that will pass the peak flow within the allowable headwater and develop a performance curve for the pipe. Thirdly, the designer would develop a stage-discharge curve for the inlet control structure, recognizing that the headwater for the discharge pipe will be the tailwater that needs to be considered in designing the inlet structure. Last, the designer would use the stage-discharge curve in the basin routing procedure.

10.3.4 Emergency Overflow Weirs

The purpose of an emergency overflow weir is to provide a controlled relief for storm flows in excess of the design discharge for the storage facility. An emergency overflow weir usually has a trapezoidal cross-section for ease of construction. Emergency overflow weirs that do not incorporate a spillway, comparable to the illustration in Figure 10-5, should be treated as a broad-crested weir. Spillway design should use the following equations.

Figure 10-5: Emergency Spillway Design Schematic

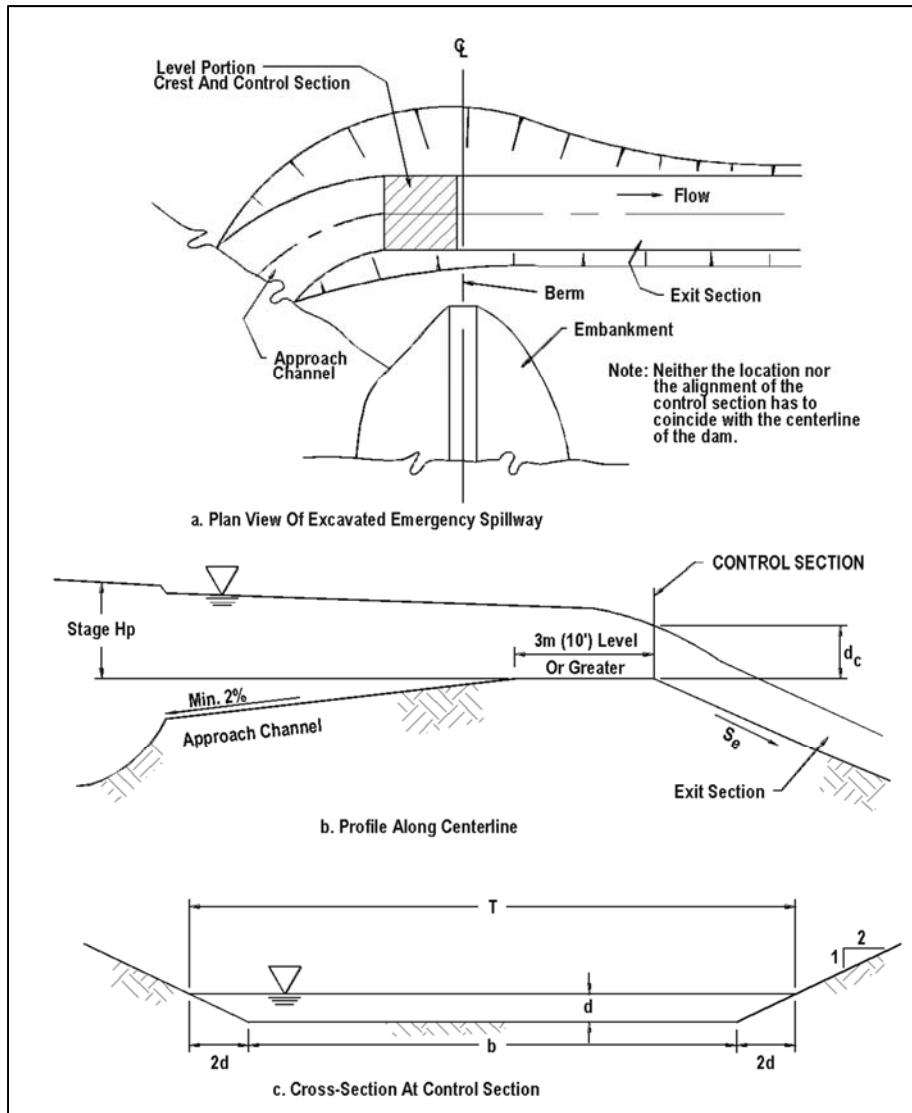

Source: HEC 22 [5]

Equation 10-9 presents a relationship for computing the flow through a broad-crested emergency spillway. The dimensional terms in the equation are illustrated in Figure 10-5.

Equation 10-9

$$Q = C_{SP} b H_P^{1.5}$$

Where:

Q = Emergency spillway discharge (cfs)


C_{SP} = Discharge coefficient

b = Width of the emergency spillway (ft)

H_P = Effective head on the emergency spillway (ft).

The discharge coefficient, C_{SP} , in Equation 10-9 varies as a function of spillway bottom width and effective head. Figure 10-6 illustrates this relationship. Table 10-2 (modified from USDA, 1969) provides a tabulation of emergency spillway design parameters.

Figure 10-6: Discharge Coefficients for Emergency Spillways, English Units

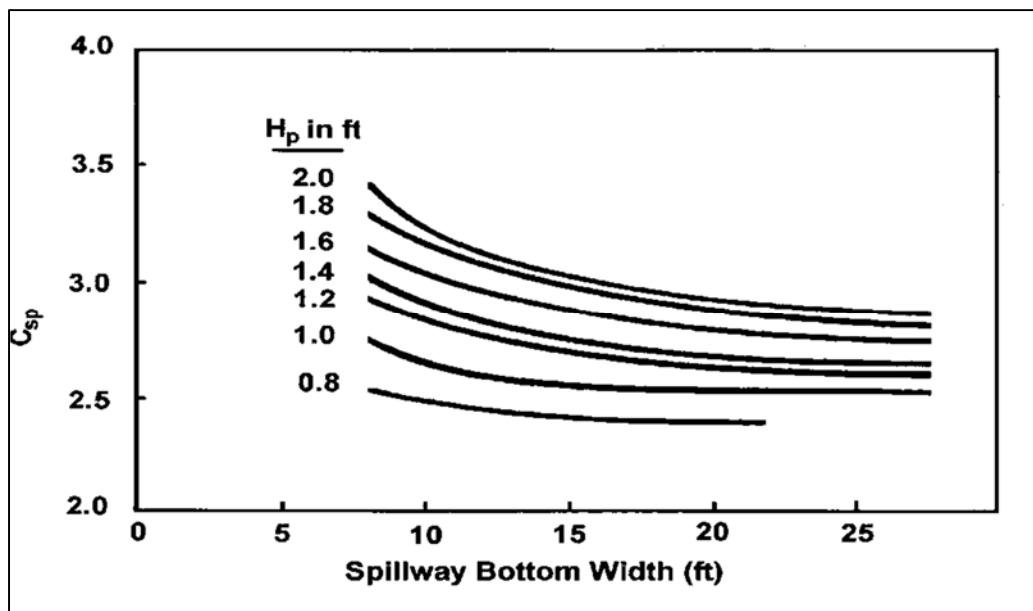

Source: HEC 22 [5]

The critical slopes of Table 10-2 are based upon an assumed $n = 0.040$ for turf cover of the spillway. For a paved spillway, the n should be assumed as 0.015. Equation 10-10 and Equation 10-11 can be used to compute the critical velocity and slope for spillway materials having other roughness values.

Equation 10-10

$$V_c = K_{SP}(Q/b)^{0.33}$$

Where:

V_c = Critical velocity at emergency spillway control section (ft/s)

Q = Emergency spillway discharge (cfs)

b = Width of the emergency spillway (ft)

K_{SP} = 3.18 (English units).

Equation 10-11

$$S_c = K'_{SP}n^2[(V_c b)/Q]^{0.33}$$

Where:

S_c = Critical slope (ft/ft)

n = Manning's coefficient

V_c = Critical velocity at emergency spillway control section (ft/s)

Q = Emergency spillway discharge (cfs)

b = Width of the emergency spillway (ft)

K'_{SP} = 14.6 (English units).

Table 10-2: Emergency Spillway Design Parameters (English units)

H_p (ft)		Spillway Bottom Width, b , (ft)											
		8	10	12	14	16	18	20	22	24	26	28	30
0.8	Q	14	18	21	24	28	32	35	-	-	-	-	-
	V_c	3.6	3.6	3.6	3.7	3.7	3.7	3.7	-	-	-	-	-
	S_c	3.2	3.2	3.2	3.2	3.1	3.1	3.1	-	-	-	-	-
1	Q	22	26	31	36	41	46	51	56	61	66	70	75
	V_c	4.1	4.1	4.1	4.1	4.1	4.1	4.2	4.2	4.2	4.2	4.2	4.2
	S_c	3	3	3	3	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9
1.2	Q	31	37	44	50	56	63	70	76	82	88	95	101
	V_c	4.5	4.5	4.5	4.6	4.6	4.6	4.6	4.7	4.6	4.6	4.6	4.6
	S_c	2.8	2.8	2.8	2.8	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.6
1.4	Q	40	48	56	65	73	81	90	98	105	113	122	131
	V_c	4.9	4.9	4.9	4.9	5	5	5	5	5	5	5	5
	S_c	2.7	2.7	2.6	2.6	2.6	2.6	2.6	2.6	2.6	2.6	2.6	2.6
1.6	Q	51	62	72	82	92	103	113	123	134	145	155	165
	V_c	5.2	5.2	5.3	5.3	5.3	5.3	5.3	5.4	5.4	5.4	5.4	5.4
	S_c	2.6	2.6	2.6	2.6	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.4
1.8	Q	64	76	89	102	115	127	140	152	164	176	188	200
	V_c	5.5	5.5	5.6	5.6	5.6	5.7	5.7	5.7	5.7	5.7	5.7	5.7
	S_c	2.5	2.5	2.5	2.4	2.4	2.4	2.4	2.4	2.4	2.3	2.3	2.3
2	Q	78	91	106	122	137	152	167	181	196	211	225	240
	V_c	5.8	5.8	5.8	5.9	6	6	6	6	6	6	6	6
	S_c	2.5	2.4	2.4	2.4	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3

NOTE:

1. For a given H_p , decreasing exit slope from S_c decreases spillway discharge, but increasing exit slope from S_c does not increase discharge.
2. If a slope S_e steeper than S_c is used, velocity V_e in the exit channel will increase according to the following relationship: $V_e = V_c(S_e/S_c)^{0.3}$
3. After Maryland SCS

Source: HEC 22 [5]

This page intentionally left blank.

11 Lakes, Dams and Levees

11.1 Lakes and Dams

11.1.1 General Requirements

In the event that a property owner or developer desires to modify an existing pond or lake or desires to impound stormwater by filling or constructing an aboveground dam, thereby creating a lake, pond, lagoon or basin as part of the planned development of that property, the criteria listed below shall be met before city approval of the impoundment can be given. Ponds or lakes created by excavation of a channel area without erecting a dam above natural ground elevation or instream low water check dams are also subject to the criteria listed below, with the exception of spillway capacity requirements. The City Engineer has the final authority to determine the design criteria for a proposed dam, check dam or excavated lake. The dam safety requirements of the Texas Commission on Environmental Quality (TCEQ) and Federal Emergency Management Agency (FEMA) must also be met for the construction of dams, lakes, and other improvements.

11.1.2 Dam Design Criteria

- A. The design criteria for a dam are dependent on the size and hazard classification of the dam. The size and hazard classification will be based on the recommended guidelines adopted by the TCEQ under Texas Water Code 12.052, which provides for the safe construction, maintenance, repair and removal of dams located in the State of Texas, and will be determined by the City Engineer based on information furnished by the owner. The following criteria will be used to classify a dam:
 1. Size. The classification for size is based on the height of the dam and storage capacity, whichever gives the larger size category. "Height" is defined as the distance between the top of the dam (minus the freeboard) and the existing streambed at the downstream toe. Storage is defined as the maximum water volume impounded at the top of the dam (minus the freeboard).
 2. Hazard potential. The hazard potential for a dam is based on the potential for loss of human life and property damage downstream from a dam in the event of failure. Hazard Potential Classifications are based on the potential for loss of life and for the extent of economic loss based on existing and potential development downstream of the dam.
 3. Spillway Design Flood. The classification of a dam based on the above criteria will be used to determine the Spillway Design Flood (SDF). The total capacity of a dam structure, including principal and emergency spillways, shall be adequate to pass the SDF without exceeding the top dam elevation. The SDF's for various dam classifications are described by TCEQ Dam Safety Guidelines.
- B. All design will be for the fully developed watershed contributing to the structure.
- C. In all cases, the minimum principal spillway design capacity is a minimum of the 100-year design flood. In certain cases, a dam breach analysis may be required to determine the proper classification of the structure. For all structures requiring a spillway design flood equal to the Probable Maximum Flood (PMF), a dam breach analysis is required to determine the downstream consequences of a failure. All dams shall be constructed with a minimum freeboard of two feet

above SDF elevation and upstream development within the contour line determined by the emergency spillway crest elevation plus 2-feet, or the 100-year flood elevation (based on fully developed watershed conditions) plus 2-feet, whichever is greater.

D. Owners of significant and high hazard dams were required to submit an Emergency Action Plan in accordance with Title 30 Texas Administrative Code (TAC) Chapter 299, Dams and Reservoirs, §299.61(b).

11.1.3 Maintenance and Liability Criteria

The owner or developer shall retain their private ownership of the constructed lake, pond or lagoon or basin and shall assume full responsibility for the protection of the general public from any health or safety hazards related to the lake, pond or lagoon constructed. The owner or developer shall assume full responsibility for the maintenance of the lake, pond or lagoon or basin constructed. The owner or developer shall keep TCEQ advised of the currently responsible agent for this maintenance. All dams are required to be registered with TCEQ in accordance with the TCEQ Dam Safety Regulations.

11.1.4 Natural Resource Conservation Service Lakes

A. There are a number of NRCS (previously Soil Conservation Service) lakes within the City limits and extraterritorial jurisdiction of the City of New Braunfels. These lakes present complex issues of flood control, erosion control, maintenance, and floodplain management. These lakes were constructed to NRCS standards. The lakes are in private ownership, with maintenance provided by Comal County. Operation of the lakes is the responsibility of Comal County. The City of New Braunfels is responsible for floodplain management of those areas upstream, downstream and adjacent to the lakes. Operation and maintenance of the NRCS lakes shall remain the responsibility of others.

B. The City of New Braunfels shall control future development upstream, downstream and adjacent to all NRCS lakes. Planning for future development which impacts on, or is impacted by, NRCS lakes shall require that a detailed engineering study be performed to provide a technical basis for development and that the dam be upgraded as follows:

1. Provide principal spillway capacity adequate to discharge the 100-year flood event based on fully developed watershed conditions.
2. Provide total capacity of the dam structure, including principal and emergency spillways to accommodate the PMF.
3. Manage existing flood storage capacity.
4. Prohibit upstream development within the contour line determined by the emergency spillway crest elevation plus 2-feet, or the 100-year flood elevation (based on fully developed watershed conditions) plus 2-feet, whichever is greater.
5. Restrict development and improvements within the floodplain established by a breach flow analysis from the dam to the downstream limits of the dam breach impact.

11.1.5 Additional Design Requirements

A. An engineering plan for such construction accomplished by complete drainage design information and sealed by a licensed professional engineer, shall be approved by the City of New Braunfels.

B. The spillway and any emergency overflow areas shall be located so that floodwaters will not inundate any permanent habitable structures.

- C. The minimum SDF should be the 100-year, 24-hour storm regardless of critical inflow design storm peaks.
- D. The design shall comply with all federal, state and county laws pertaining to the impoundment of surface water, including the design, construction, and safety of the impounding structure. Copies of any federal, state or county permits issued for proposed impoundments shall be submitted to the City Engineer.
- E. Any existing NRCS structure or other dams which are included in the project drainage area shall comply with the applicable federal, state, county and city safety requirements for structures. Improvements may be required to upgrade the structure to the currently adopted guidelines. Before removing, enlarging or altering any existing lake, the applicant will furnish a study of the effects of the alteration upon flooding conditions both upstream and downstream. The study shall be prepared by a professional engineer and submitted to the City Engineer for approval prior to making the proposed alteration.
- F. Any improvements to existing dams or lakes or construction of new impoundments shall be made at the expense of the developer, prior to completion of the adjacent street, utilities and drainage improvements, as provided for under the subdivision regulations.

11.2 Levees

In the event that developers or owners wish to build levees to protect an area from flooding, all applicable FEMA guidelines, State of Texas Dam Safety Guideline, and the following criteria apply:

- A. Levees shall be designed to have freeboard requirements as specified by FEMA.
- B. Levees shall be designed according to the Corps of Engineers' design criteria used for federally authorized levees, whether or not they are federally authorized.
- C. Ring levees shall not be permitted.
- D. If possible, provision shall be made to provide the permanent maintenance of levees either by a flood control district or similar governmental organization or by the existing property owner and all future owners, heirs or assigns, through the use of a maintenance agreement.
- E. Levee systems shall be designed with interior drainage system to prevent flooding from local runoff contained within the system for the 100-year design flood.
- F. Levee system shall have written operation procedures that address gate-closure conditions and an emergency warning plan. A copy of these procedures shall be furnished to the City Engineer.
- G. Automated gate-closure systems shall have power from two independent sources and shall be capable of being operated manually.
- H. All new levee systems shall have permanent positive closures to the required design elevation. Temporary closures involving sandbagging or other procedures requiring manual operations shall not be permitted.
- I. Additional plan requirements including water surface profiles for the design flood and standard project flood; the top of the levee profile, definition of interior drainage facilities, including pump station and ponding areas; location of gravity outlets, gatewells and closure structures; and elevation-duration data on the receiving system.

This page intentionally left blank.

12 Site Erosion Control During Construction

12.1 Applicable Properties or Construction Sites

Private property owners, developers or builders shall be accountable for any erosion of their property or construction site which results in measurable accumulation of sedimentation in dedicated streets, alleys, any waterway or other private properties. Any accumulation or deposit of soil material beyond the limits of the property or in City streets, alleys or drainage facilities in an amount sufficient to constitute a threat to public safety and comfort as determined by the City Engineer shall constitute a violation. Sediment carried by stormwater runoff through these acres shall be prevented from entering storm drain systems and natural watercourses.

12.2 General Guidelines for Erosion Control Plan

- A. Maximum use shall be made of vegetation to minimize soil loss. At a minimum, 70% established re-vegetation is required for residential subdivision developments that do not retain the natural vegetation. Vegetation measures should begin as soon as possible during construction in order to allow for establishment at construction termination.
- B. Natural vegetation should be retained wherever possible.
- C. Where inadequate natural vegetation exists or where it becomes necessary to remove existing natural vegetation, temporary controls should be installed promptly to minimize soil loss and ensure that erosion and sedimentation does not occur. The developer is responsible for maintenance of site erosion control devices until a sufficient vegetation cover has been provided or replaced as determined by the City Engineer. Periodic maintenance shall be performed by the developer to remove accumulated sediment that would otherwise inhibit the proper functioning of the erosion control devices. Storm Water Pollution Prevention Plans (SWPPP) are required to be maintained on all permitted construction sites at all times.
- D. During construction, erosion controls shall be used to slow drainage flow rate and prevent downstream sedimentation.
- E. Erosion control elements should be implemented as soon as practical in the development process.
- F. Waste or disposal areas and construction roads should be located and constructed in a manner that will minimize the amount of sediment entering streams.
- G. Frequent fording of live streams will not be permitted; therefore, temporary bridges or other structures shall be used wherever an appreciable number of crossings of a stream are necessary.
- H. When work areas or material sources are located in or adjacent to live streams, such areas shall be separated from the stream by a dike or other barrier to keep sediment from entering a flowing stream. Care shall be taken during the construction and removal of such barriers to minimize the sediment transport into a stream.
- I. Should preventative measures fail to function effectively, the applicant shall act immediately to bring the erosion and/or siltation under control by whatever additional means are necessary.
- J. Erosion control devices shall be placed to trap any losses from stockpiled topsoil. Some acceptable forms of site erosion control devices include, but are not limited to, silt fences, silt traps, geonetting and geotextiles. Hay bales are not permitted.

- K. The selection and timing of the installation of erosion controls shall be based upon weather and seasonal conditions that could make certain controls not practicable.
- L. Vegetation used for vegetative cover shall be suitable for local soil and weather conditions. Ground cover plants shall comply with listings from the Texas Agricultural Extension Service.
- M. Runoff shall be diverted away from construction areas as much as possible.
- N. Stripping of vegetation from project sites shall be phased so as to expose the minimum amount of area to soil erosion for the shortest possible period of time. Phasing shall also consider the varying requirements of an erosion control plan at different stages of construction and shall include the establishment of new vegetation or permanent erosion control measures.
- O. Developers, builders, or owners of property shall install all utilities, including franchise utilities, before final acceptance of a subdivision, property and/or structure. Final acceptance will also be contingent upon having all necessary erosion control measures installed to minimize off-site sediment. At the discretion of the City Engineer; a site may be accepted without erosion control measures if perennial vegetative cover is actively growing.
- P. SWPPP shall follow TCEQ rules.

12.3 Stream Bank Erosion

Erosion control will be provided along streams and drainage channels. Where bank stabilization or other erosion protection measures are required to protect streams and channels, the stream bank protection and erosion damage mitigation measures provided in this manual shall be utilized.

13 Water Quality Controls

13.1 Applicability

Permanent water quality controls for development located over Edwards Aquifer regulated zones shall comply with the latest Texas Commission on Environmental Quality (TCEQ) published rules and technical design guidance. Permanent water quality controls for new development outside of the Edwards Aquifer regulated zones shall meet the criteria in this manual if the following are met:

1. The development is located in the City's Jurisdiction; and,
2. The development is defined as Type 3; and,
3. The total impervious cover for the development will exceed 30% of the contiguous property as a result of the development.

13.2 Design Criteria

Permanent water quality best management practices (BMPs) shall be designed to provide adequate treatment of the water quality volume (WQV) in the City's Jurisdiction. The WQV is defined as the first one-half inch of runoff from all new impervious surfaces added to a site that does not replace existing impervious surfaces (Equation 13-1).

Equation 13-1

$$WQV \text{ (cubic feet)} = \frac{0.5 \text{ inches}}{12 \frac{\text{inch}}{\text{foot}}} \times (IC \text{ Area Post Construction} - IC \text{ Area Pre Construction})(\text{sq. ft.})$$

13.3 Treatment Methods

In order to provide adequate treatment, one of the following methods must be followed:

1. Detention Filtration: Detain the WQV in an earthen basin for at least 24 hours as described in this Section
2. Provide one or more BMPs that meet the requirements in TCEQ report publication RG-348 and/or subsequent addenda
3. Provide BMPs that are approved by the Engineering Division prior to submission of a development application.

The WQV may be reduced by applying for impervious cover credits and/or the use of Low Impact Development (LID) strategies. Impervious cover credits and LID strategies are defined in the City of New Braunfels LID Manual.

13.3.1 Detention Filtration

The following process determines detention filtration requirements:

1. Calculate the minimum extended detention volume using Equation 13-2. The water quality volume shall be increased by a safety factor of 20% to account for deposition of solids over time. A fixed vertical sediment depth marker shall be installed in the basin to indicate when sediment

accumulation meets or exceeds 20% of the water quality volume and sediment removal is required.

Equation 13-2

$$V = WQV * 1.2$$

2. The flow path from the inlet to the outlet of the extended detention basin should be twice as long as the width of the extended detention basin.
3. The 24-hour draw-down time should be achieved by installing the appropriate sized orifice on the outlet structure. No more than 50% of the extended detention volume shall drain from the facility within the first 12 hours. Outlet pipes shall be designed to prevent accumulated sediment from discharging from extended detention basin.
 - a. If perforated pipe is used, then the size of the perforations should not be used for draw-down time design purposes, and a filter should be installed to prevent the perforations from clogging.
 - b. If the discharge pipe extends through a concrete wall, then a sleeve is required in the wall, and a water proof sealant should be used to prevent leaks around the sleeve.
4. The extended detention basin may be installed offline from peak flow attenuating detention basins or incorporated into a detention basin

13.3.2 TCEQ Method

When a treatment method approved by TCEQ is utilized outside of the Edwards regulatory zones, the increase in TSS load resulting from all new impervious surfaces must be reduced by at least 70%. Calculation of the capture volume or minimum flow rate shall follow the method in the latest technical guidance on BMPs for the Edwards Aquifer Rules.

13.3.3 Alternative Methods

The Engineering Division prior to submitting a development application must approve all other methods. Alternative methods must show comparable treatment levels as the Detention Filtration or TCEQ Methods.

13.4 Maintenance

A maintenance schedule and plan for water quality controls shall be submitted to the Engineering Division prior to approval of construction plans. When included as part of a subdivided development, a maintenance bond shall be provided in accordance with Section 118-38 of the New Braunfels Code of Ordinances. Alternate methods may require additional monitoring and engineering studies to ensure compliance.

Appendix A: References

1. Asquith, W. H. (1998). Depth-Duration Frequency of Precipitation for Texas, US Geological Survey Water-Resources Investigations Report 98-4044, Austin, TX.
2. City of Austin. (2014). Drainage Criteria Manual, Austin, TX.
3. Natural Resources Conservation Service. (1986). Urban Hydrology for Small Watersheds – Technical Release 55, Washington, D.C.
4. Texas Department of Transportation. (2014). Hydraulic Design Manual, Austin, TX.
5. U.S. Department of Transportation, Federal Highway Administration. (2009). Urban Drainage Design Manual, Hydraulic Engineering Circular No. 22, 3rd Edition, Washington, D.C.
6. Izzard, C.F. (1946). Hydraulics of Runoff from Developed Surfaces, Proceedings of the Highway Research Board, Volume 26, pp. 129-150, Washington, D.C.
7. U.S. Department of Transportation, Federal Highway Administration. (1961). Design Charts for Open-Channel Flow, Hydraulic Design Series 3, Washington, D.C.
8. U.S. Department of Transportation, Federal Highway Administration. (1984). Drainage of Highway Pavements, Hydraulic Engineering Circular 12, Washington, D.C.
9. U.S. Department of Transportation, Federal Highway Administration. (2005). Design of Roadway Channels with Flexible Linings, Hydraulic Engineering Circular 15, 3rd Edition, Washington, D.C.
10. Chow, V.T. (1959) Open-Channel Hydraulics, McGraw-Hill, Inc., New York, NY.
11. American Association of State Highway and Transportation Officials. (2005). Chapter 13 Storm Drainage Systems, Model Drainage Manual, Third Edition, Washington, D.C.
12. U.S. Department of Transportation, Federal Highway Administration. (2006). Hydraulic Design of Energy Dissipaters for Culverts and Channels, Hydraulic Engineering Circular 14, 3rd Edition, Washington, D.C.
13. U.S. Department of Transportation, Federal Highway Administration. (2012). Hydraulic Design of Highway Culverts, Third Edition, Hydraulic Design Series Number 5, Washington, D.C.
14. Jones, J. (2006). Stormwater Detention Outlet Control Structures. Great Works on Urban Water Resources (1962-2001), pp. 857-887, ASCE, New York, NY.
15. Brater, E.F. and King, H.W. (1976). Handbook of Hydraulics, 6th Edition, McGraw Hill, Inc., New York, NY.
16. Sandvik, A. (1985). Proportional Weirs for Stormwater Pond Outlets, Civil Engineering, Vol. 55, No. 3, ASCE, New York, NY.

This page intentionally left blank.

Appendix B: Definition of Terms

Abstractions. The fractions of precipitation lost to evaporation, transpiration, interception, depression storage and infiltration.

Abutment. A wall supporting the end of a bridge or span, and sustaining the pressure of the abutting earth.

Apron. A floor or lining of concrete, timber, or other suitable material at the toe of a dam, entrance or discharge side of spillway, a chute, or other discharge structure, to protect the waterway from erosion from falling water or turbulent flow.

Backwater. The rise of the water level upstream due to an obstruction or constriction in the channel.

Backwater Curve. The term applied to the longitudinal profile of the water surface in an open channel when flow is steady but non uniform.

Baffle Chute. A drop structure in a channel with baffles for energy dissipation to permit the lowering of the hydraulic energy gradient in a short distance to accommodate topography.

Baffles. Deflector vanes, guides, grids, gratings, or similar devices constructed or placed in flowing water, to: (a) check or effect a more uniform distribution of velocities; (b) absorb energy; (c) divert, guide, or agitate the liquids; and (d) check eddy currents.

Base Flood. The flood having a one percent chance of being equaled or exceeded in any given year.

Calibration. Process of checking, adjusting, or standardizing operating characteristics of instruments and model appurtenances on a physical model or coefficients in a mathematical model. The process of evaluating the scale readings of an instrument in terms of the physical quantity to be measured.

Channel. Natural or engineered open waterway designed to convey stormwater runoff.

Channel Roughness. Irregularities in channel configuration which retard the flow of water and dissipate its energy.

Channel stability. A condition in which a channel neither degrades to the degree that structures, utilities or private property are endangered, nor aggrades to the degree that flow capacity is significantly diminished as a result of one or more storm runoff events or moves laterally to the degree that adjacent property is endangered.

Channel treatment measure. A physical alteration of a channel for any purpose.

Chute. An inclined conduit or structure used for conveying water to a lower level.

City Engineer. City of New Braunfels staff individual responsible for administration, processing and compliance with provisions of this Manual, or his/her designated representative.

Comprehensive plan. The City of New Braunfels Comprehensive Plan and amendments thereto.

Conduit. Any open or closed device for conveying flowing water.

Contaminants. Contaminating agents such as oil wastes, sewage, chemicals, etc.

Continuity. Continuity of flow exists between two sections of a pipe or channel when the same quantity of water passes the two cross sections and all intermediate cross sections at any one instant.

Critical Flow. The state of flow which exhibits the following characteristics: (a) the specific energy is a minimum for a given discharge; (b) the discharge is a maximum for a given specific energy; (c) the specific force is a minimum for a given discharge; (d) the velocity head is equal to half the hydraulic depth in a channel of small slope; (e) the Froude Number is equal to unity.

Crown. (a) The highest point on a transverse section of conduit; (b) the highest point of a roadway cross section.

Culvert. Large pipe or other conduit through which a stormwater flows under a road or street.

Curb. A vertical or sloping rim along the edge of a roadway, normally constructed integrally with the gutter, which strengthens and protects the pavement edge and clearly defines the pavement edge to vehicle operators.

Curb Inlet. A vertical opening in a curb through which the gutter flow passes. The gutter may be undepressed or depressed in the area of the curb opening.

Curb Split Dam. The elevation difference between curbs on opposite sides of a street.

Dam. A barrier constructed across a watercourse for the purposes of (a) creating a reservoir; (b) diverting water from a conduit or channel.

Degradation. The progressive general lowering of a stream channel by erosion.

Depression Storage. Collection and storage of rainfall in natural depressions (small puddles) after exceeding infiltration capacity of the soil.

Design Storm or Flood. The storm or flood which is used as the basis for design, i.e., against which the structure is designed to provide a stated degree of protection or other specified result.

Detention. The storage of storm runoff for a controlled release during or immediately following the design storm.

a. **Off site detention.** A detention pond located outside the boundary of the area it serves.

- b. **On site detention.** A detention pond which is located within and serves only a specific site or subdivision.
- c. **On stream detention.** Detention facilities provided to control excess runoff based on a watershed wide hydrologic analysis.

Developed land. Any lot or parcel of land occupied by any structure intended for human occupation, including structures intended for commercial or industrial enterprise.

Developer. Any individual, estate, trust, receiver, cooperative association, club, corporation, company, firm, partnership, joint venture, syndicate or other entity engaging in platting, subdivision, filling, grading, excavating, or construction of structures.

Ditch. Open waterway typically used to convey stormwater runoff alongside roadways.

Downstream capacity. The ability of downstream drainage facilities to accept and safely convey runoff generated upstream.

Drainage basin. The storm water catchment area above a point on a channel to which waters drain and collect. Watershed has the same meaning.

Drainage control. The treatment and/or management of surface runoff.

Drainage easement. A platted area reserved for the primary purpose of stormwater drainage and maintenance.

Drainage System. Drainage systems shall include streets, alleys, storm drains, drainage channels, culverts, bridges, overflow swales and any other facility through which or over which storm water flows.

Drop Inlet. A storm drain intake structure typically located in unpaved areas. The inlet may extend above the ground level with openings on one or more sides or it may be flush with the ground with a grated cover.

Drop Structures. A sloping or vertical section of a channel designed to reduce the elevation of flowing water without increasing its velocity.

Entrance Head. The head required to cause flow into a conduit or other structure; it includes both entrance loss and velocity head.

Entrance Loss. Head lost in eddies or friction at the inlet to a conduit, headwall or structure.

Erosion control. Treatment measures for the prevention of damages due to soil movement and to deposition.

Evaporation. Process by which water is transferred from land and water masses to the atmosphere.

Excavation. Digging and removal of earth by mechanical means.

Exceedance Probability. The statistical probability that an event will equal or exceed a specific magnitude.

Fill. The placement of material such as soil or rock to replace existing material, or to create an elevated embankment. Fill also refers to the material which is placed.

Flash Flood. A flood of short duration with a relatively high peak rate of flow, usually resulting from high intensity rainfall over a small area.

Flexible Pipe. Any corrugated metal pipe, pipe arch, sectional plate pipe, sectional plate pipe arch or plastic (polyethylene) pipe.

Flood or Flooding. A general and temporary condition of inundation of normally dry land areas by surface runoff. The 100 year flood is the flow rate with a 1% probability of being equaled or exceeded in any one year.

Flood Control. The elimination or reduction of flood damage by the construction of flood storage reservoirs, channel improvements, dikes and levees, bypass channels, or other engineering works.

Flood Hazard Area. Area subject to flooding by 100 year frequency floods.

Flood Hazard Mitigation. See Stormwater Management.

Flood Management. See Stormwater Management.

Floodplain. Geographically the entire area subject to flooding. In usual practice, it is the area subject to flooding by the 100 year frequency flood. In this manual, the "100 year floodplain" refers to the floodplain resulting from a 100 year flood based on ultimate watershed development conditions. The "FEMA floodplain" shall refer to the area subject to flooding resulting from the 100 year flood for current watershed development conditions.

Floodway. The channel of a river, or other watercourse, and the adjacent land areas that must be reserved in order to discharge the base flood without cumulatively increasing the water surface elevation by more than a designated height. In this manual, the floodway refers to the floodway resulting from a 100 year flood event based on ultimate development conditions.

Floodway Fringe. Part of the flood hazard area within the floodplain but outside of the floodway.

Freeboard. The distance between the normal operating level and the top of the side of an open conduit left to allow for wave action, floating debris, or any other condition or emergency without overtopping the structure.

Frequency. Average recurrence interval of a given flood event over long periods of time. Mathematically, frequency is the reciprocal of the exceedance probability.

Froude Number. A flow parameter which is a measure of the extent to which gravitational action affects the flow. A Froude number greater than one indicates supercritical flow and a value less than one indicates subcritical flow.

Fully developed watershed. A hydrologic condition in which all areas upstream and downstream of a point in question are assumed completely developed, including any undeveloped areas which are assumed to be developed in accordance with development densities established by the City of New Braunfels.

Gabion. A wire basket containing earth or stones, deposited with others to provide protection against erosion.

Grade. (a) The inclination or slope of a channel, canal, conduit, etc., or natural ground surface, usually expressed in terms of the percentage of number of units of vertical rise (or fall) per unit of horizontal distance. (b) The elevation of the bottom of a conduit, canal, culvert, sewer, etc. (c) The finished surface of a canal bed, road bed, top of an embankment, or bottom of excavation.

Grading. Any movement of soil, rock or vegetation by artificial means, to include any or all of the following acts: clearing, grubbing, excavating, placement of fill material, or grading of land.

Grate Inlet. An opening in the gutter covered by one or more grates through which the water falls. As with all inlets, grated inlets may be either depressed or undepressed and may be located either on a continuous grade or in a sump.

Gutter. A generally shallow waterway adjacent to a curb, used or suitable for drainage of water.

Head. The amount of energy per pound of fluid.

Headwater. (a) The upper reaches of a stream near its sources; (b) the region where ground waters emerge to form a surface stream; (c) the water upstream from a structure.

High Intensity Node. Areas of existing or proposed development that contain a large concentration of buildings and large amounts of pavement. High Intensity nodes typically generate large volumes of storm water runoff.

Histogram. Representation of statistical data by means of rectangles whose widths represent rainfall, runoff, etc. and whose height represents frequency.

Hydraulic Control. The hydraulic characteristic which determines the stage discharge relationship in a flowing stream or conduit. The control is usually critical depth, tailwater depth or uniform depth.

Hydraulic Grade Line. A line representing the pressure head available at any given point within the system.

Hydraulic Gradient. A hydraulic profile of the piezometric level of the water, representing the sum of the depth of flow and the pressure head. In open channel flow it is the water surface.

Hydraulic Jump. The hydraulic jump is an abrupt rise in the water surface which occurs in an open channel when water flowing at supercritical velocity is retarded by water flowing at subcritical velocity. The transition through the jump results in a marked loss of energy, evidenced by turbulence of the flow within the area of the jump. The hydraulic jump is sometimes used as a means of energy dissipation.

Hydraulics. A branch of science that deals with practical applications of the mechanics of water movement.

Hydrograph. A graph showing flow (or sometimes stage, velocity or other properties of water) versus time at a given point on a stream or conduit.

Hydrology. The science that deals with the processes governing the depletion and replenishment of the water resources of the land areas of the earth.

Hyetograph. A histogram or graph of rainfall intensity versus time usually during a storm.

Impervious. A term applied to a material through which water cannot pass, or through which water passes with great difficulty.

Infiltration. (a) The entering of water through the interstices or pores of a soil or other porous medium; (b) the quantity of groundwater which leaks into a sanitary or combined sewer or drain through defective joints, breaks or porous walls; (c) The absorption of water by soil, either as it falls as precipitation or from a stream flowing over the surface.

Inlet. (a) An opening into a storm sewer system for the entrance of surface storm runoff, more completely described as a storm sewer inlet; (b) a structure at the diversion end of a conduit; (c) the upstream connection between the surface of the ground and a drain or sewer, for the admission of surface or storm water.

Intensity. As applied to rainfall, a rate usually expressed in inches per hour.

Interception. As applied to hydrology, refers to the process by which precipitation is caught and held by foliage, twigs, and branches of trees, shrubs and buildings, never reaching the surface of the ground, and then lost by evaporation.

Invert. The floor, bottom, or lowest portion of the internal cross-section of a conduit. Used particularly with reference to storm drains, sewers, tunnels, channels and swales.

Lag Time. The time difference between two occurrences, such as between rainfall and runoff or pumping of a well and effect on the stream. See Time of Concentration.

Lining. The material placed on the sides and bottom of a ditch, a channel, and/or a reservoir to prevent or reduce seepage of water through the sides and bottom and/or to prevent erosion.

Lip. A small wall on the downstream end of an apron, to break the flow from the apron.

Maintenance. The cleaning, shaping, grading, repair and minor replacement of drainage, flood control and erosion facilities, but not including the cost of power consumed in the normal operation of pump stations.

Major facility. Any facility, including a street or alley, which would collect, divert, or convey a peak discharge of more than 50 cubic feet per second (50 cfs) or store more than 2.0 acre feet of runoff in the event of a 50 year design storm.

Manning Coefficient. The coefficient of roughness used in the Manning Equation for flow in open channels.

Manning Equation. A uniform flow equation used to relate velocity, hydraulic radius and the energy gradient.

Minor facility. Any facility which would collect, divert or convey a peak discharge of 50 cubic feet per second (50 cfs) or less, or store 2 acre feet of water or less in the event of the 50 year design storm.

Model. Mathematical systems analysis by computer, applied to evaluate rainfall runoff relationships; simulate watershed characteristics; predict flood and reservoir routings; or for other aspects of planning.

Multiple use facility. A drainage control, flood control or erosion control facility in which other secondary uses are planned or allowed, including but not limited to recreation, open space, transportation, and utility location.

Nappe. The sheet or curtain of water overflowing a weir or dam. When freely overflowing any given structure, it has a well defined upper and lower surface.

100 year Event. Event (rainfall or flood) that statistically has a one percent chance of being equaled or exceeded in any given year.

Open Channel. The general term for a conduit in which water flows with a free surface.

Orifice. (a) An opening with closed perimeter and regular form in a plate, wall, or partition, through which water may flow; (b) the end of a small tube, such as a Pitot tube, piezometer, etc.

Peak Flow. The maximum rate of runoff during a given runoff event.

Percolation. To pass through a permeable substance such as ground water flowing through an aquifer.

Permeability. The property of a material which permits movement of water through it when saturated and actuated by hydrostatic pressure.

Pervious. Applied to a material through which water passes relatively freely.

Porosity. (a) An index of the void characteristics of a soil or stratum as pertaining to percolation; degree of perviousness; (b) the ratio, usually expressed as a percentage, of the volume of the interstices in a quantity of material to the total volume of the material.

Post development. The condition of the given site and drainage area after the anticipated development has taken place.

Precipitation. Any moisture that falls from the atmosphere, including snow, sleet, rain and hail.

Pre development. The condition of the given site and drainage area prior to development.

Prismatic Channel. A channel with unvarying cross-section and constant bottom slope.

Probable Maximum Flood (PMF). The flood that may be expected from the most severe meteorological and hydrologic conditions that are reasonably possible in the region.

Probable Maximum Precipitation (PMP). The critical depth duration area rainfall relationship for a given area during a storm containing the most critical meteorological conditions considered probable of occurring.

Rainfall Duration. The length of time over which a single rainfall event occurs.

Rainfall Frequency. The average recurrence interval of rainfall events, averaged over long periods of time.

Rainfall Intensity. The rate of accumulation of rainfall, usually in inches or millimeters per hour.

Rational Formula. A traditional means of relating runoff from a drainage basin to the intensity of the storm rainfall, the size of the basin, and the characteristics of the basin (such as land use, impervious cover).

Reach. Any length of river or channel. Normally refers to sections which are uniform with respect to discharge, depth, area or slope, or sections between gauging stations.

Recurrence Interval. The average interval of time within which a given event is statistically predicted to be equaled or exceeded once. For an annual series (as opposed to a partial duration series), it is the probability of occurrence interval. Thus a flood having a recurrence interval of 100 years has a one percent probability of being equaled or exceeded.

Return Period. See Recurrence Interval

Reynold's Number. A flow parameter which is a measure of the viscous effects on the flow.

Rigid Pipe. Any concrete, clay or cast iron pipe.

Riprap (Revetment). Forms of bank channel protection, usually using rock or concrete. Riprap is a term sometimes applied to stone which is dumped rather than placed more carefully.

Routing. Routing is a technique used to predict the temporal and spatial variations of a flood wave as it traverses a river reach or reservoir. Generally, routing technique may be classified into two categories hydrologic routing and hydraulic routing.

Right-of-way (ROW). A strip of land dedicated for public streets and/or related facilities, including utilities, drainage systems and other transportation uses.

ROW Width. The shortest horizontal distance between the lines which delineate the limits of right of way of a street.

Runoff. That part of the precipitation that exceeds abstractions and reaches a stream or storm drain.

Runoff Coefficient. A decimal number used in the Rational Formula, which defines the runoff characteristics (i.e., land use impervious cover) of the drainage area under consideration. It may be applied to an entire drainage basin as a composite representation or it may be applied to a small individual area such as one residential lot.

Runoff Total. The total volume of flow from a drainage area for a definite period of time such as a day, month, year, or for the duration of a particular storm.

Scour. The erosive action of running water, in streams or channels, in excavating and carrying away material from the bed and banks.

SCS Runoff Curve Number. Index number used by the Soil Conservation Service as a measure of the tendency of rainfall to run off into streams rather than evaporate or infiltrate.

Sediment. Material of soil and rock origin transported, carried, or deposited by flowing water.

Sidewalk. A paved area within the street right of way specifically designed for pedestrians and/or bicyclists.

Slope, Critical. (a) The slope or grade of a channel that is exactly equal to the loss of head per foot resulting from flow at a depth that will give uniform flow at critical depth; (b) the slope of a conduit which will produce critical flow.

Slope, Friction. The friction head or loss per unit length of channel or conduit. For uniform flow the friction slope coincides with the energy gradient. Where a distinction is made between energy losses due to bends, expansions, impacts, etc., a distinction must also be made between the friction slope and the energy gradient. The friction slope is equal to the bed or surface slope only for uniform flow in uniform open channels.

Soffit. The top of the inside of a pipe. In a pipe, the uppermost point on the inside of the structure.

Spillway. A waterway in or about a dam or other hydraulic structure for the escape of excess water.

Steady Flow. Open channel flow is said to be steady if the depth of flow does not change and can be assumed to be constant during the time interval under consideration.

Stilling Basin. Pool of water conventionally used, as part of a drop structure or other structure, to dissipate energy.

Storm Hydrology. The branch of hydrology that concentrates on the calculation of runoff from storm rainfall.

Stormwater Management. The control of storm runoff by means of land use restrictions, detention storage, erosion control, and/or drainage systems

Stormwater Model. Mathematical method of solving stormwater problems by computer technology.

Streets. The classifications and descriptions of streets, such as alley, arterial, collector, freeway, local, parkway, etc., established by the City of New Braunfels in the Thoroughfare/Transportation Plan.

Subcritical Flow. Relatively deep, tranquil flow with low flow velocities. The Froude Number is less than 1.0 for subcritical flow conditions.

Supercritical Flow. Relatively shallow, turbulent flow with high velocities. The Froude Number is greater than 1.0 for supercritical flow conditions.

Swale. A low lying or depressed stretch of land without a defined channel or tributary.

Tailwater. The depth of flow in the stream directly downstream of a drainage facility or other man made control structure.

Temporary drainage facility. A non-permanent drainage control, flood control or erosion control facility constructed as part of a phased project or to serve until such time that a permanent facility is in place, including but not limited to desilting ponds, berms, diversions, channels, detention ponds, erosion control measures, bank protection and channel stabilization measures.

Time of Concentration. The estimated time in minutes required for runoff to flow from the most hydraulically remote section of the drainage area to the point at which the flow is to be determined. Hydraulically remote refer to the travel path with the longest flow travel time, not necessarily the longest linear distance.

Total Head Line. A line representing the energy in flowing water. The elevation of the energy line is equal to the elevation of the flow line plus the depth plus the velocity head plus the pressure head.

Trash Rack. Racks, gratings, or mesh designed so as to prevent tree limbs, water borne debris and rubbish from plugging the outlets from a dam or detention basin.

Trunk Line. The main line of a storm drain system, extending from manhole to manhole or from manhole to outlet structure.

Ultimate Development. The condition of the watershed after the entire watershed has undergone development.

Uniform Channel. A channel with a constant cross section, slope and roughness.

Uniform Flow. Open channel flow is said to be uniform if the depth of flow is the same at every section of the channel.

Unit Hydrograph. The direct runoff hydrograph resulting from one inch of precipitation excess, distributed uniformly over a watershed for a specified duration.

Velocity Head. The energy per unit weight of water due to its velocity. The velocity head also represents the vertical distance water must fall freely under gravity to reach its velocity.

Warped Headwall. The wingwalls are tapered from vertical at the abutment to a stable bank slope at the end of the wall.

Water Year. The water year commonly used in the United States is the period from October 1 of the previous calendar year to September 30 of the numbered calendar year.

Watershed. The area contributing storm runoff to a stream or drainage system. Other terms are drainage area, drainage basin and catchment area.

This page intentionally left blank.

Appendix C: Stream Bank Erosion Hazard Setbacks Exhibit

New Braunfels

Stream Setback Exhibit


Legend

- Stream Setback 100 (ft) (Red)
- Stream Setback 50 (ft) (Dark Red)
- Stream Setback 0 (ft) (Light Blue)
- Streets (Grey lines)
- New Braunfels City Limits (Dashed black lines)
- FEMA Floodplain 100 Yr (Blue)
- FEMA Floodplain 500 Yr (Light Blue)

Drainage Basin Area (sq mi)

< 1 (sq mi)	0 (ft) Setback
1 - 5 (sq mi)	50 (ft) Setback
> 5 (sq mi)	100 (ft) Setback

2



1 inch = 1 mile



Lockwood, Andrews & Newnam, Inc.
A LEO A DALY COMPANY

